


UNIFORM BUILDING CODE

**1940
EDITION**



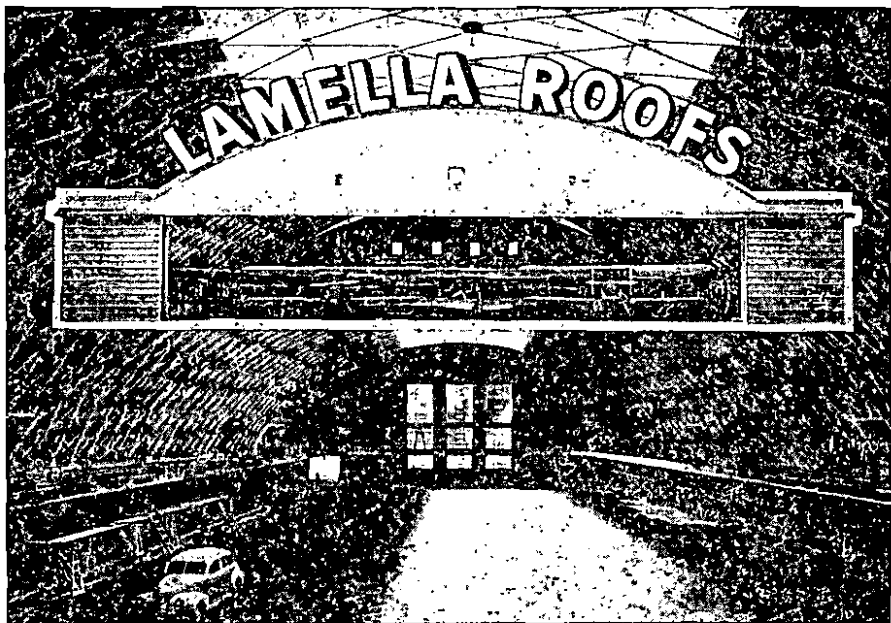


S U M M E R B E L L

ROOF STRUCTURES



Lamella Roofs and Summerbell Roof Trusses are widely adaptable to structures being built as part of the National Defense Program — as well as to buildings required for normal commercial, industrial, fraternal and educational uses . . . Summerbell Engineers are glad to render advisory service without obligation to Architects and Engineers.

754 East 29th Street • ADams 6166 • Los Angeles

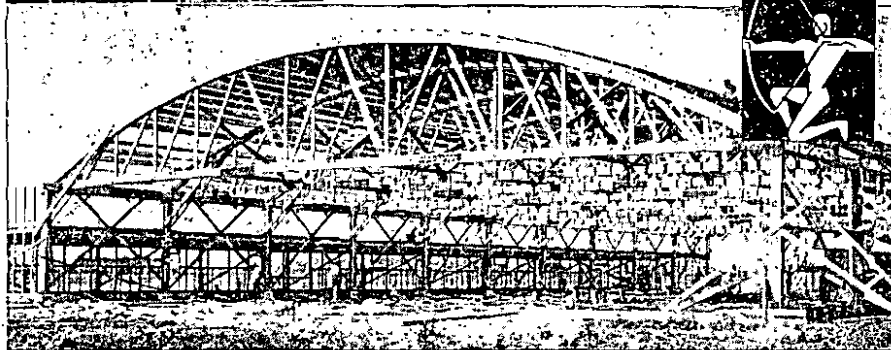

YOU'LL RECOGNIZE REDWOOD ON THE JOB!

Let this familiar name, clearly marked on every piece,
help you keep ahead of inspection schedules



Foundation grade Redwood is the special-use grade selected for durability under PCUBC standards.

You'll recognize also the three Certified Dry Grades, used for siding, trim, finish—wherever dry lumber is needed:

CLEAR ALL HEART CERTIFIED DRY REDWOOD
A GRADE CERTIFIED DRY REDWOOD
B GRADE CERTIFIED DRY REDWOOD

And "commons" of uncommon durability:

NO. 1 HEART COMMON REDWOOD
NO. 2 COMMON REDWOOD
NO. 3 COMMON REDWOOD

*Technical information on any subject of Redwood utilization
may be obtained by writing the Technical Department.*

CALIFORNIA REDWOOD ASSOCIATION

405 Montgomery Street
San Francisco, Calif.

832 West Fifth Street
Los Angeles, Calif.

SISALKRAFT

"BETTER BUILDING PAPER"

WATERPROOF

WINDPROOF

DURABLE

STRONG

USE IT

- **Back of Stucco**
- **Over Sheathing**
- **For Curing & Protecting Concrete**

COPPER ARMORED SISALKRAFT

"Copper Protection At New Low Cost"


USE FOR: Flashing openings — head and sill protection — Membrane waterproofing — foundation damp coursing — waterproofing shower stalls — and many other practical applications on every job.

THE SISALKRAFT

San Francisco
55 New Montgomery St.

Los Angeles
10519 Dunleer Drive

Better CONSTRUCTION *thru Better* MATERIALS



Behind the U·S·S Symbol is the constant effort of 1700 metallurgists and chemists working in 87 laboratories, insuring that U·S·S Products are manufactured to meet the most exacting specifications.

NATIONAL PIPE AND BOILER TUBES
ELECTRICAL WIRES — WIRE FABRIC
NAILS — WIRE — WIRE FENCE — GATES
STRUCTURAL SHAPES — PLATES
REINFORCING BARS — MERCHANT BARS
STAINLESS STEELS — ALLOY STEELS
STEEL SHEETS — SHEET STEEL PILING

COLUMBIA STEEL COMPANY

San Francisco
Seattle

Los Angeles

Salt Lake City
Portland

UNITED STATES STEEL

INTERNATIONAL CODE COUNCIL
 1940 ICC. ALL RIGHTS RESERVED.
 ORDER NUMBER #101943106
 FEB 04, 2025 01:32 PM (CST)
 PURSUANT TO LICENSE AGREEMENT WITH ICC. NO FURTHER REPRODUCTION, NO FURTHER REPRODUCTIONS

Preface

¶ The Uniform Building Code is dedicated to the development of better building construction and greater safety to the public, through the elimination of needless red tape, favoritism and local politics by uniformity in building laws; to the granting of full justice to all building materials on the fair basis of the true merits of each material; and to the development of a sound economic basis for the future growth of cities through unbiased and equitable dealing with structural design and fire hazards.

OUTLINE OF PROCEDURE STATE CHAMBER CODE CORRELATING COMMITTEE

¶ The California State Chamber of Commerce Building Code has been officially presented to the Pacific Coast Building Officials Conference, and will be used as a reference work in connection with future revisions of the Uniform Building Code. A committee has been appointed to carry on this work. This is a Conference project and the committee recommendations will be submitted through regular channels to the membership for their study and action.

¶ It has always been the policy of the Conference to consult with all organizations and individuals having an interest in regulations considered for adoption in the Uniform Building Code in order to eliminate discrimination, economic waste and severity, and to assist arranging the material in the most convenient and usable form.

¶ Structural engineers and architects are largely governed in the conduct of their business by the provisions of various codes. They should be vitally interested in the present study and representatives from each of these groups should sit in and consult with the committee while this work is in progress.

¶ It is not the intention of the Conference to change the form or sequence of the presentation of the regulations in the present Uniform Building Code. The committee is instructed to recommend any desirable material in the Chamber of Commerce Code for insertion in its proper place in the Uniform Building Code.

OUTLINE OF CONTENTS BY PARTS, CHAPTERS AND SECTIONS

	Page
Part I—Administrative	
CHAPTER 1. Title and Scope.....	19
SEC. 101. Title	
102. Purpose	
103. Scope	
104. Application to Existing Buildings	
(a) Major Alterations and Repairs	
(b) Changed Use	
(c) Additions	
(d) Structural Alterations and Repairs	
(e) Non-structural Alterations and Repairs	
105. Maintenance	
CHAPTER 2. General Provisions.....	21
SEC. 201. Application for Permit	
202. Building Permits	
203. Fees	
204. Inspection and Registered Inspectors	
(a) Inspection Required	
(b) Special Engineering Supervision	
205. Certificate of Compliance	
206. Certificate of Occupancy	
207. Change of Occupancy	
CHAPTER 3. Enforcement	26
SEC. 301. Powers and Duties of Building Inspector	
302. (a) Alternate Materials and Types of Construction	
(b) Tests of Materials and Systems of Construction	
303. Appeals	
304. Board of Examiners and Appeals	
305. Violations and Penalties	
Part II—Definitions.	
CHAPTER 4. Definitions	30
SEC. 401. Definitions	
Part III—Requirements Based on Occupancy.	
CHAPTER 5. Classification of All Buildings by Use or Occupancy and General Requirements for All Occupancies.....	36
SEC. 501. Occupancy Classified	
502. Change in Use	
503. Mixed Occupancy	
504. Location on Property	
CHAPTER 6. Requirements for Group A Occupancies..	40
SEC. 601. Group A Occupancies Defined	

Page

- 602. Construction, Height and Area Allowable
- 603. Location on Property
- 604. Exit Facilities
- 605. Light and Ventilation
- 606. Enclosure of Vertical Openings
- 607. Fire Extinguishing Apparatus
- 608. Special Hazards
- 609. Exceptions and Deviations
- 610. Mixed Occupancies

CHAPTER 7. Requirements for Group B Occupancies.. 46

- SEC. 701. Group B Occupancies Defined
- 702. Construction, Height and Area Allowable
- 703. Location on Property
- 704. Exit Facilities
- 705. Light and Ventilation
- 706. Enclosure of Vertical Openings
- 707. Fire Extinguishing Apparatus
- 708. Special Hazards
- 709. Exceptions and Deviations
- 710. Mixed Occupancies

CHAPTER 8. Requirements for Group C Occupancies.. 49

- SEC. 801. Group C Occupancies Defined
- 802. Construction, Height and Area Allowable
- 803. Location on Property
- 804. Exit Facilities
- 805. Light and Ventilation
- 806. Enclosure of Vertical Openings
- 807. Fire Extinguishing Apparatus
- 808. Special Hazards
- 809. Exceptions and Deviations
- 810. Mixed Occupancies

CHAPTER 9. Requirements for Group D Occupancies 55

- SEC. 901. Group D Occupancies Defined
- 902. Construction, Height, and Area Allowable
- 903. Location on Property
- 904. Exit Facilities
- 905. Light and Ventilation
- 906. Enclosure of Vertical Openings
- 907. Fire Extinguishing Apparatus
- 908. Special Hazards
- 909. Exceptions and Deviations
- 910. Mixed Occupancies

CHAPTER 10. Requirements for Group E Occupancies 58

- SEC. 1001. Group E Occupancies Defined
- 1002. Construction, Height and Area Allowable
- 1003. Location on Property

- 1004. Exit Facilities
- 1005. Light, Ventilation and Sanitation
- 1006. Enclosure of Vertical Openings
- 1007. Fire Extinguishing Apparatus
- 1008. Special Hazards
- 1009. Exceptions and Deviations
- 1010. Mixed Occupancies

CHAPTER 11. Requirements for Group F Occupancies 62

- SEC. 1101. Group F Occupancies Defined
- 1102. Construction, Height and Area Allowable
- 1103. Location on Property
- 1104. Exit Facilities
- 1105. Light, Ventilation and Sanitation
- 1106. Enclosure of Vertical Openings
- 1107. Fire Extinguishing Apparatus
- 1108. Special Hazards
- 1109. Exceptions and Deviations
- 1110. Mixed Occupancies

CHAPTER 12. Requirements for Group G Occupancies 64

- SEC. 1201. Group G Occupancies Defined
- 1202. Construction, Height and Area Allowable
- 1203. Location on Property
- 1204. Exit Facilities
- 1205. Light, Ventilation and Sanitation
- 1206. Enclosure of Vertical Openings
- 1207. Fire Extinguishing Apparatus
- 1208. Special Hazards
- 1209. Exceptions and Deviations
- 1210. Mixed Occupancies

CHAPTER 13. Requirements for Group H Occupancies 66

- SEC. 1301. Group H Occupancies Defined
- 1302. Construction, Height and Area Allowable
- 1303. Location on Property
- 1304. Exit Facilities
- 1305. Light, Ventilation and Sanitation
- 1306. Enclosure of Vertical Openings
- 1307. Fire Extinguishing Apparatus
- 1308. Special Hazards
- 1309. Exceptions and Deviations
- 1310. Mixed Occupancies

CHAPTER 14. Requirements for Group I Occupancies 69

- SEC. 1401. Group I Occupancies Defined
- 1402. Construction and Area Allowable
- 1403. Location on Property
- 1404. Exit Facilities
- 1405. Light, Ventilation and Sanitation
- 1406. Enclosure of Vertical Openings
- 1407. Fire Extinguishing Apparatus

	Page
1408. Special Hazards	
1409. Exceptions and Deviations	
1410. Mixed Occupancies	
CHAPTER 15. Requirements for Group J Occupancies	70
SEC. 1501. Group J Occupancies Defined	
1502. Construction, Height and Area Allowable	
1503. Location on Property	
1504. Exit Facilities	
1505. Light and Ventilation	
1506. Enclosure of Vertical Openings	
1507. Fire Extinguishing Apparatus	
1508. Special Hazards	
1509. Exceptions and Deviations	
1510. Mixed Occupancies	

Part IV—Requirements Based on Location in Fire Zones.

CHAPTER 16. Restrictions in Fire Zones	72
SEC. 1601. Fire Zones Defined	
1602. Restrictions in Fire Zone No. 1	
1603. Restrictions in Fire Zone No. 2	
1604. Restrictions in Fire Zone No. 3	

Part V—Requirements Based on Types of Construction.

CHAPTER 17. Classification of All Buildings by Types of Construction	75
SEC. 1701. General	
1702. Classification by Types of Construction	
CHAPTER 18. Type I Buildings (Fire-Resistive)	76
SEC. 1801. Definition	
1802. Height Allowable	
1803. Area Allowable	
1804. Foundations	
1805. Exterior and Inner Court Walls	
1806. Partitions	
1807. Enclosure of Vertical Openings	
1808. Structural Framework	
1809. Fire-protection of Structural Members	
1810. Floor Construction	
1811. Roof Construction	
1812. Stair Construction	
1813. Doors and Windows	
1814. Projections from the Building	
1815. Penthouses and Skylights	
1816. Combustible Materials Regulated	

	Page
CHAPTER 19. Type II Buildings (Heavy Timber Construction)	81
SEC. 1901. Definition	
1902. Height Allowable	
1903. Area Allowable	
1904. Foundations	
1905. Exterior and Inner Court Walls	
1906. Partitions	
1907. Enclosure of Vertical Openings	
1908. Structural Framework	
1909. Fire-protection of Structural Members	
1910. Floor Construction	
1911. Roof Construction	
1912. Stair Construction	
1913. Doors and Windows	
1914. Projections from the Building	
1915. Penthouses and Skylights	
1916. Combustible Materials Regulated	
CHAPTER 20. Type III Buildings (Ordinary Masonry)	86
SEC. 2001. Definition	
2002. Height Allowable	
2003. Area Allowable	
2004. Foundations	
2005. Exterior and Inner Court Walls	
2006. Partitions	
2007. Enclosure of Vertical Openings	
2008. Structural Framework	
2009. Fire-protection of Structural Members	
2010. Floor Construction	
2011. Roof Construction	
2012. Stair Construction	
2013. Doors and Windows	
2014. Projections from the Building	
2015. Penthouses and Skylights	
2016. Combustible Materials Regulated	
CHAPTER 21. Type IV Buildings (Light Incombustible Frame)	89
SEC. 2101. Definition	
2102. Height Allowable	
2103. Area Allowable	
2104. Foundations	
2105. Exterior Walls	
2106. Partitions	
2107. Enclosure of Vertical Openings	
2108. Structural Framework	
2109. Fire-protection of Structural Members	
2110. Floor Construction	
2111. Roof Construction	
2112. Stair Construction	
2113. Doors and Windows	
2114. Projections from the Building	
2115. Penthouses and Skylights	

	Page
CHAPTER 22. Type V Buildings (Wood Frame).....	92
SEC. 2201. Definition	
2202. Height Allowable	
2203. Area Allowable	
2204. Foundations	
2205. Exterior Walls and Wall Coverings	
2206. Interior Partitions	
2207. Enclosure of Vertical Openings	
2208. Structural Framework	
2209. Fire-Protection of Structural Members	
2210. Floor Construction	
2211. Roof and Ceiling Construction	
2212. Stair Construction	
2213. Doors and Windows	
2214. Projections from the Building	
2215. Penthouses and Skylights	
2216. Combustible Materials Regulated	

Part VI—Engineering Regulations, Quality and Design of the Materials of Construction.

CHAPTER 23. Live and Dead Loads.....	115
SEC. 2301. Definitions	
2302. Loads	
2303. Method of Design	
2304. Unit Live Loads	
2305. Roof Loads	
2306. Reduction of Live Loads	
2307. Wind Pressure	
2308. Live Loads and Seating Capacity Posted	
2309. Occupancy Permits for Changed Floor Loading	
2310. Retaining Walls and Basement Floors	
2311. Footing Design	
2312. Earthquake Regulations	
CHAPTER 24. Masonry (Quality and Design).....	119
SEC. 2401. General	
2402. Burned Clay or Shale Brick	
2403. Sand-Lime Brick	
2404. Concrete Brick	
2405. Hollow Clay Tile	
2406. Hollow Concrete Block or Tile	
2407. Plain Concrete	
2408. Cast Stone	
2409. Gypsum	
2410. Mortar	
2411. Allowable Working Stresses	
2412. Special Requirements	
CHAPTER 25. Wood (Quality and Design).....	127
SEC. 2501. General	
2502. Determination of Required Sizes	
2503. Allowable Unit Stresses	
2504. Horizontal Shear	
2505. Columns	

	Page
2506. Combined Stresses	
2507. Compression on Inclined Surfaces	
2508. Bolted Joints	
2509. Timber Connectors	
2510. Cylindrical Pins	
2511. Lag Screws	
2512. Wood Screws	
2513. Nails	
2514. Washers	
2515. Columns or Posts	
2516. Built Up Columns or Compression Members	
2517. Horizontal Members	
2518. Wall Anchors and Ties	
2519. Header and Tail Joists	
2520. Bridging	
2521. Cutting and Notching	
2522. Deflection	
2523. Laminated Floors	
2524. Stud Walls and Partitions	
2525. Nailing and Fastening	
2526. Fire Stops	
2527. Foundation Ventilation	
2528. Wood Diaphragms	
2529. Termite Provisions	
 CHAPTER 26. Reinforced Concrete (Quality and Design)	 146
SEC. 2601. Quality	
2602. Design	
2603. Definitions	
2604. Materials	
2605. Tests	
2606. Quality of Concrete	
2607. Proportions and Consistency	
2608. Control of Proportions	
2609. Mixing and Placing Concrete	
2610. Forms and Details of Construction	
2611. Assumptions for Design	
2612. Symbols and Notations	
2613. Working Stresses	
2614. Flexural Computations	
2615. Shrinkage and Temperature Reinforcement	
2616. Two-Way Slabs	
2617. Shear and Diagonal Tension	
2618. Bond and Anchorage	
2619. Flat-Slab Construction	
2620. Reinforced Concrete Columns	
2621. Footings	
2622. Precast Concrete Joists	
2623. Composite Beams	
 CHAPTER 27. Steel and Iron (Quality and Design).....	 187
SEC. 2701. Quality and Design	
2702. Allowable Unit Stresses	

	Page
2703. Eccentric Loads	
2704. Beams and Girders	
2705. Thickness of Materials	
2706. Compression Splices	
2707. Gross and Net Sections	
2708. Connections	
2709. Rivets and Bolts	
2710. Welded Connections	
2711. Construction Details	
2712. Lattice	
2713. Pins and Pin Holes	
2714. Bearing Plates and Anchorage	
2715. Light Steel Construction	
2716. Expansion	
2717. Workmanship	
2718. Painting	
2719. Erection	

Part VII—Detailed Regulations.

CHAPTER 28. Excavations, Footings and Foundations	203
SEC. 2801. Excavations	
2802. Footings and Foundations	
2803. Piles	
2804. Caissons	
CHAPTER 29. Walls and Partitions	208
SEC. 2901. Solid Masonry	
Walls: General Provisions	
2902. Working Stresses	
2903. Thickness of Exterior Walls other than Skeleton Construction	
2904. Bond	
2905. Piers	
2906. Chases and Recesses	
2907. Hollow Walls: General Provisions	
2908. Working Stresses	
2909. Thickness and Height of Walls other than Skeleton Construction	
2910. Bond	
2911. Beam Supports	
2912. Piers	
2913. Chases and Recesses	
2914. Reinforced Concrete Walls: General Provisions	
2915. Minimum Thickness	
2916. Anchorage and Reinforcement	
2917. Piers	
2918. Chases and Recesses	
2919. Quality of Material (Stone Walls)	
2920. Working Stresses	
2921. Lateral Support and Thickness	
2922. Bond	
2923. Chases and Recesses	
2924. Quality of Material (Veneered Walls)	
2925. Working Stresses	

2926.	Attachment of Veneering	
2927.	Height of Veneered Walls	
2928.	Quality of Material (Faced Walls)	
2929.	Working Stresses	
2930.	Thickness	
2931.	Bond	
2932.	Solid Masonry Walls	
2933.	Hollow Masonry Walls	
2934.	Party Walls	
2935.	Parapet Walls	
2936.	Bearing Partitions	
2937.	Non-bearing Partitions	
2938.	Foundation Walls	
2939.	Panel and Enclosure Walls	
2940.	Anchoring of Walls	
2941.	Use of Existing Walls	
CHAPTER 30.	Enclosure of Vertical Openings	221
SEC. 3001.	Enclosures; When Required	
3002.	Stairway, Ramp and Elevator Enclosures	
3003.	Other Vertical Openings	
CHAPTER 31.	Floor Construction	222
SEC. 3101.	General	
3102.	Concrete Floors	
3103.	Steel Joisted Floors	
3104.	Mill Constructed Floors	
3105.	Wood Joisted Floors	
CHAPTER 32.	Roof Construction and Covering	225
SEC. 3201.	General	
3202.	Construction	
3203.	Design	
3204.	Roof Coverings	
3205.	Attics: Access and Area	
3206.	Roof Drainage	
CHAPTER 33.	Stairs, Ramps and Smokeproof Towers	227
SEC. 3301.	General Requirements	
3302.	General Design	
3303.	Arrangement and Access	
3304.	Doors	
3305.	Railings	
3306.	Lighting	
3307.	Detailed Requirements	
3308.	Stairway Enclosures	
3309.	Stairways Required	
3310.	Ramps	
3311.	Horizontal Exits	
3312.	Signs and Lighting	
3313.	Passageways and Corridors	
3314.	Exceptions	
3315.	Smokeproof Towers	
3316.	Outside Stairways	

	Page
CHAPTER 34. Doors, Windows and Skylights.....	234
SEC. 3401. Doors and Windows	
3402. Skylights	
CHAPTER 35. Bays and Balconies.....	235
SEC. 3501. Construction	
CHAPTER 36. Penthouses and Roof Structures.....	236
SEC. 3601. Penthouses and Roof Structures	
3602. Towers and Spires	
CHAPTER 37. Chimneys and Heating Apparatus.....	237
SEC. 3701. Chimneys	
3702. Smokestacks	
3703. Gas Vents	
3704. Patent Chimneys	
3705. Smoke Pipes and Thimbles	
3706. Fireplaces	
3707. Warm Air Furnaces	
3708. Low Pressure Steam Heating Plants	
3709. Boilers	
3710. Stoves	
3711. Gas Ranges, Domestic Water Heaters and Hot Plates	
3712. Gas Ranges for Restaurants and Hotels	
3713. Oil Burners	
3714. Other Sources of Heat	
3715. Warm Air Ducts and Appurtenances	
3716. Incinerators	
CHAPTER 38. Fire Extinguishing Apparatus.....	246
SEC. 3801. Automatic Sprinklers; Where Required	
3802. Detailed Requirements	
3803. Dry Standpipes; Where Required	
3804. Detailed Requirements	
3805. Wet Standpipes; Where Required	
3806. Detailed Requirements	
3807. Basement Pipe Inlets	
3808. Approvals	
3809. Flame Protection	
CHAPTER 39. Stages and Platforms.....	251
SEC. 3901. Stage Ventilators	
3902. Gridirons	
3903. Rooms Accessory to Stage	
3904. Proscenium Walls	
3905. Stage Floors	
3906. Platforms	
3907. Stage Exits	
3908. Miscellaneous	
CHAPTER 40. Motion Picture Machine Booths.....	253
SEC. 4001. Motion Picture Machine Booths	
CHAPTER 41. Proscenium Curtains.....	255
SEC. 4101. General Requirements	
4102. Curtain Coverings	
4103. Design and Construction	

	Page
4104. Operating Equipment	
4105. Tests	
4106. New Designs	
Part VIII—Fire-Resistive Standards for Fire Protection.	
CHAPTER 42. General	259
SEC. 4201. Fire-Resistive Construction Defined	
4202. Fire-Resistive Materials	
4203. Fire-Resistive Construction	
CHAPTER 43. Fire-Resistive Standards	261
SEC. 4301. Protection of Structural Parts	
4302. Fire-Resistive Walls and Partitions	
4303. Fire-Resistive Floor and Ceiling Construction	
4304. Fire Doors, Shutters and Windows	
4305. Roof Coverings	
Part IX—Regulations for Use or Occupancy of Streets and Projections Over Public Property.	
CHAPTER 44. Temporary Use of Streets During Construction	276
SEC. 4401. Temporary Use of Streets During Construction	
CHAPTER 45. Permanent Occupancy of Public Property	278
SEC. 4501. Permanent Occupancy of Public Property.	
Part X—Legislative.	
CHAPTER 46. Legislative	280
SEC. 4601. Validity	
4602. Appended Documents	
4603. Ordinances Repealed	
4604. Date Effective	
Part XI—Special Subjects	
CHAPTER 47. Schools	281
CHAPTER 47. Plastering	280
(See Appendix, page 301)	
SEC. 4701 to 4721. Plastering Provisions	
CHAPTER 48. Film Storage	280
(See Appendix, page 313)	
CHAPTER 49. Mechanical Refrigeration	280
(See Appendix, page 314)	
APPENDIX	281
INDEX	323

PACIFIC COAST BUILDING OFFICIALS CONFERENCE

UNIFORM BUILDING CODE

Ordinance No......

An ordinance regulating the erection, construction, enlargement, alteration, repair, moving, removal, conversion, demolition, occupancy, equipment, use, height, area, and maintenance of buildings and/or structures in the City of.....

.....; providing for the issuance of permits and collection of fees therefor; declaring and establishing Fire Districts; providing penalties for the violation thereof, and repealing all ordinances and/or parts of ordinances in conflict therewith.

Be it ordained by the..... of the City of..... as follows:

PART I

ADMINISTRATIVE

CHAPTER 1 — TITLE AND SCOPE

Sec. 101. This Ordinance shall be known as the "Building Title Code," may be cited as such and will be referred to in this Ordinance as "this Code."

Sec. 102. The purpose of this Code is to provide certain minimum standards, provisions and requirements for safe and stable design, methods of construction and uses of materials in buildings and structures hereafter erected, constructed, enlarged, altered, repaired, moved, converted to other uses or demolished and to regulate the equipment, maintenance, use and occupancy of all buildings and structures. **Purpose**

The provisions of this Code shall be deemed to supplement any and all state laws of the State relating to buildings.

Sec. 103. New buildings and structures hereafter erected in the City and buildings and structures moved into the City shall conform to all requirements of this Code; and all requirements in this Code, unless otherwise specifically provided, shall apply to all such buildings and structures. **Scope**

Additions, alterations, repairs and changes of use or occupancy in all buildings and structures shall comply with the requirements for new buildings and structures except as otherwise provided in Section 104 of this Code. (See Chapter 16)

Where, in any specific case, different sections of this code specify different materials or methods of construction, the most restrictive requirement shall govern.

Sec. 104. The following specified requirements shall apply to existing buildings which for any reason whatsoever do not conform to the requirements of this Code for new buildings: **Application to Existing Buildings**

(a) **Major Alterations and Repairs.** If alterations and repairs in excess of 50 per cent of the value of an existing building are made to such building within any period of 12 months, the entire building shall be made to conform with the requirements given herein for new buildings. Any existing building which for any reason whatsoever, requires repairs, at any one time, in excess of 50 per cent of the value thereof, not deducting from such value any loss caused by fire or any other reason, shall be made to conform to the requirements of this Code or shall be demolished, except as specified in Section 1602.

(b) **Changed Use.** If the existing use or occupancy of an existing building is changed to a use or occupancy which would not be permitted in a similar building hereafter erected, the entire building shall be made to conform with the requirements given herein for new buildings; provided, however, that if the use or occupancy of only a portion or portions of an existing building is changed and such portion or portions are segregated as specified in Section 503 of this Code then only such portion or

Sections 104-105

portions of the building need to be made to comply with said requirements; and provided, further, that the Building Inspector is hereby given authority to approve any change in the use or occupancy of any existing building within any one Group of Occupancy as specified in Part III, even though such building is not made to fully conform to the requirements of this Code, when it is obvious that such a change in the use or occupancy of the existing building will not extend or increase any existing non-conformity or hazard of the building.

(c) **Additions.** Any existing building not covered by the preceding paragraphs (a) and (b) which has its floor area or its number of stories increased or its use or occupancy changed in any way from its former or existing use or occupancy shall be provided with stairways, emergency exits and fire protection facilities as required in this Code for buildings hereafter erected for similar uses or occupancies.

(d) **Structural Alterations and Repairs.** Where any alteration or repair is made to the structural portion of any building or structure, the structural portion or any part thereof shall be made to conform to the requirements of this code for new buildings where deemed necessary by the Building Inspector.

(e) **Non-Structural Alterations and Repairs.** Minor non-structural alterations, repairs and changes may be made with the same materials of which the building is constructed; provided, that not more than 25 per cent of the roof covering of any building shall be replaced in any period of 12 months unless the new roof covering is made to conform to the requirements of this Code for new buildings.

New roofing meeting the requirements of this Code may be placed over existing roofing when the existing roofing and roof framing are such as to permit the new roofing to be properly supported and securely fastened.

Maintenance

Sec. 105. The requirements contained in this Code, covering the maintenance of buildings, shall apply to all buildings and structures now existing or hereafter erected. All buildings and structures and all parts thereof shall be maintained in a safe condition, and all devices or safeguards which are required by this Code at the erection, alteration or repair of any building shall be maintained in good working order.

This section shall not be construed as permitting the removal or non-maintenance of any existing devices or safeguards unless authorized in writing by the Building Inspector.

The Chief of the Fire Department shall inspect periodically the storage of volatile or flammable liquids, exits, fire-prevention and fire-extinguishing apparatus and facilities in all buildings or structures, and shall report in writing to the Building Inspector any violations of the provisions of this Code applicable to any building or structure inspected.

CHAPTER 2 — GENERAL PROVISIONS

Sec. 201. No person shall erect or construct or proceed with the erection or construction of any building or structure, nor add to, enlarge, alter, repair, move, convert, extend or demolish any building or structure, or cause the same to be done, without first obtaining a building permit therefor from the Building Inspector. **Application for Permit**

Any person desiring a building permit as required by this Code shall file with the Building Inspector an application therefor in writing on a blank form to be furnished for that purpose.

Every such application for a permit shall describe the land upon which the proposed building or work is to be done, either by lot, block and tract, or similar description that will readily identify and definitely locate the proposed building or work.

Every such application shall show the use or occupancy of all parts of the building and such other reasonable information as may be required by the Building Inspector.

Copies of plans and specifications and a lot plan showing the location of the proposed building and of every existing building on the property, shall accompany every application for a permit, and shall be filed in duplicate with the Building Inspector; provided, however, that the Building Inspector may authorize the issuance of a permit without plans or specifications for small or unimportant work.

Plans shall be drawn to scale upon substantial paper or cloth and the essential parts shall be drawn to a scale of not less than one-eighth inch ($\frac{1}{8}$ ") to one foot (1').

Plans and specifications shall be of sufficient clarity to indicate the nature and character of the work proposed and to show that the law will be complied with. Computations, strain sheets, stress diagrams and other data necessary to show the correctness of the plans, shall accompany the plans and specifications when required by the Building Inspector.

Any specifications in which general expressions are used to the effect that "work shall be done in accordance with the Building Code" or "to the satisfaction of the Building Inspector" shall be deemed imperfect and incomplete and every reference to this Code shall be to the section or subsection applicable to the material to be used or to the method of construction proposed.

All plans shall bear the name of the Architect, Structural Engineer or person responsible therefor.

Sec. 202. The application, plans and specifications filed by an applicant for a permit shall be checked by the Building Inspector. Such plans may be reviewed by the Chief of the Fire Department with respect to the storage of volatile and flammable liquids as specified in Part III, and the installation of fire-prevention and fire-extinguishing apparatus and facilities as provided in this Code. When such plans and specifications are found to be in **Building Permits**

Sections 202-204

conformity with the requirements of this Code and all other laws or ordinances applicable thereto, the Building Inspector shall issue a permit for the specified construction upon receipt of the required permit fee.

When the Building Inspector issues the permit, he shall endorse in writing or stamp on both sets of plans and specifications "APPROVED."

One such approved set of plans and specifications shall be retained by the Building Inspector as a public record, for a period of not less than 90 days from date of completion of the work covered therein, and one set of approved plans and specifications shall be returned to the applicant, which set shall be kept on such building or work at all times during which the work authorized thereby is in progress and shall be open to inspection by public officials. Such approved plans and specifications shall not be changed, modified or altered without authorization from the Building Inspector, and all work shall be done in accordance with the approved plans.

Fees

Sec. 203. Any person desiring a building permit shall, at the time of filing an application therefor, as provided in Sec. 201 of this Code, pay to the Building Inspector a fee as required in this section.

For a total valuation of \$50.00 or less no fee.

For a total valuation from \$50.00 to \$1,001 a \$2.00 fee; and an additional fee of \$2.00 for each additional \$1000 or fraction thereof of total valuation to and including \$15,000; and an additional fee of \$1.00 for each additional \$1000 or fraction thereof of total valuation to and including \$50,000; and an additional fee of 50c for each additional \$1000 or fraction thereof of total valuation exceeding \$50,000.

The city, county, state, or the United States of America shall be exempt from the paying of any fee for any building.

The Building Inspector shall determine the estimated valuation in all cases, and for such purpose he shall be guided by approved estimating practices.

Where work for which a permit is required by this Code is started or proceeded with prior to obtaining said permit, the fees above specified shall be doubled, but the payment of such double fee shall not relieve any persons from fully complying with the requirements of this Code in the execution of the work nor from any other penalties prescribed herein.

The Building Inspector shall keep a permanent, accurate account of all fees and other monies collected and received under this Code, the names of the persons upon whose account the same were paid, the date and amount thereof, together with the location of the building or premises to which they relate.

**Inspection
and
Registered
Inspectors**

Sec. 204. (a) Inspections Required. The Building Inspector shall inspect or cause to be inspected at various intervals during the erection, construction, enlarging, alteration, repairing, moving, demolition, conversion, occupancy and underpinning all buildings or structures referred to in this Code and located in the City, and a final inspection shall be made of every building or structure hereafter erected prior to the issuance of the Certificate of Occupancy as required in Section 206.

Section 204

No building construction, alteration, repair or demolition requiring a building permit shall be commenced until the permit holder or his agent shall have posted the building permit card in a conspicuous place on the front premises and in such position as to permit the Building Inspector to conveniently make the required entries thereon respecting inspection of the work. This permit card shall be maintained in such position by the permit holder until the Certificate of Occupancy has been issued by the Building Inspector.

The Building Inspector upon notification from the permit holder or his agent shall make the following inspections of Type V buildings and shall either approve that portion of the construction as completed or shall notify the permit holder or his agent wherein the same fails to comply with the law.

Foundation Inspection: To be made after trenches are excavated and the necessary forms erected and when all materials for the foundation are delivered on the job. Where concrete from a central mixing plant (commonly termed "transit mixed") is to be used, materials need not be on the job.

Frame Inspection: To be made after the roof, all framing, fire-blocking and bracing is in place and all pipes, chimneys and vents are complete.

Stucco Inspection: To be made after all lathing and backing is in place and all plastering and stucco materials are delivered on the job, but before any stucco is applied.

Final Inspection: To be made after building is completed and is ready for occupancy.

No work shall be done on any part of the building and structure beyond the point indicated in each successive inspection without first obtaining the written approval of the Building Inspector. Such written approval shall be given only after an inspection shall have been made of each successive step in the construction as indicated by each of the above four inspections.

No reinforcing steel or structural framework of any part of any building or structure shall be covered or concealed in any manner whatsoever without first obtaining the approval of the Building Inspector.

In all buildings where plaster is used for fire protection purposes the permit holder or his agent shall notify the Building Inspector after all lathing and backing is in place and all plastering materials are delivered on the job and no plaster shall be applied until the approval of the Building Inspector has been received.

(b) **Special Engineering Supervision.** Any person engaged in the erection or causing the erection of a building or structure, except Type V buildings or structures, where the estimated cost exceeds \$20,000 shall employ a "registered inspector" properly qualified as specified in this section or shall cause his employment by the architect, structural engineer or designer of such structure; provided, that the Building Inspector may authorize the proposed construction without requiring a "registered inspector" when in his estimation such special supervision is not necessary. The Building Inspector may designate any building or structure as requiring a "registered inspector" when deemed

**Special
Engineering
Supervision**

necessary or where there is a complicated design or where new materials or methods of construction are intended to be used.

The "registered inspector" shall be approved by, registered with, deputized by and assigned to a particular building or structure by the Building Inspector. Such "registered inspector" shall be thoroughly qualified by knowledge and experience in the design and construction of the structure to which he is assigned by the Building Inspector and he shall be thoroughly familiar with the requirements of this Code applying to that building or structure and with their practical application. The Building Inspector may authorize one such "registered inspector" to supervise the simultaneous construction of a limited number of buildings and structures, provided that his service shall extend over all the important details of framing, erection and assembly and that he is able to render full engineering inspection service on each building and structure under his supervision and control.

Before commencing his duties the "registered inspector" shall obtain a certificate of registration from the Building Inspector for which he shall pay the sum of \$1.00, and he shall deposit with the City a surety bond in the sum of \$5000, conditioned upon the faithful and efficient performance of his duties, said bond to be made payable to the City and to be furnished for the term of one year. The "registered inspector" shall remain constantly upon the work during the process of construction and his duties shall terminate only when a Certificate of Compliance is issued by the Building Inspector in approval and acceptance of the work on which he may be engaged as required in Section 205.

Each such "registered inspector" shall carefully inspect all materials entering into the construction of the structure and be responsible for obtaining full information regarding the strength of materials where new or untried materials are intended for any use involving structural safety. He shall report in writing, upon the special forms furnished by the Building Department, the true details regarding the progress of the work, the condition of same, deviation, defects, delays, general character of materials, working situations, weather conditions and all and any influencing factors that affect in any manner the structural safety and strength of the building. He shall be held directly responsible for the enforcement of this Code wherever same is applicable to the structure upon which he is engaged. He shall notify the Building Inspector of any attempt to cover, conceal, patch or repair any defect in materials or workmanship before such materials have been examined by the Building Inspector or his duly authorized representative. He shall be held directly responsible for the infraction of any ruling of the Building Inspector and shall have the authority to compel the removal of defective materials or to suspend or stop work pending the rulings of the Building Inspector. He shall not be engaged in any other labor on the project upon which he is employed.

Sec. 205. The duties of the "registered inspector" shall terminate only when a Certificate of Compliance has been issued by the Building Inspector. Such Certificate of Compliance shall bear a statement signed by the "registered inspector" stating that the work upon the building or structure to which he has

**Certificate
of
Compliance**

Sections 205-207

been assigned has been completed in a satisfactory manner and that the regulations of this Code affecting the structural features of such building or structure have been fully complied with. If there have been any infractions of this ordinance they shall be noted in this statement. The Building Inspector shall approve such Certificate of Compliance filed by the "registered inspector" if after inspection the structural features of such building or structure are found to be in accordance with the provisions of this Code. Each Certificate of Compliance shall bear the legal description of the property upon which such building or structure is located and an identifying description of the building. A duplicate of each Certificate of Compliance shall be kept on file permanently in the office of the Building Inspector.

Sec. 206. No building shall be occupied in any part thereof unless or until a Certificate of Occupancy has been issued by the Building Inspector. The Building Inspector shall, after an application therefor has been filed by the owner or his agent, issue a Certificate of Occupancy for such building, if after inspection it is found that such building complies with the provisions of this Code and all other requirements of law or ordinance applicable thereto. Such Certificate of Occupancy shall show the use to which the structure may be put and the maximum allowable floor loads for each floor thereof. A temporary Certificate of Occupancy may be issued by the Building Inspector for the temporary use of a portion of a building prior to the completion and occupancy of the entire building.

**Certificate
of
Occupancy**

Sec. 207. The use or occupancy of any building shall not be changed until a Certificate of Occupancy permitting the new use or occupancy is issued by the Building Inspector when the new occupancy is such as to require alterations or repairs of the building, as specified in this Code. Where such changes involve storage of volatile or flammable liquids as specified in Part III, exits as specified in Chapter 33, or fire-prevention and fire-extinguishing apparatus as specified in Chapter 38, the Chief of the Fire Department, upon request of the Building Inspector, within two days shall certify his approval in writing to the Building Inspector when such changes are found to comply with the requirements of this Code. No such Certificate of Occupancy shall be issued unless the building shall comply with the requirements of this Code. (See Section 104.)

**Change of
Occupancy**

CHAPTER 3 — ENFORCEMENT

**Powers and
Duties of
Building
Inspector**

Sec. 301. The office of Building Inspector is hereby created and the Building Inspector is hereby authorized and directed to enforce all of the provisions of this Code and for such purpose he shall have the powers of a police officer.

The Building Inspector or his authorized representative may enter any building or premises for the purpose of inspection or to prevent violation of this Code, upon presentation of the proper credentials.

Whenever any building work is being done contrary to the provisions of this Code, or is being done in an unsafe or dangerous manner, the Building Inspector may order the work stopped by notice in writing served on any persons engaged in the doing or causing such work to be done, and any such persons shall forthwith stop such work until authorized by the Building Inspector to recommence and proceed with the work.

Whenever any building or portion thereof is being used or occupied contrary to the provisions of this Code the Building Inspector shall order such use or occupancy discontinued and the building or portion thereof vacated by notice served on any person using or causing such use or occupancy to be continued and such person shall vacate such building or portion thereof within ten days after receipt of such notice, or make the building or portion thereof comply with the requirements of this Code; provided however, that in the event of an emergency the following paragraph shall apply:

Any building or portion thereof, including buildings and structures in process of erection, if found to be dangerous to persons or property, or unsafe for the purpose for which it is being used, or in danger from fire due to defects in construction, or dangerous for use because of insufficient means of egress in case of fire, or which violates the provisions of this Code due to the removal, decay, deterioration or the falling off of any thing, appliance, device or requirement originally required by this Code, or which has become damaged by the elements or fire to an extent of 50 per cent of its value, may be condemned by the Building Inspector. The Building Inspector may order portions of the structural frame of a building or structure to be exposed for inspection when in his opinion they are in an unsafe condition. In any of the aforesaid cases the Building Inspector shall serve notice in writing on the owner, reputed owner or person in charge of such building or premises, setting forth what must be done to make such building safe. The person receiving such notice shall commence within 48 hours thereafter to make the changes, repairs or alterations set out in such notice and shall proceed diligently with such work or demolish the building. No such building shall be occupied or used for any purpose after the Building Inspector serves written notice of its unsafe or dangerous condition until the instructions of the Building Inspector have been complied with.

If, at the expiration of the time as set forth in the first notice, the instructions, as stated, have not been complied with, a second notice shall be served personally upon the owner, his agent, or the person in possession, charge or control of such building or structure or part thereof, stating therein such pre-

cautionary measures as may be necessary or advisable to place such building or structure or part thereof in a safe condition. Should the necessary changes not be made within 30 days after the service of such second notice the City Council may order the owner or agent of the building prosecuted as a violator of the provision of this Code and may order the Building Inspector to proceed with the work specified in such notice. A statement of the cost of such work shall be transmitted to the City Council, who shall cause the same to be paid and levied as a lien against the property. Proper service of either of such notices shall be personal service upon the owner of record, if he shall be found within the city limits. If he is not found within the city limits such service may be had upon any person accustomed to collect rents on the property in question who may be in the city and in the absence of such a person, upon the tenant of the premises. In the event such premises are vacant, and the owner is not found in the city, such service will be completed when the notice is sent by registered mail to the last known address of the said owner. Whenever the owner, agent or tenant is a corporation, service may be made upon the president, vice-president, secretary or treasurer, or in the absence of any of these, the local representatives of such corporation.

Sec. 302. (a) Alternate Materials and Types of Construction.

The provisions of this Code are not intended to prevent the use of types of construction or materials offered as an alternate for the types of construction or materials required by this Code, but such alternate types of construction or materials to be given consideration shall be offered for approval as specified in this chapter. Corresponding materials or types of construction referred to in this Code, the use of which is the same as is intended for the new material or construction, and approved, shall be considered as standards of quality and strength if no specification is provided.

Any person desiring to use types of construction or materials not specifically mentioned in this Code shall file with the Building Inspector authentic proof in support of claims that may be made regarding the sufficiency of such types of construction and materials and request approval and permission for their use.

The Building Inspector may approve such alternate types of construction or materials and may recommend an amendment to this Code in order to make permissible the use of same. If the evidence and proof are not sufficient, in the opinion of the Building Inspector, to justify approval or recommendation for an amendment, the applicant may refer the entire matter to the Board of Examiners and Appeals as specified in Section 303.

(b) **Tests of Materials and Systems of Construction.** Where certain systems of construction, qualities of materials or tests are referred to or regulated by this code, tests may be required by the Building Inspector. Such tests shall be made at the expense of the owner or his agent by a testing laboratory or other organization approved for the purpose by the Building Inspector. Certified copies of all test reports shall be filed with the Building Inspector for his approval, before the systems of construction or materials are used. The owner or his agent shall notify the Building Inspector of the time and location of all such tests, so that he may be present.

**Alternate
Materials
and Types
of Con-
struction**

**Tests of
Materials
and
Systems of
Construction**

Sections 303-305

Appeals

Sec. 303. Any person whose application for a building permit for the use of an alternate material or type of construction has been refused by the Building Inspector or who may consider that the provisions of this Code do not cover the point raised or that any particular provision would cause a manifest injury to be done may appeal to the Board of Examiners and Appeals by serving written notice on the Building Inspector in which it shall be stated that the applicant desiring to use the alternate materials or types of construction shall guarantee payment of all expenses for necessary tests made or ordered by the Board of Examiners and Appeals. Such notice shall be at once transmitted to the Board, which Board shall arrange for a hearing on the particular point raised.

Such written notice shall be accompanied by the sum of \$10.00 payable to the City. If the appeal is denied such fee shall be retained by the City, otherwise the fee shall be returned to the appellant.

Board of Examiners and Appeals

Sec. 304. In order to determine the suitability of alternate materials and types of construction and to provide for reasonable interpretations of the provisions of this Code, there shall be and is hereby created a Board of Examiners and Appeals, consisting of five members, who are qualified by experience and training to pass upon matters pertaining to building construction. One member shall be a practicing architect, one a competent builder, one a lawyer and two structural engineers, each of whom shall have had at least 10 years' experience as an architect, builder, lawyer or structural engineer. The Building Inspector shall be an ex-officio member and shall act as Secretary to the Board. The Board of Examiners and Appeals shall be appointed by the Mayor and shall hold office at his pleasure. The Board shall adopt reasonable rules and regulations for conducting its investigations and shall render all decisions and findings in writing to the Building Inspector with a duplicate copy to the appellant and may recommend to the City Council such new legislation as is consistent therewith.

The Board of Examiners and Appeals may interpret the provisions of this Code to cover a special case, if it appears that the provisions of this Code do not definitely cover the point raised or that a manifest injustice might be done, provided that every such decision shall be by unanimous vote of the Board of Examiners and Appeals. Decisions as to the use of alternate materials and types of construction shall be by majority vote and if not permitted by this Code shall become effective only when authorized by an amendment to this Code.

Violations and Penalties

Sec. 305. It shall be unlawful for any person, firm or corporation to erect, construct, enlarge, alter, repair, move, remove, demolish, convert, equip, use or occupy or maintain any building and structure or any portion of any building and structure in the city, contrary to or in violation of any provision of this Code or to cause, permit or suffer the same to be done.

Any person, firm or corporation violating any of the provisions of this Code shall be deemed guilty of a misdemeanor and each such person shall be deemed guilty of a separate of-

Section 805

fense for each and every day or portion thereof during which any violation of any of the provisions of this Code is committed, continued or permitted, and upon the conviction of any such violation such person shall be punishable by a fine of not more than \$500, or by imprisonment in the city jail for not more than six months, or by both such fine and imprisonment.

The issuance or granting of a permit or approval of plans and specifications shall not be deemed or construed to be a permit for, or an approval of, any violation of any of the provisions of this Code. No permit presuming to give authority to violate or cancel the provisions of this Code shall be valid, except insofar as the work or use which it authorizes is lawful.

The issuance of a permit upon plans and specifications shall not prevent the Building Inspector from thereafter requiring the correction of errors in said plans and specifications or from preventing building operations being carried on thereunder when in violation of this Code or of any other ordinance of the City.

Every permit issued by the Building Inspector under the provisions of this Code shall expire by limitation and become null and void, if the building or work authorized by such permit is not commenced within 60 days from the date of such permit, or if the building or work authorized by such permit is suspended or abandoned at any time after the work is commenced for a period of 60 days. Before such work can be recommenced a new permit shall be first obtained so to do, and the fee therefor shall be one-half the amount required for a new permit, provided no changes have been made or will be made in the original plans and specifications for such work; and provided, further, that such suspension or abandonment has not exceeded one year.

**Expiration
of Permit**

PART II

DEFINITIONS

CHAPTER 4—DEFINITIONS

Definitions

Sec. 401. For the purpose of this Code, certain terms, phrases, words and their derivatives shall be construed as set out in this section. Words used in the singular include the plural and the plural the singular. Words used in the masculine gender include the feminine, and the feminine the masculine. Wherever a section, chapter or part is referred to in this Code by number it shall be understood to refer to a section, chapter or part of this Code.

A

(a) **ALLEY.** Any public space, public park or thoroughfare less than sixteen feet (16') but not less than ten feet (10') in width which has been dedicated or deeded to the public for public use.

ALTERATION. Alter or alteration means any change, addition or modification in construction or occupancy.

APARTMENT is a room or suite of rooms which is occupied or which is intended or designed to be occupied by one family for living and sleeping purposes.

APARTMENT HOUSE is any building, or portion thereof, which is designed, built, rented, leased, let or hired out to be occupied, or which is occupied as the home or residence of three or more families living independently of each other and doing their own cooking in the said building, and shall include flats and apartments.

APPROVED as to materials and types of construction, refers to approval by the Building Inspector as the result of investigation and tests conducted by him, or by reason of accepted principles or tests by national authorities, technical or scientific organizations.

AREA (see "Floor Area").

ATTIC STORY is any story situated wholly or partly in the roof, so designated, arranged or built as to be used for business, storage or habitation.

B

(b) **BALCONY** is that portion of the seating space of an assembly room, the lowest part of which is raised four feet (4') or more above the level of the main floor.

BASEMENT is that portion of a building between floor and ceiling, which is partly below and partly above grade (as defined in this Section), but so located that the vertical distance from grade to the floor below is less than the vertical distance from grade to ceiling. (See "Story".)

BAY WINDOW is a rectangular, curved or polygonal window, supported on a foundation extending beyond the main wall of the building.

BUILDING is any structure built for the support, shelter, or enclosure of persons, animals, chattels, or property of any kind.

BUILDING—EXISTING BUILDING is a building erected prior to the adoption of this Code, or one for which a legal building permit has been issued.

BUILDING INSPECTOR shall mean the Chief Building Inspector or any regularly authorized deputy.

(c) **CAST STONE** is a building stone manufactured from cement concrete precast and used as a trim, veneer or facing on or in buildings or structures. **C**

CELLAR is that portion of a building between floor and ceiling which is wholly or partly below grade (as defined in this Section) and so located that the vertical distance from grade to the floor below is equal to or greater than the vertical distance from grade to ceiling. (See "Story".)

CHIEF OF THE FIRE DEPARTMENT shall mean the head of the Fire Department or any regularly authorized deputy.

COURT is an open, unoccupied space, bounded on two or more sides by the walls of the building. An inner court is a court entirely within the exterior walls of a building. All other courts are outer courts.

(d) **DEAD LOAD** in a building includes the weight of the walls, permanent partitions, framing, floors, roofs and all other permanent, stationary construction forming a part of the building. **D**

DWELLING is any building or any portion thereof, which is not an "Apartment House" or a "Hotel" as defined in this Code, which contains one or more "Apartments" or "Guest Rooms", used, intended, or designed to be built, used, rented, leased, let or hired out to be occupied, or which are occupied for living purposes.

(e) **EXISTING BUILDING**—(See. Building—Existing). **E**

(f) **FAMILY** is one person living alone or a group of two or more persons living together, whether related to each other by birth or not. **F**

FLOOR AREA is the area included within surrounding walls of a building (or portion thereof), exclusive of vent shafts and courts.

FOOTING or **FOUNDATION** is the spreading course at the base or bottom of a foundation wall, column or pier.

Section 401

Definitions (Cont'd)

G

FRONT OF LOT means the front boundary line of a lot bordering on the street, and in the case of a corner lot may be either frontage.

(g) **GALLERY** is that portion of the seating space of an assembly room having a seating capacity of more than 10 located above a balcony.

GARAGE is a building or portion thereof in which a motor vehicle containing gasoline, distillate or other volatile, flammable liquid in its tank, is stored, repaired or kept.

GARAGE, PRIVATE, is a building, or a portion of a building, in which only motor vehicles used by the tenants of the building or buildings on the premises are stored or kept, and with space for not more than 10 automobiles. (See Section 1509.)

GARAGE, PUBLIC, is any garage other than a private garage.

GRADE (Ground Level) is the average of the finished ground level at the center of all walls of a building. In case walls are parallel to and within five feet (5') of a sidewalk, the above ground level shall be measured at the sidewalk.

GRADE (Lumber) means the division of sawn lumber into quality classes with respect to its physical and mechanical properties as defined in published lumber manufacturers' standard grading rules.

GUEST means any person hiring or occupying a room for living or sleeping purposes.

H

(h) **HEIGHT OF BUILDING** is the vertical distance from the "Grade" to the highest point of the coping of a flat roof or to the deck line of a mansard roof or to the average height of the highest gable of a pitch or hip roof.

HOTEL is any building containing six or more rooms intended or designed to be used, or which are used, rented or hired out to be occupied, or which are occupied for sleeping purposes by guests.

(i) No definitions.

(j) No definitions.

(k) No definitions.

L

(l) **LINTEL** is the beam or girder placed over an opening in a wall, which supports the wall construction above.

LIVE LOADS are all imposed, fixed or transient loads other than "Dead Loads".

M

(m) **MASONRY** is that form of construction, composed of stone, brick, concrete, gypsum, hollow clay tile, concrete block or tile, or other similar building units or materials or a combination of these materials laid up unit by unit and set in mortar. For the purpose of this Code plain monolithic concrete shall be considered as Masonry. (See Section 2405.)

Section 401

MASONRY, SOLID, means masonry built without hollow spaces. **Definitions (Con't.)**

MEZZANINE or **MEZZANINE FLOOR** is an intermediate floor placed in any story or room. When the total area of any such "Mezzanine Floor" exceeds 33 1/3 per cent of the total floor area in that room, it shall be considered as constituting an additional "Story". The clear height above or below a "Mezzanine Floor" construction shall be not less than seven feet (7').

(n) No definitions.

(o) **OCCUPANCY** is the purpose for which a building is used or intended to be used. Change of occupancy is not intended to include change of tenants or proprietors.

ORIEL WINDOW is a window which projects from the main line of an enclosing wall of a building and is carried on brackets or corbels.

(p) **PERSON** means a natural person, his heirs, executors, administrators or assigns, and also includes a firm, partnership or corporation, its or their successors or assigns, or the agent of any of the aforesaid.

(q) No definitions.

(r) **REPAIR** means the reconstruction or renewal of any part of an existing building for the purpose of its maintenance. The word "Repair" or "Repairs" shall not apply to any change of construction.

ROOM CAPACITY. (See Seating Capacity).

(s) **SEATING CAPACITY.** The seating capacity of a theater, auditorium, or any room or place of public assemblage in which seats are not fixed, shall be determined on the basis of seven square feet (7 sq. ft.) of floor, balcony and gallery area per person, and in the case of fixed seats such as pews or benches the seating capacity shall be based on one person to each eighteen inches (18") of pew or bench length.

Exceptions: 1. The capacity of dance floors or the playing areas of gymnasiums when such areas or floors are not to be used for general assembly purposes shall be determined on the basis of fifteen square feet (15 sq. ft.) of floor area per person.

2. The capacity of school class rooms, individual rooms in public libraries and museums, when two thousand square feet (2000 sq. ft.) or less in floor area, shall be determined on the basis of twenty square feet (20 sq. ft.) of floor area per person.

SHAFT means a vertical opening through a building for elevators, dumb waiter, light, ventilation or similar purposes.

SHALL as used in this Code, is mandatory.

Definitions (Cont'd)

STAGE is a raised platform in an assembly room which is cut off from the audience section by a proscenium wall where the wing space is over three feet (3') beyond the proscenium opening on one or both sides or where there is more than three feet (3') of open space above the proscenium opening.

STORY means that portion of a building included between the upper surface of any floor and the upper surface of the floor next above, except that the topmost story shall be that portion of a building included between the upper surface of the topmost floor and the ceiling or roof above. If the finished floor level directly above a basement or cellar is more than six feet (6') above grade such basement or cellar shall be considered a story.

STREET is any thoroughfare or public park not less than sixteen feet (16') in width which has been dedicated or deeded to the public for public use.

STRUCTURE is that which is built or constructed, an edifice or building of any kind, or any piece of work artificially built up or composed of parts joined together in some definite manner.

T (t) **THEATER** is a building or part thereof which contains an assembly hall, having a stage which may be equipped with curtains and permanent stage scenery or mechanical equipment adaptable to the showing of plays, operas, motion pictures, performances, spectacles and similar forms of entertainment.

(u) No definitions.

V (v) **VALUE** of a building shall be the estimated cost to replace the building in kind.

VENEER is a facing of brick, stone, concrete, tile or similar material attached to a wall for the purpose of providing ornamentation, protection or insulation but not counted as adding strength to the wall.

W (w) **WALLS** shall be defined as follows:

Bearing Wall is a wall which supports any load other than its own weight.

Curtain Wall is a non-bearing wall between columns or piers which is not supported by girders or beams.

Enclosure Wall is an exterior, non-bearing wall in skeleton construction, anchored to columns, piers or floors, but not necessarily built between columns or piers.

Faced Wall is a wall in which the masonry facing and backing are so bonded as to exert a common action under load.

Interior Wall is a wall entirely surrounded by the exterior walls of the building.

Non-Bearing Wall is a wall which supports no load other than its own weight.

Section 401

Panel Wall is a non-bearing wall in skeleton construction built between columns or piers and wholly supported at each story. **Definitions (Continued)**

Parapet Wall is that part of any wall entirely above the roof line.

Party Wall is a wall used or adapted for joint service between two buildings.

Retaining Wall is any wall used to resist the lateral displacement of any material.

WINDOW. (See Bay Window; See Oriel Window).

(x) No definitions.

(y) **YARD** is an open, unoccupied space, other than a court, unobstructed from the ground to the sky, except where specifically provided by this Code, on the lot on which a building is situated.

PART III

REQUIREMENTS BASED ON OCCUPANCY

CHAPTER 5—CLASSIFICATION OF ALL BUILDINGS BY USE OR OCCUPANCY AND GENERAL REQUIREMENTS FOR ALL OCCUPANCIES

Occupancy Classified

Sec. 501. Every building, whether existing or hereafter erected, shall be classified by the Building Inspector according to its use or the character of its occupancy, as a building of Group A, B, C, D, E, F, G, H, I or J, as defined in Chapters 6, 7, 8, 9, 10, 11, 12, 13, 14 and 15 respectively. (See Tables No. I and II of this Chapter.)

When a building is used for more than one occupancy purpose it shall be classified in the occupancy group representing the greatest occupancy hazard. Group A Occupancy shall be considered the most hazardous and Group J the least hazardous. When portions of a building are separated from the remainder of a building by one or more unplastered continuous walls extending from the foundation of the building to and through the roof and affording four-hour fire-resistive protection (see Sec. 4302), such portions shall be considered as separate buildings.

Any occupancy not mentioned specifically or about which there is any question shall be classified by the Building Inspector and included in the Group which its use most nearly resembles based on the existing or proposed life and fire hazard.

Change in Use

Sec. 502. No change shall be made in the character of occupancy or use of any building which would place the building in a different Group of occupancy, unless such building is made to comply with the requirements of this Code for that Group.

Exception: The character of the occupancy of existing buildings may be changed subject to the approval of the Building Inspector, and the building may be occupied for purposes in other Groups without conforming to all the requirements of this Code for those Groups, provided the new or proposed use is less hazardous, based on life and fire risk, than the existing use.

No change in the character of occupancy of a building shall be made without a Certificate of Occupancy, as required in Section 207 of this Code.

Buildings in existence at the time of the passage of this Code, may have their existing use or occupancy continued, if such use or occupancy was legal at the time of the passage of this Code, provided such continued use is not dangerous to life.

Mixed Occupancy.

Sec. 503. (a) General. When a building is used for more than one occupancy purpose each part of the building comprising a distinct "Occupancy Division," as described in Chapters 5 to 15, shall be separated from any other occupancy division as specified in Tables No. I and II of this Chapter.

(b) **Forms of Occupancy Separations.** Occupancy separations shall be vertical or horizontal or both or, when necessary, of such other form as may be required to afford a complete separation between the various occupancy divisions in the building.

(c) **Types of Occupancy Separation.** Occupancy separations shall be classed as "Absolute," "Special" and "Ordinary."

1. An "Absolute Occupancy Separation" shall have no openings therein and shall be of not less than four-hour fire-resistive construction as specified in Chapters 42 and 43.

2. A "Special Occupancy Separation" shall be of not less than three-hour fire-resistive construction as specified in Chapters 42 and 43. All openings in walls forming such separation shall be protected on each side thereof by self-closing one-hour fire-resistive doors as specified in Section 4304 (a) and such doors shall be kept normally closed. The total width of all openings in any "Special Occupancy Separation" wall in any one story shall not exceed 25 per cent of the length of the wall in that story and no single opening shall have an area greater than one hundred and twenty square feet (120 sq. ft.).

All openings in floors forming a "Special Occupancy Separation" shall be protected by vertical enclosures, extending above and below such openings. The walls of such vertical enclosures shall be of not less than two-hour fire-resistive construction as specified in Chapters 42 and 43 and all openings therein shall be protected on one side thereof by self-closing one-hour fire-resistive doors as specified in Section 4304 (a) and such doors shall be kept normally closed.

3. An "Ordinary Occupancy Separation" shall be of not less than one-hour fire-resistive construction specified in Chapters 42 and 43. All openings in such separations shall be protected with self-closing metal-clad doors, as specified in Section 4304 (a) and such doors shall be kept normally closed.

(d) **Fire Ratings for Occupancy Separations.** Occupancy separations shall be provided between the various groups and divisions of occupancies as specified in Tables No. I and II of this Chapter, except that in no case need the separation be more fire-resistive than the exterior walls of the building in which the separation occurs, unless such walls are less than one-hour fire-resistive construction. Where any occupancy separation is required the minimum shall be an "Ordinary Occupancy Separation."

Sec. 504. The location of all buildings and the protection of certain openings shall conform to the requirements of the occupancy group in which such building is classified in this Code according to the use or character of the occupancy; provided, that exterior walls which form an angle of 75 degrees or more with the adjacent property line may have openings therein which are protected by not less than one-hour fire-resistive construction as specified in Section 4304.

**Location
on
Property**

The specific requirements given in Sections 603, 703, 803, 903, 1003, 1103, 1203, 1303, 1403, and 1503, regulating the construction of exterior walls and the protection of openings therein with respect to adjacent property lines, shall apply to buildings erected on the same property, but with reference to an

Sections 503-504

TABLE No. I—OCCUPANCY CLASSIFICATIONS

Chapter Reference	Group	OCCUPANCY	Permanent Stage	Seating Capacity in Any One Room
		DIVISION*		
6	A	1—All theaters, etc.....	Yes	1000 or more
		2—Assembly halls.....	No	3500 or more
7	B	1—Same as Group "A", Division 1.....	Yes	800-1000
		2—Same as Group "A", Division 2.....	No	750-3500
8	C	1—Same as Group "A", Division 1.....	Yes	Less than 300
		2—Same as Group "A", Division 2.....	No	50-750
		3—Same as Group "A", Division 2.....	No	Less than 50
		4—Stadiums, reviewing stands, amusement park structures not included in the above.....		
9	D	1—Jails, prisons, reformatories, asylums, similar buildings.....		
		2—Hospitals, sanitariums, orphanages, nurseries and similar buildings (accommodating more than 6 patients).....		
10	E	1—Public garages, paint or petroleum products storage, dry cleaning.....		
		2—Planing mills, box factories, woodworking and mattress factories.....		
		3—Storage of hay and highly flammable or explosive materials.....		
11	F	1—Wholesale and retail stores, office buildings, restaurants, undertaking parlors, printing plants, municipal police and fire stations.....		
		2—Factories and workshops using materials not highly flammable or explosive.....		
		3—Storage and sales rooms for combustible goods.....		
12	G	1—Ice plants, power plants, pumping plants, cold storage, creameries.....		
		2—Factories and workshops using incombustible or non-explosive materials.....		
		3—Storage and sales rooms of incombustible or non-explosive goods.....		
13	H	1—Hotels, apartment houses, dormitories, lodging houses.....		
		2—Convents, monasteries, old peoples' homes (accommodating 10 or more).....		
14	I	1—Dwellings.....		
15	J	1—Private garages, sheds and minor buildings used as accessories only when not over one thousand square feet (1000 sq. ft.) in area.....		
		2—Fences over six feet (6') high, tanks and towers.....		

*Refer to Chapters 6 to 15, inclusive, for more complete listing of occupancies and definitions.

imaginary property line located between such buildings and parallel to the face of either building; provided that in the case of Group J-1 occupancies which are accessory to Group I occupancies on the same property the requirements for Occupancy Separations between such occupancies as set forth in Section 503 may be substituted in lieu thereof.

CHAPTER 6—REQUIREMENTS FOR GROUP A OCCUPANCIES

Group A Occupancies Defined

Sec. 601. Group A Occupancies shall be:

Division 1: Theaters, motion picture theaters, auditoriums, schools, churches, lodges, clubs, museums, dance halls, armories, libraries, gymnasiums, passenger stations, administration buildings of city, county or state and similar buildings having a permanent stage and seating capacity of 1000 or more in any one room.

Division 2: The same as Division 1 except, not having a permanent stage and having a seating capacity of 3500 or more in any one room.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Construction, Height and Area Allowable

Sec. 602. (a) **General.** Buildings or parts of buildings classed in Group A because of the use or character of the occupancy shall be of Type I Construction and shall not be limited as to location in fire zones, seating capacity, height or floor area.

Platforms which are used in lieu of stages shall be included in the floor area of the assembly room, when determining the seating capacity as defined in Section 401.

(b) **Special Construction.** Stages as defined in Section 401 shall be of Type I Construction, except as specified in Section 3905.

The slope of the main floor of the auditorium shall not exceed one in five. Ramps steeper than one in eight shall have non-slip floor surfaces.

Bleachers in a gymnasium over usable spaces shall be protected with the fire-resistive equivalent of metal lath and plaster.

Location on Property

Sec. 603. All buildings housing Group A occupancies shall front directly upon at least one public street not less than twenty feet (20') in width in which front shall be located the main entrance and exit of such building. The main floor of every Group A occupancy shall be located at or near the ground floor level.

All exterior walls or parts of walls, except on street fronts, of Group A occupancies which are less than five feet (5') from adjacent property lines shall have no openings therein. All openings in exterior walls, except on street fronts, which are less than ten feet (10') from adjacent property lines shall be protected by doors or windows of one-hour fire-resistive protection as set forth in Section 4304. See Section 504 for regulating adjacent buildings on the same property.

Exit Facilities

Sec. 604. (a) **Main Entrance and Exits.** In every Group A occupancy there shall be not less than one exit on each of three sides of the auditorium. Each of these exits shall be not less than five feet (5') in width and shall open directly upon a street or into an open exit court which shall be directly connected to a street, as specified in subsection (b) of this Section.

One such exit on a street front which shall serve as the main entrance shall be proportioned on the basis of two feet (2') of width for each 100 persons or major fraction thereof to and including 1000 persons, with an additional one foot (1') per 100 persons for each additional 100 persons or major fraction thereof to and including 2000 persons and an additional six inches (6") for each additional 100 persons or major fraction thereof, all based upon the total seating capacity of the building served by such entrance and exit.

**Exit
Facilities
(Con't.)**

At the main entrance of each Group A occupancy there shall be a foyer having an area of one square foot (1 sq. ft.) to each seat in such building having access to such foyer. The required width of the foyer at any point shall be the combined width of the aisles, passageways and stairways tributary thereto at that point but need not exceed the required width of the entrance. The foyer shall be at the same level as the back of the auditorium and all changes in elevation between the foyer and the public street adjacent thereto shall be by ramps with a slope of not more than one in 10.

The foyer if not abutting directly upon a public street shall communicate therewith by a straight and unobstructed corridor or passageway equal in width to that required for the main entrance which shall be used only as an exit or entrance; provided, however, that not to exceed 10 per cent of such required width may be used for the placing of a ticket booth.

(b) **Exit Courts.** Along each side of, and long enough to accommodate all side exits of the auditorium not fronting directly upon a street, (not including that side bounded by the stage) shall be an open court, or a passageway of Type I construction, not less than five feet (5') in width when the total seating capacity is 1000 or less, and such width shall be increased by one foot (1') for each additional 500 persons or major fraction thereof. These are required widths and shall not be reduced in any manner.

The courts shall extend full width to a street or shall be connected to the street by a passageway of the same required width, with a height of not less than seven feet (7') and such passageway shall not exceed a length of fifty feet (50'). The court or passageway shall meet the street level and all changes in elevation shall be by ramps with a slope of not more than one in eight.

All doors opening into such open courts or passageways of Type I construction shall be arranged so as not to decrease the clear width of the court when open.

(c) **Main Floor Auditorium Exits.** There shall be provided at the rear of the auditorium leading into the foyer, exits which shall be not less in width than the full width of the aisle or aisles leading thereto. Additional exits, located on each side of and not less than one-half the length of the auditorium from the foyer, shall be provided on the main floor of each Group A occupancy. These exits shall be proportioned on the basis of not less than twenty-two inches (22") of combined width to each

Section 604**Exit
Facilities
(Con't.)**

150 seats or major fraction thereof on the main floor of the auditorium, and this exit width shall be equally divided to each side of the auditorium. All such exits shall open directly upon a street or upon an exit court or upon corridors connected to an exit court. Each such corridor shall have a clear width not less than the required width of the largest door opening into the corridor, plus one-half the sum of the widths of all other doors opening into the corridor. There shall be no openings in such corridors other than the exit openings, and the exit doors shall be hung so as not to decrease the required width. Egress from the main floor of the auditorium to the street shall be by means of ramps having a slope of not more than one in eight, except as required in subsection (a) of this Section.

Where fixed seats are not provided the exits shall be proportioned on the seating capacity as defined in Section 401 and shall be evenly distributed and so arranged that the distance between adjacent exits shall not exceed one hundred feet (100') measured along the wall.

(d) **Balcony and Gallery Exits.** For balconies or galleries having a seating capacity of over 50, exits shall be provided from each side of each balcony or gallery, leading directly to a street or exit court. These exits shall have a combined width of not less than twenty-two inches (22") for every 75 seats or major fraction thereof in such balcony or gallery and such exits shall be equally divided on each side. No exit shall be less than three feet six inches (3'-6") in width. All exits shall be served by stairs or ramps completely enclosed and constructed as specified in Chapter 33. Balconies or galleries having a seating capacity of 50 or less shall be provided with not less than two means of egress at least one of which shall lead directly to a street or court. These exits shall be not less than three feet six inches (3'-6") in width. All such exits shall be located as far apart as is practicable and all combined exits shall continue the full combined width to the street. No stair exit shall be continued to or communicate with a basement.

Exits leading to the foyer shall have a combined width of not less than twenty-two inches (22") for each 150 seats or major fraction thereof in such balcony or gallery. No such exit shall be less than three feet six inches (3'-6") in width.

Where fixed seats are not provided the exits shall be proportioned on the seating capacity as defined in Section 401.

Hand rails shall be provided for stairs as specified in Section 3305.

Stairs emptying into exit courts shall meet the court floor at not less than the stair width from the near side of any main floor exit opening into such exit court.

(e) **Stage Exits.** For size and location of stage exits see Section 3907.

(f) **Aisles.** Aisles on the main floor shall be located so that there are not more than six seats between any seat and an aisle. Every aisle shall be not less than three feet (3') wide if having seats on only one side and not less than three feet six inches (3'-6") wide if having seats on both sides. Such minimum

Section 604

width shall be measured at the end farthest from the foyer and shall be increased by one and one-half inches (1½") for each five feet (5') in length toward the foyer. There shall be no steps or obstructions of any kind in any aisles, and aisles may have a slope of not more than one in five. Ramps steeper than one in eight shall have non-slip floor surfaces.

Exit Facilities (Con't.)

Aisles in balconies or galleries shall be located so that there are not more than six seats between any seat and an aisle.

Aisles in balconies and galleries shall have the same minimum width as for aisles on the first floor and shall have the same ratio of increase in width with the exception that the increase shall be in the direction of exit travel. There shall be provided in all balconies or galleries having more than 20 rows of seats a cross aisle not less than four feet (4') wide from the back of one chair to the edge of the seat when down in the next row. Such cross aisle shall lead directly to an entrance or to an emergency exit.

Risers shall be not more than seven and one-half inches (7½") and shall be the full width of the aisle and no tread shall be less than ten inches (10"). When the slope of the aisle is not more than one in five it shall be ramped. All aisles shall lead directly to exits.

The floor between rows of seats shall be on the same level as the aisles where they intersect.

(g) **Seats.** Seats shall be spaced not less than thirty-three inches (33") back to back.

All seats in occupancies of Division 1 of Group A on the main floor and in balconies and galleries shall be fastened securely to the floor and shall be not less than eighteen inches (18") in minimum width.

(h) **Boxes.** Boxes may be served by stairs not less than three feet (3') in width with a rise and tread as required for main stair exits. Boxes accommodating more than 25 persons shall be considered as balconies. Seats in boxes need not be fastened to the floor.

(i) **Doors and Gates.** All exit and entrance doors or gates shall swing in the direction of exit travel and if provided with latches such latches shall be of self-releasing type, such as panic bolts or similar devices, which will permit the door to open when pressed against. All doors shall be installed so as not to decrease the required width of any opening, passageway or corridor in any manner whatsoever. No single door shall be more than three feet six inches (3'-6") in width and every exit door on the exterior of such building shall be not less than one-hour fire-resistive construction as specified in Section 4304 except at the main entrance and exit. Doors opening from within the building into a stair or ramp enclosure may be metal-clad doors as specified in Section 4304.

(j) **Exit Lights.** All exits shall be marked with illuminated signs bearing the word "EXIT" in letters at least five inches (5") high. Each sign shall be provided with two separate electric light globes on separate circuits, one such circuit being separate from any other circuit in the building. All exit signs shall be illuminated at all times when the building is occupied.

Sections 604-607

(k) **Smokeproof Tower.** Where there is more than one balcony or gallery all balconies or galleries above the first shall be served by not less than one smokeproof tower located on each side of such balcony or gallery and constructed as specified in Chapter 33.

(l) **General.** No obstructions shall be placed in any aisle, exit, foyer, passageway or corridor.

No bars shall be placed upon any window or any other opening in any Group A occupancy except on the windows of a private office.

All doors shall have a clear height of not less than six feet eight inches (6'-8").

Light and Ventilation

Sec. 605. All portions of Group A occupancies customarily used by human beings and all dressing rooms shall be provided with light and ventilation by means of windows and skylights with an area not less than one-eighth of the total floor area, or shall be provided with artificial light and a mechanically operated ventilating system. The mechanically operated ventilating system shall supply at least thirty cubic feet (30 cu. ft.) of pure air per minute per seat in all portions of the building and such system shall be kept continuously in operation during such time as the building is occupied. If the velocity of the air at the register exceeds ten feet (10') per second the register shall be placed more than eight feet (8') above the floor directly beneath.

Lights in all parts of the building customarily used by human beings shall be on a separate circuit from that of the stage and shall be controlled from the box office. All lights in corridors, exit courts and exit passageways shall be protected by a wire cage.

All registers or vents supplying air backstage shall be equipped with automatic closing devices with fusible links. Such closing devices shall be located where the vents or ducts pass through the proscenium wall and shall be operated by fusible links located on both sides of the proscenium wall and both inside of and outside of the vent or duct.

Enclosure of Vertical Openings

Sec. 606. Main stair or ramp exits from the first or lower balcony or gallery need not be enclosed but all other stair exits shall be enclosed as specified in Chapter 30. There shall be no openings into stair or ramp enclosures except necessary entrance and exit doors. All emergency stair or ramp enclosures shall lead directly to a public street or alley or exit court.

All elevator shafts, vent shafts and other vertical openings shall be enclosed as specified under Types of Construction.

Fire Extinguishing Apparatus

Sec. 607. Group A occupancies shall be equipped with automatic sprinklers as required in Chapter 38.

Wet and dry standpipes shall be provided as required in Chapter 38.

Stages shall be equipped with automatic ventilators as required in Section 3901.

Sections 608-610

Sec. 608. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.

**Special
Hazards**

Motion picture machine booths shall conform to the requirements of Chapter 40.

No flammable liquids shall be placed or stored in a Group A occupancy.

Every gas service to the stage portion of the building shall be separated from any other service to the building and each gas service shall be provided with an approved shut-off valve at a convenient and conspicuous place outside the building and adequately marked.

Exterior openings in a boiler room or room containing central heating equipment, if located below openings in another story or if less than ten feet (10') from other doors or windows of the same building, shall be provided with one-hour fire-resistive protection as set forth in Section 4304.

Every boiler room or room containing a heating plant which burns liquid or solid fuel shall be separated from the rest of the building with a "Special Occupancy Separation" as defined in Sec. 503.

Every boiler room or room containing a heating plant which burns gas as fuel shall be separated from the rest of the building with not less than an "Ordinary Occupancy Separation" as defined in Section 503.

Sec. 609. Gymnasiums and similar occupancies may have running tracks constructed of wood or unprotected steel or iron.

**Exceptions
and
Deviations**

Sec. 610. Separation of Group A occupancies from all other occupancies shall be provided as specified in Section 503.

**Mixed
Occupancies**

CHAPTER 7—REQUIREMENTS FOR GROUP B OCCUPANCIES

Group B Occupancies Defined

See. 701. Group B occupancies shall be:

Division 1: Theaters, motion picture theaters, auditoriums, schools, churches, lodges, clubs, museums, dance halls, armories, libraries, gymnasiums, passenger stations, administration buildings of city, county or state and similar buildings having a permanent stage and a seating capacity of 300 or more but less than 1000 in any one room.

Division 2: The same as Division 1, except, not having a permanent stage and having a seating capacity of 750 or more but less than 3500 in any one room.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Construction Height and Area Allowable

Sec. 702. (a) General. Buildings classed in Group B, because of the use or character of the occupancy shall be of Type I, II or III construction only and shall not exceed the maximum limits set forth in Table No. I of this Chapter.

Platforms which are used in lieu of stages shall be included in the floor area of the assembly room when determining the seating capacity, as defined in Section 401.

(b) **Special Provisions.** Stages as defined in Section 401 and platforms shall be constructed as specified in Chapter 39.

All partitions and floors in Group B occupancies and all bearing partitions and floors below a Group B occupancy when such occupancy is placed or is to be placed above the first floor of a building or structure shall be of not less than one-hour fire-resistive construction as specified in Chapter 43.

Bleachers in a gymnasium over usable spaces shall be protected with the fire-resistive equivalent of metal lath and plaster.

For attic space partitions and draft stops see Section 3205.

**TABLE No. I—TYPES OF CONSTRUCTION, SEATING
CAPACITIES AND FLOOR AREAS PERMITTED
FOR GROUP B OCCUPANCIES**

Type of Construction Permissible	Maximum Total Seating Capacity in Any One Room	Floor Area Permissible (Sq. Ft.)
Type I	3500	No limit
Type II	1000*	25,000
Type III	750*	15,000

* Seating capacity may be increased, except for Division 1 Group B occupancies, not to exceed 50 per cent when no balconies or galleries are constructed as a part of such building and when the auditorium floor is located at or near ground floor level, in which case all exits shall be at street level or shall meet street level by means of ramps.

Sections 703-708

Sec. 703. All buildings housing Group B occupancies shall front directly upon at least one public street not less than twenty feet (20') in width, in which front shall be located the main entrance and exit of such building, or such building may be connected to the street by an entrance passageway as specified in Section 604 (a). The main floor of each Group B occupancy shall be located at or near the ground floor level, provided that occupancies in Division 2 of Group B having a total seating capacity of not more than 1500, may be located above the ground floor or in the first basement, and stairs may be used as a means of ingress and egress.

**Location
on
Property**

All exterior walls or parts of walls, except on street fronts, of Group B occupancies which are less than five feet (5') from adjacent property lines shall have no openings therein. All openings in exterior walls, except on street fronts, which are less than ten feet (10') from adjacent property lines shall be protected by doors or windows of one-hour fire-resistive construction as specified in Section 4304. See Section 504 for regulating adjacent buildings on the same property.

Sec. 704. Requirements in this Section for Group B occupancy shall be the same as for Group A occupancies as specified in Section 604 with the following exceptions:

**Exit
Facilities**

1. A foyer shall not be required.
2. No balcony or gallery shall be allowed except in buildings of Type I construction.

Exception: This shall not apply to balconies in a school gymnasium, provided that there is no stage in the gymnasium; that the seating capacity of each such balcony does not exceed 300 persons, and that there are not more than two such balconies in any gymnasium.

Sec. 705. All portions of Group B occupancies customarily used by human beings and all dressing rooms shall be provided with light and ventilation, either natural or artificial, as specified in Section 605.

**Light and
Ventilation**

Sec. 706. All vertical openings such as elevator shafts, stairs, ramps and vent shafts shall be enclosed as specified in Chapter 30, provided, however, that stair or ramp exits serving only a Group B occupancy on the second floor of a building need not be enclosed. There shall be no openings into stair or ramp enclosures except necessary entrance and exit doors.

**Enclosure
of Vertical
Openings**

Sec. 707. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38.

**Fire-Extinguishing
Apparatus
Special
Hazards**

Sec. 708. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.

Motion picture machine booths shall conform to the requirements of Chapter 40.

No flammable liquids shall be placed or stored in a Group B occupancy.

Every gas service to a Group B occupancy shall be provided with an approved outside shut-off valve conspicuously marked.

Exterior openings in a boiler room or room containing central heating equipment, if located below openings in another

story or if less than ten feet (10') from other doors or windows of the same building, shall be provided with one-hour fire-resistive protection as specified in Section 4304.

Every boiler room or room containing a heating plant which burns liquid or solid fuel shall be separated from the rest of the building with a "Special Occupancy Separation" as defined in Section 503. Every boiler room or room containing a heating plant which burns gas as fuel shall be separated from the rest of the building with not less than an "Ordinary Occupancy Separation" as defined in Section 503.

**Exceptions
and
Deviations**

Sec. 709. Gymnasiums and similar occupancies may have running tracks constructed of wood or unprotected steel or iron.

**Mixed
Occupancies**

Sec. 710. Separation of Group B occupancies from any other occupancies shall be provided as specified in Section 503.

CHAPTER 8—REQUIREMENTS FOR GROUP C OCCUPANCIES

Sec. 801. Group C occupancies shall be:

**Group C
Occupancies
Defined**

Division 1: Theaters, motion picture theaters, auditoriums, schools more than one story in height, churches, lodges, clubs, museums, dance halls, armories, libraries, gymnasiums, passenger stations, administration buildings of city, county or state and similar buildings having a permanent stage and having a seating capacity of less than 300, and one-story schools having a seating capacity of not more than 500 in any one room.

Division 2: The same as Division 1, except, not having a permanent stage but having a seating capacity of 50 or more, but less than 750.

Division 3: The same as Division 1, except, not having a permanent stage but having a seating capacity of less than 50.

Division 4: Stadiums, reviewing stands and amusement park structures not included within Groups A and B, and Divisions 1, 2 and 3 of Group C.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Sec. 802. (a) **General.** Buildings classed in Group C, because of the use or character of the occupancy, shall be one of the "Types of Construction," and shall not exceed the maximum limits set forth in Table No. I of this chapter.

**Construction
Height and
Area
Allowable**

**TABLE No. I—TYPES OF CONSTRUCTION, NUMBER OF
STORIES AND FLOOR AREAS PERMITTED
FOR GROUP C OCCUPANCIES**

Types of Construction	Number of Stories	Maximum Floor Areas (Sq. Ft.)		
		When Building Fronts on		
		1 street	2 streets	3 or more streets
Type I		NO RESTRICTIONS		
Type II	6 or 7 stories	12,000	15,000	18,000
	2 to 5 stories	15,000	18,000	20,000
	1 story	20,000	25,000	30,000
Type III	2 to 5 stories	12,000	15,000	18,000
	1 story	18,000	22,000	26,000
Type IV*	2 stories	10,000	12,500	15,000
	1 story***	10,000	12,500	15,000
Type V	2 stories**	6,000**	7,000**	8,000**
	1 story	8,500	9,500	10,500

* See Section 802, Sub-section (c).

** See Section 802, Sub-section (d).

***Areas may be increased 50 per cent when exterior walls and bearing partitions are of one-hour fire-resistive construction and floor construction over usable space is protected with a ceiling of metal lath and three-fourths inch (¾") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Section 802

Construction Height and Area Allowable (Cont'd)

Exceptions: 1. When the entire building is protected by an automatic sprinkler system as provided in Chapter 38, the permissible areas shown may be increased 100 per cent.

2. When a building of Type IV or V construction is provided with certain fire-resistive protection, as specified in Sub-Sections (c) and (d) of this Section, the permissible floor areas shown in the table may be increased as indicated.

3. Division 4 structures of open skeleton frame type shall not be limited in height or area.

Division 1 and 2 occupancies shall not be located above the first story, except in buildings protected throughout with not less than one-hour fire-resistive construction.

Stairs and corridors in Group C occupancies shall be of not less than one-hour fire-resistive construction.

A side or rear yard which is forty feet (40') or more in width to the adjacent property line or to another building, and which affords unobstructed access to a street, may be considered a street for the purpose of determining the allowable area of a school building.

Platforms which are used in lieu of stages shall be included in the floor area of the assembly room when determining the seating capacity as defined in Section 401.

(b) **Special Provisions.** All public and private school buildings more than two stories in height shall be of Type I construction.

Bleachers in a gymnasium over usable spaces shall be protected with the fire-resistive equivalent of metal lath and plaster.

Stages as defined in Section 401 and platforms shall be constructed as provided in Chapter 39.

For attic space partitions and draft stops, see Section 3205.

(c) **Special Type IV Construction—Increase in Area Allowed.** The allowable floor area for one- or two-story Type IV buildings may be increased 50 per cent provided that exterior and court walls are of not less than two-hour fire-resistive construction and the structural frame is protected by not less than one hour fire-resistive construction and that all ducts, pipe sleeves and vents shall be fire-protected between ceiling and floor or roof where they cut through the ceiling space.

(d) **Special Type V Construction—Increase in Area Allowed.** The allowable floor area for one-story Type V buildings may be increased 50 per cent provided one-hour fire-resistive construction is used throughout. The allowable floor area for two-story Type V buildings may be increased 50 per cent, provided the construction up to and including the first floor is of Type I construction and the rest of the building of one-hour fire-resistive construction throughout.

(e) **Division 4 Construction.** Erection and structural maintenance of structures housing Group C Division 4 occupancies shall conform to the requirements of this Code and where there are not such specific requirements, shall provide adequate safety for the loads to which they may be subjected. (See Appendix.)

Sections 802-804

Structures housing Group C Division 4 occupancies, other than those of open frame construction, when more than one story in height or two hundred square feet (200 sq. ft.) in area, shall have exterior walls, bearing partitions and floors of not less than one-hour fire-resistive construction as set forth in Chapter 43.

When the space under a Division 4 occupancy is used for any purpose, it shall be separated from all parts of such Division 4 occupancy including exits, by walls, floors and ceilings of not less than one-hour fire-resistive construction as set forth in Chapter 43.

The Building Inspector may cause all Division 4 structures to be reinspected at least once every six months.

Sec. 803. All Group C occupancies shall front directly upon at least one public street not less than twenty feet (20') in width, in which front shall be located the main entrance and exit of such building, or such building may be connected to such street by an entrance passageway as specified in Section 604(a).

All exterior walls or parts of walls except on street fronts of Divisions 1, 2 and 3 of Group C occupancies which are less than three feet (3') from adjacent property lines shall have no openings therein, shall be of not less than four-hour fire-resistive construction as specified in Chapter 43, and shall be constructed as set forth in Parts V, VI and VII of this Code. Walls which are three feet (3') or more, but less than ten feet (10') from adjacent property lines, except street fronts, shall be of not less than two-hour fire-resistive construction as specified in Chapter 43. All openings in exterior walls except on street fronts which are less than ten feet (10') from adjacent property lines, shall be provided with doors and windows of one-hour fire-resistive construction as specified in Section 4304.

When any portion of a Division 4 occupancy is less than ten feet (10') from adjacent property lines, such portion shall have exterior walls including openings of not less than one-hour fire-resistive construction as set forth in Chapter 43. See Section 504 for regulating adjacent buildings on the same property.

Sec. 804. Requirements in this section for Group C occupancies shall be the same as for Group A occupancies as specified in Section 604 with the following exceptions:

1. A foyer shall not be required.
2. Seats shall not be required to be fixed.
3. Divisions 2 and 3 when located above the first floor may be served by stairs in place of ramps.
4. No balcony or gallery shall be allowed unless the balcony or gallery and all exits therefrom are of incombustible construction.

Exception: This shall not apply to balconies in a school gymnasium, provided that there is no stage in the gymnasium, that the seating capacity of each balcony does not exceed 300 persons and that there are not more than two such balconies in any gymnasium.

Section 804

Exceptions and Deviations (Cont'd.)

5. In Division 3 all required exits may be located on one side of the room provided that in no case shall any part of a room be more than thirty-five feet (35') from an exit.

6. Except as required in Section 803, the provisions requiring fire-protected doors specified in Section 604 (i) shall not apply.

7. For classroom portions of school buildings, and similar small assembly rooms, the aggregate width of exit stairs in any story shall be on the basis of whole units of twenty-two inches (22") each. The required number of units shall be determined by dividing the greatest number of people on any one floor above the stairs in question by 100 and no stairs shall be decreased in width toward the building exit. Each floor shall have not less than two exit stairs. Each classroom, the floor of which is more than four feet (4') above the finished grade, shall have an exit door not more than one hundred feet (100') (measured along the line of travel) from the nearest building exit or exit stairway. For other requirements see Chapter 33.

The clear width of hallways in school buildings shall be measured in whole twenty-two inch (22") units and shall have a width of one more than the number of units obtained by dividing the total number of people in all rooms opening into such hallway by 100, provided that such hallway shall have a minimum clear width of four feet six inches (4' 6") and the required clear width shall not be diminished by any furniture, fixtures or locker or room doors when such doors are fully open. There shall be no dead end in exit hallways more than ten feet (10') beyond the stairway or exit. Where an auditorium exits into a hallway that serves as an egress from other rooms of a school, the hallway between the auditorium and the exit to the exterior need only provide for the occupants of either the auditorium or the classrooms, whichever requires the greater width. The minimum width of exit doors at either end of a hallway to a yard or passage shall be eighteen inches (18") less than the required width of the hallway.

Single classrooms and other similar small assembly rooms accommodating 40 or more pupils or persons shall have not less than two exit doors each three feet (3') wide and there shall be not less than two means of exit available from each door.

8. Any room in a school basement used by students shall have at least one exit leading directly to the outside of the building and this exit shall be not less in width than one-half the total required width of all room exists for that room.

9. Exit lights need not be installed over classroom exits.

10. All stairs and ramps serving as entrances or exits for any Group C occupancy shall be not less in width than the width required for the doors serving such stairs and shall be designed and constructed as specified in Chapter 33; provided, that when such Group C occupancy is located on the second floor of a two-story building, stairs or ramps, when leading to and serving such occupancy only, need not be enclosed when leading directly to the outer air or are connected thereto by direct passages with unpierced walls and ceilings.

Sections 804-808

All emergency stairs and ramps shall lead directly to a public street or alley or to a court or space not less than five feet (5') in clear width connected directly to a street or alley.

11. Stairs, exits, aisles and seating for stadiums and reviewing stands shall be as follows:

I. Stairs. All stairs shall have a rise of not more than seven and one-half inches (7½") and a tread of not less than ten inches (10") not including the nosing.

II. Exits. There shall be provided one exit not less than seven feet (7') wide for each 2000 persons or major fraction thereof which the stadium or reviewing stand is designed to seat. Such exits shall be spaced not more than seventy-five feet (75') apart. Passageways serving such exits shall be not less than seven feet (7') in clear height nor less than seven feet (7') in clear width.

III. Aisles. Aisles not less than three feet six inches (3'6") in width shall be provided so that there are not more than 20 seats between any seat and an aisle.

IV. Seats. Where seats are not spaced or marked off in any stadium or reviewing stand, a distance of eighteen inches (18") along any bench or platform shall constitute one seat in computing the required aisles, stairs and exits. Seats shall be spaced not less than twenty-six inches (26") back to back except that where backs are provided they shall be spaced not less than thirty inches (30") apart.

12. Stairs and exits for Division 4 amusement structures shall be provided according to the principles used in Chapter 33, subject to the approval of the Building Inspector. Stairs and ramps in such structures not exceeding two stories in height need not be enclosed. Exit lights shall be installed as specified in Section 3312, where required by the Building Inspector.

Sec. 805. All portions of Group C occupancies customarily used by human beings shall be provided with light and ventilation, either natural or artificial, as specified in Section 605.

**Light and
Ventilation**

Sec. 806. All vertical openings such as elevator shafts, stair wells and vent shafts which permit the passage of fire or smoke through more than one floor shall be enclosed as specified in Chapter 30.

**Enclosure
of
Vertical
Openings**

Sec. 807. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38.

**Fire Extinguishing
Apparatus**

Sec. 808. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.

**Special
Hazards**

Motion picture machine booths shall conform to the requirements of Chapter 40.

Where the basement and first floor of a Type V building is required to be of Type I construction the first floor shall be unpierced for human access. No usable underfloor space or basement shall be allowed in a two-story Type V building unless such space or basement is surrounded by four-hour fire-resistive construction.

Sections 808-810

Exterior openings in a boiler room or room containing central heating equipment, if located below openings in another story or if less than ten feet (10') from other doors or windows of the same building, shall be provided with one-hour fire-resistive protection as specified in Section 4304.

Every boiler room or room containing a heating plant which burns liquid or solid fuel shall be separated from the rest of the building with a "Special Occupancy Separation" as defined in Section 503. Every boiler room or room containing a heating plant which burns gas as fuel shall be separated from the rest of the building with not less than an "Ordinary Occupancy Separation" as defined in Section 503.

No flammable liquids shall be placed, used or stored in any Group C occupancy except in small quantities as necessary in laboratories, and such liquids shall be kept in tight or sealed containers when not in actual use.

Any gas service to a Group C occupancy shall be provided with an approved outside shut-off valve conspicuously marked.

Exceptions and Deviations

Sec. 809. Gymnasiums and similar buildings may have running tracks constructed of wood or unprotected steel or iron.

All walls, partitions and floors of Group C occupancies when more than one story in height and all walls, bearing partitions and floors below a Group C occupancy when such occupancy is placed or is to be placed above the first floor of a building or structure shall be of not less than one-hour fire-resistive construction as specified in Chapter 43.

Roof trusses, roof girders and beams twenty-five feet (25') or more above the nearest floor or balcony need not be fire-protected.

Rooms in school buildings having a seating capacity of more than 300 shall not be located above the first story above grade except in buildings of Type I construction.

No school classroom used for kindergarten, first or second grade pupils shall be located above the first story above grade except in buildings of Type I construction.

An arcade connecting buildings and used exclusively as a passageway, need not be considered as an adjacent building for the provisions of this Chapter, provided the walls of the buildings adjoining the arcade are finished with the same construction as required for the exterior walls of the building and with no communicating openings between the arcade and the building, except a door, and provided the arcade is of not less than one-hour fire-resistive construction or entirely of incombustible materials.

Mixed Occupancies

Sec. 810. Separation of Group C occupancies from any other occupancies shall be provided as specified in Section 503.

CHAPTER 9—REQUIREMENTS FOR GROUP D OCCUPANCIES

Sec. 901. Group D occupancies shall be:

Division 1: Jails, prisons, reformatories, houses of correction, asylums for the insane or feeble-minded, and similar buildings where personal liberties of inmates are restrained.

Division 2: Hospitals, sanitariums, orphanages, nurseries and similar buildings (accommodating more than six).

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

**Group D
Occupancies
Defined**

Sec. 902. (a) **General.** Buildings classed in Group D because of the use or character of the occupancies shall be one of the "Types of Construction," and shall not exceed the maximum limits set forth in Table No. I of this chapter.

**Construction
Height and
Area Allowed**

Exceptions: When the entire building is protected by an automatic sprinkler system as provided in Chapter 38, the permissible areas shown may be increased 100 per cent.

(b) **Special Provisions.** All Division 1 occupancies of Group D shall be Type I Construction throughout; and all Division 2 occupancies more than one story in height shall be of not less than one-hour fire-resistive construction throughout. Exterior and bearing walls of all Type IV and Type V buildings shall be of not less than one-hour fire-resistive construction and the floors thereof over usable spaces shall be protected with a ceiling of metal lath and three-fourths inch ($\frac{3}{4}$ ") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

For attic space partitions and draft stops, see Section 3205.

Sec. 903. All exterior walls or parts of walls except on street fronts, of Group D occupancies, which are less than five feet (5') from adjacent property lines shall have no openings therein,

**Location
on
Property**

**TABLE No. I—TYPES OF CONSTRUCTION, NUMBER OF
STORIES AND FLOOR AREAS PERMITTED
FOR GROUP D OCCUPANCIES**

Types of Construc- tion	Number of Stories	Maximum Floor Areas (Sq. Ft.)		
		When Building Fronts on		
		1 street	2 streets	3 or more streets
Type I	NO RESTRICTIONS			
Type II	2 to 5 stories	15,000	18,000	20,000
	1 story	20,000	25,000	30,000
Type III	2 to 3 stories	10,000	12,500	15,000
	1 story	15,000	20,000	25,000
Type IV	1 story	8,000	10,000	12,000
Type V	1 story	5,000	6,000	7,000

Sections 903-908

shall be of not less than four-hour fire-resistive construction as specified in Chapter 43 and shall be constructed as set forth in Parts V, VI and VII of this code. All openings in exterior walls except on street fronts, which are less than ten feet (10') from adjacent property lines, shall be provided with doors or windows of one-hour fire-resistive construction as specified in Section 4304. See Section 504 for regulating adjacent buildings on the same property.

Exit Facilities

Sec. 904. Not less than two exits shall be provided from each floor in every Group D occupancy regardless of the height or area of the building, and additional exits shall be provided as required in Chapter 33.

In hospitals or sanitariums, ramps with a slope of not more than one in six shall be installed instead of stairways or in addition thereto to serve all portions of the building where bed-ridden patients are or may be placed. These ramps shall land at the first or ground floor level at points giving the most direct access practicable to the outer air. The width of all ramps and corridors shall be not less than five feet (5') clear of all obstructions, except hand rails.

Except in places of detention, exit doors shall not be fastened against exit by any device except self-releasing latches, panic bolts or similar devices which can be opened readily from the inside at all times without the use of keys or any special knowledge or effort.

Smokeproof towers shall be provided as and when required in Chapter 33.

Light and Ventilation

Sec. 905. All portions of Group D occupancies customarily used by human beings shall be provided with light and ventilation by means of windows or skylights with an area equal to one-eighth of the total floor area, or shall be provided with artificial light and a mechanically operated ventilating system. The mechanically driven ventilating system shall supply at least thirty cubic feet (30 cu. ft.) of pure air per minute for each occupant thereof in all portions of the building and such system shall be kept continuously in operation while the building is occupied.

Enclosure of Vertical Openings

Sec. 906. All elevator shafts, vent shafts and other vertical openings shall be enclosed as specified under Types of Construction.

Fire Extinguishing Apparatus

Sec. 907. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38.

Special Hazards

Sec. 908. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.

Motion picture machine booths shall conform to the requirements of Chapter 40.

Sections 908-910

No storage of volatile flammable liquids shall be allowed in Group D occupancies and the handling of such liquid shall not be permitted in any Group D occupancies in quantities of more than one gallon unless such handling complies with the suggested Fire Prevention Ordinance, Edition of 1938,¹ recommended by the National Board of Fire Underwriters.

Any gas service to a Group D occupancy shall be provided with an approved outside shut-off valve conspicuously marked.

Every boiler room or room containing a heating plant which burns liquid or solid fuel shall be separated from the rest of the building with a "Special Occupancy Separation" as defined in Section 503. Every boiler room or room containing a heating plant which burns gas as fuel shall be separated from the rest of the building by not less than an "Ordinary Occupancy Separation" as defined in Section 503.

Sec. 909. No requirements of this Chapter shall be so construed as to prohibit the construction of cell blocks in jails or prevent the use of any locks or safety devices in buildings where it is necessary to forcibly restrain the inmates.

Sec. 910. Separation of Group D occupancies from any other occupancies shall be provided as specified in Section 503.

**Exceptions
and
Deviations**

**Mixed
Occupancies**

¹See Specification Documents for provisions for handling flammable liquids.

Sections 1001-1003

CHAPTER 10—REQUIREMENTS FOR GROUP E OCCUPANCIES

Occupancies Defined

Sec. 1001. Group E occupancies shall be:

Division 1: Public garages, paint or petroleum storage, dry cleaning plants, gasoline service stations, paint shops and spray painting rooms and shops.

Division 2: Planing mills, box factories, woodworking and mattress factories.

Division 3: Storage of hazardous and highly flammable or explosive materials and liquids.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Note:—Flammable liquids shall be deemed to be those with a flash point below 190 degrees Fahrenheit as determined by the closed cup tester.

Construction, Height and Area Allowable

Sec. 1002. Buildings classed in Group E because of the use or character of the occupancy shall be one of the "Types of Construction," and shall not exceed the maximum limits set forth in Table No. I of this chapter.

Exception: When the entire building is protected by an automatic sprinkler system as provided in Chapter 38, the permissible areas shown may be increased 100 per cent. For attic space partitions and draft stops see Section 3205.

Location on Property

Sec. 1003. All exterior walls or parts of walls except on street fronts, of Group E occupancies, which are less than five feet (5') from adjacent property lines shall have no openings therein,

**TABLE No. I—TYPES OF CONSTRUCTION, NUMBER OF
STORIES AND FLOOR AREAS PERMITTED
FOR GROUP E OCCUPANCIES**

Types of Construction	Number of Stories	Maximum Floor Areas (Sq. Ft.)		
		When Building Fronts on		
		1 street	2 streets	3 or more streets
Type I	NO RESTRICTIONS			
	6 or 7 stories	8,000	10,000	12,000
Type II	2 to 5 stories	10,000	12,000	15,000
	1 story	18,000	22,000	26,000
Type III	2 to 5 stories	8,000	10,000	12,000
	1 story	12,000	15,000	18,000
Type IV	1 story*	8,000	10,000	12,000
Type V	1 story	8,000	9,000	10,000

*Areas may be increased 50 per cent when exterior walls and bearing partitions are of one-hour fire-resistive construction and floor construction over usable space is protected with a ceiling of metal lath and three-fourths inch (¾") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Sections 1003-1006

shall be of not less than four-hour fire-resistive construction as specified in Chapter 43 and shall be constructed as set forth in Parts V, VI and VII of this Code. All openings in exterior walls except on street fronts, which are less than ten feet (10') from adjacent property lines, shall be provided with doors or windows of one-hour fire-resistive construction as specified in Section 4304. See Section 504 for regulating adjacent buildings on the same property.

**Location
on
Property
(Cont'd.)**

Sec. 1004. All Group E occupancies shall have not less than two means of egress from each story including basements or cellars unless such basements or cellars are used for heating apparatus only, in which case only one exit shall be required.

**Exit
Facilities**

Stairs and exits shall be provided as and when required in Chapter 33.

Smokeproof towers shall be provided as and when required in Chapter 33.

Where ramps are used for the transfer of automobiles from one floor to another such ramps shall meet the ground floor level at a point not less than twenty feet (20') from the exit from such building.

Sec. 1005. All portions of Group E occupancies customarily used by human beings shall be provided with light and ventilation by means of windows or skylights with an area equal to one-eighth of the total floor area or shall be provided with artificial light and a mechanically operated ventilating system. The mechanically driven ventilating system shall supply at least thirty cubic feet (30 cu. ft.) of pure air per minute for each occupant thereof in all portions of the building and such system shall be kept continuously in operation while the building is occupied.

**Light, Ventilation and
Sanitation**

In all buildings used for the storing or handling of automobiles operated under their own power and in all buildings where flammable liquids are used exhaust ventilation shall be provided sufficient to produce one complete change of air every 15 minutes. Such exhaust ventilation shall be taken from a point at or near the floor level.

All buildings where more than four persons are employed shall be provided with at least one toilet. All buildings and each subdivision thereof where both sexes are employed shall be provided with access to at least two toilets, located either in such building or conveniently in a building adjacent thereto.

Sec. 1006. All elevator shafts, vent shafts and other vertical openings shall be enclosed as specified under "Types of Construction."

**Enclosure
of
Vertical
Openings**

Doors which are part of an automobile ramp enclosure may be kept normally open but shall be equipped with fusible links and so arranged as to be self-closing when released.

Sections 1007-1009

Fire Extinguishing Apparatus

Sec. 1007. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38.

Special Hazards

Sec. 1008. Chimneys and heating apparatus shall conform to the requirements of Chapter 37. In any room in which volatile flammable liquids are used or stored no device generating a glow or flame capable of igniting gasoline vapor shall be installed or used within twenty-four inches (24") of the floor.

The use, handling, storage and sale of gasoline, fuel oil and other flammable liquids shall not be permitted in any Group E occupancy unless such use, handling, storage and sale comply with the suggested Fire Prevention Ordinance, Edition of 1938,¹ recommended by the National Board of Fire Underwriters.

Dry cleaning plants in which combustible solvents are used or stored shall be of Type I construction and shall not exceed one story in height. All partitions shall be of four-hour fire-resistive construction, except for the necessary openings for the vent ducts, piping and shafting. All openings in exterior walls, except wall vents, shall be protected with one-hour fire-resistive doors or windows. Wall vents having an area of not less than sixteen square inches (16 sq. in.) each, shall be placed in the exterior walls near the floor line, not more than six feet (6') apart horizontally. Each building shall be provided with a power driven fan exhaust system of ventilation which shall be arranged and operated so as to produce a complete change of air in each room every three minutes.

Each machine in dry cleaning establishments which uses a volatile flammable liquid shall have an adequate steam line directly connected to it, so arranged as to have the steam automatically released to the inside of such machine should an explosion occur in the machine.

Laws of the State regulating the construction and maintenance of dry cleaning plants or other buildings containing any occupancy or special hazard covered by this Chapter, shall be deemed to be a part of this Code and such buildings shall conform to the provisions of such state laws.

Exceptions and Deviations

Sec. 1009. Public garages shall not be of Type V construction, shall not be of Type III construction when more than two stories in height, and shall be not over six hundred square feet (600 sq. ft.) in area or twenty-five feet (25') in height when of Type IV construction.

All public garage floors shall be of incombustible materials and if not placed directly on the ground shall conform to the requirements for floors of Type I construction, or the floors may be of Type II construction properly protected with incombustible materials against saturation by oil and grease.

Gasoline filling stations of Type V construction shall have incombustible exterior wall covering. Canopies, including sup-

¹See Specification Documents, for provisions for handling flammable liquids.

Sections 1009-1010

ports thereof, over pumps shall be of incombustible materials or one-hour fire-resistive construction.

Division 3 occupancies of Group E more than five stories in height shall have all floors of not less than three-hour fire-resistive construction as specified in Section 4303.

**Mixed
Occupancies**

Sec. 1010. Separation of Group E occupancies from all other occupancies shall be provided as specified in Section 503.

CHAPTER 11—REQUIREMENTS FOR GROUP F OCCUPANCIES

Group F Occupancies Defined

Sec. 1101. Group F occupancies shall be:

Division 1: Wholesale and retail stores, office buildings, restaurants, undertaking parlors, printing plants, municipal police and fire stations.

Division 2: Factories and workshops using materials not highly flammable or combustible.

Division 3: Storage and sales rooms for combustible goods.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Construction Height and Area Allowable

Sec. 1102. Buildings classed in Group F because of the use or character of the occupancy shall be one of the "Types of Construction," and shall not exceed the maximum limits set forth in Table No. I of this Chapter.

Exceptions: 1. When the entire building is protected by an automatic sprinkler system as provided in Chapter 38, the permissible areas shown may be increased 100 per cent.

2. The area of a Group F occupancy of Types II and III construction may exceed that set forth in Table No. I of this Chapter, provided that such a building is divided into areas by special occupancy separations, no division of which shall exceed the area set forth in Table No. I.

3. The area of a Group F occupancy of Types IV and V construction may exceed that which is set forth in Table No. I of this Chapter, provided that such building is divided into

**TABLE NO. I—TYPES OF CONSTRUCTION, NUMBER OF
STORIES AND FLOOR AREAS PERMITTED
FOR GROUP F OCCUPANCIES**

Types of Construction	Number of Stories	Maximum Floor Areas (Sq. Ft.)		
		When Building Fronts on		
		1 street	2 streets	3 or more streets
Type I	NO RESTRICTIONS			
Type II	6 or 7 stories	12,000	15,000	18,000
	2 to 5 stories	15,000	18,000	20,000
	1 story	20,000	25,000	30,000
Type III	2 to 5 stories	12,000	15,000	18,000
	1 story	18,000	22,500	25,000
Type IV	2 or 3 stories	10,000	12,500	15,000
	1 story*	15,000	20,000	25,000
Type V	2 or 3 stories	5,000	6,000	7,000
	1 story	10,000	12,000	14,000

*Areas may be increased 50 per cent when exterior walls and bearing partitions are of one-hour fire-resistive construction and floor construction over usable space is protected with a ceiling of metal lath and three-fourths inch (¾") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Sections 1102-1110

areas by two-hour fire separations with all openings therein provided with one-hour fire-resistive protection, no division of which shall exceed the area set forth in Table No. I.

For attic space partitions and draft stops see Section 3205.

Sec. 1103. All exterior walls or parts of walls except on street fronts of Group F occupancies which are less than four feet (4') from adjacent property lines shall have no openings therein; shall be of not less than four-hour fire-resistive construction as specified in Chapter 43, and shall be constructed as set forth in Parts V, VI and VII of this Code. All openings in exterior walls, except on street fronts which are less than eight feet (8') from adjacent property lines shall be provided with doors and windows of one-hour fire-resistive construction as specified in Section 4304. See Section 504 for regulating adjacent buildings on the same property.

Sec. 1104. Stairs and exits shall be provided as and when required in Chapter 33.

Smokeproof towers shall be provided as and when required in Chapter 33.

Sec. 1105. All portions of Group F occupancies customarily used by human beings shall be provided with light and ventilation by means of windows or skylights with an area not less than one-eighth of the total floor area or shall be provided with artificial light and a mechanically operated ventilating system. In no case shall less than four changes of air per hour be provided.

Every building or portion thereof where more than four persons are employed shall be provided with at least one toilet. Every building and each subdivision thereof where both sexes are employed shall be provided with access to at least two toilets located either in such building or conveniently in a building adjacent thereto.

Sec. 1106. All elevator shafts, vent shafts and other vertical openings shall be enclosed as specified under "Types of Construction."

Sec. 1107. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38.

Sec. 1108. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.

No storage of volatile flammable liquids shall be allowed in Group F occupancies and the handling and use of gasoline, fuel oil and other flammable liquids shall not be permitted in any Group F occupancy unless such use and handling comply with the suggested Fire Prevention Ordinance, Edition of 1938¹ recommended by the National Board of Fire Underwriters.

In any room in which volatile flammable liquids are used or stored no device generating a glow or flame capable of igniting gasoline vapor shall be installed or used within twenty-four inches (24") of the floor.

Sec. 1109. Division 3 occupancies of Group F more than six stories in height shall have all floors of not less than three-hour fire-resistive construction as specified in Section 4303.

Sec. 1110. Separation of Group F occupancies from all other occupancies shall be provided as specified in Section 503.

¹See Specification Documents, for provisions for handling flammable liquids.

**Location
on Property**

**Exit
Facilities**

**Light
Ventila-
tion and
Sanitation**

**Enclosure
of Vertical
Openings**

**Fire Extin-
guishing
Apparatus**

**Special
Hazards**

**Exceptions
and Devia-
tions**

**Mixed
Occupancies**

Sections 1201-1203

CHAPTER 12—REQUIREMENTS FOR GROUP G OCCUPANCIES

Group G Occupancies Defined

Sec. 1201. Group G occupancies shall be:

Division 1: Ice plants, power plants, pumping plants, cold storage, creameries.

Division 2: Factories and workshops using incombustible and non-explosive materials:

Division 3: Storage and sales rooms of incombustible and non-explosive materials.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Construction Height and Area Allowable

Sec. 1202. Buildings classed in Group G because of the use or character of the occupancy shall be one of the "Types of Construction," and shall not exceed the maximum limits set forth in Table No. I of this Chapter.

Exceptions: 1. When the entire building is protected by an automatic sprinkler system as provided in Chapter 38, the permissible areas may be increased 100 per cent.

2. The area of a Group G occupancy of Types II and III construction may exceed that set forth in Table No. I of this Chapter, provided that such a building is divided into areas by a special occupancy separation, no division of which shall exceed the area set forth in Table No. I.

**TABLE No. I—TYPES OF CONSTRUCTION, NUMBER OF
STORIES AND FLOOR AREAS PERMITTED
FOR GROUP G OCCUPANCIES**

Types of Construction	Number of Stories	Maximum Floor Areas (Sq. Ft.)		
		When Building Fronts on		
		1 street	2 streets	3 or more streets
Type I	NO RESTRICTIONS			
	6 or 7 stories	15,000	18,000	20,000
Type II	2 to 5 stories	20,000	25,000	30,000
	1 story	NO RESTRICTIONS		
Type III	2 to 5 stories	12,000	15,000	18,000
	1 story	20,000	25,000	30,000
Type IV	2 or 3 stories	15,000	18,000	21,000
	1 story*	25,000	30,000	35,000
Type V	2 or 3 stories	10,000	12,500	15,000
	1 story	12,000	15,000	18,000

*Areas may be increased 50 per cent when exterior walls and bearing partitions are of one-hour fire-resistive construction and floor construction over usable space is protected with a ceiling of metal lath and three-fourths inch (¾") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Sections 1202-1210

3. The area of a Group G occupancy of Types IV and V construction may exceed that which is set forth in Table No. I of this Chapter, provided that such building is divided into areas by two-hour fire separations with all openings therein protected with one-hour fire-resistive protection, no division of which shall exceed the area set forth in Table No. I. For attic space partitions and draft stops see Section 3205.

Sec. 1203. All exterior walls or parts of walls, except on street fronts of Group G occupancies which are less than three feet (3') from adjacent property lines, shall have no openings therein, shall be of not less than one-hour fire-resistive construction as specified in Chapter 43, and shall be constructed as specified in Parts V, VI and VII of this Code. See Section 504 for regulating adjacent buildings on the same property.

Sec. 1204. Stairs and exits shall be provided as and when required in Chapter 33.

Smokeproof towers shall be provided as and when required in Chapter 33.

Sec. 1205. All portions of Group G occupancies customarily used by human beings shall be provided with light and ventilation.

Every building or portion thereof where more than four persons are employed shall be provided with at least one toilet. Every building and each subdivision thereof where both sexes are employed shall be provided with access to at least two toilets located either in such building or conveniently in a building adjacent thereto.

Sec. 1206. Except as required in Chapter 33, vertical openings are not required to be enclosed.

Sec. 1207. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38.

Sec. 1208. Chimneys and heating apparatus shall conform to the requirements of Chapter 37. In any room in which volatile flammable liquids are used or stored, no device generating a glow or flame capable of igniting gasoline vapor shall be installed or used within twenty-four inches (24") of the floor.

The storage, use and handling of gasoline, fuel oil and other flammable liquids shall not be permitted in any Group G occupancy unless such storage and handling comply with the suggested Fire Prevention Ordinance, Edition of 1938,¹ recommended by the National Board of Fire Underwriters.

Sec. 1209. Fire protection of the under side of all roof framing of Group G occupancies may be omitted in all "Types of Construction."

Sec. 1210. Separation of Group G occupancies from all other occupancies shall be provided as specified in Section 503.

**Exit
Facilities**

**Light,
Ventila-
tion and
Sanitation**

**Enclosure
of Vertical
Openings
Fire Extinguishing
Apparatus
Special
Hazards**

**Exceptions
and
Deviations**

**Mixed
Occupancies**

¹See Specification Documents, for provisions for handling flammable liquids.

Sections 1301-1303

CHAPTER 13—REQUIREMENTS FOR GROUP H OCCUPANCIES

Group H Occupancies Defined

Sec. 1301. Group H occupancies shall be:

Division 1: Hotels, apartment houses, dormitories, lodging houses.

Division 2: Convents, monasteries, old people's homes (accommodating 10 or more persons).

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Construction, Height and Area Allowable

Sec. 1302. Buildings classed in Group H because of the use or character of the occupancy shall be one of the "Types of Construction," and shall not exceed the maximum limits set forth in Table No. I of this Chapter.

Exception: When the entire building is protected by an automatic sprinkler system as provided in Chapter 38, the permissible areas shown may be increased 100 per cent.

For attic space partitions and draft stops see Section 3205.

Location on Property

Sec. 1303. All exterior walls or parts of walls, except on street fronts of Group H occupancies which are less than three feet (3') from adjacent property lines, shall have no openings therein, shall be of not less than one-hour fire-resistive construction as specified in Chapter 43 and shall be constructed as set forth in Parts V, VI and VII of this Code. All openings in exterior walls, except on street fronts, which are less than five

**TABLE No. I—TYPES OF CONSTRUCTION, NUMBER OF
STORIES AND FLOOR AREAS PERMITTED
FOR GROUP H OCCUPANCIES**

Types of Construc- tion	Number of Stories	Maximum Floor Areas (Sq. Ft.)		
		When Building Fronts on		
		1 street	2 streets	3 or more streets
Type I		NO RESTRICTIONS		
	6 or 7 stories	12,000	15,000	18,000
Type II	2 to 5 stories	15,000	18,000	20,000
	1 story	20,000	25,000	30,000
Type III	2 to 5 stories	12,000	15,000	18,000
	1 story	18,000	20,000	22,500
Type IV	2 or 3 stories	9,000	10,000	12,000
	1 story*	9,000	10,000	12,000
Type V	2 or 3 stories	6,000	7,000	8,000
	1 story	8,000	9,000	10,000

*Areas may be increased 50 per cent when exterior walls and bearing partitions are of one-hour fire-resistive construction and floor construction over usable space is protected with a ceiling of metal lath and three-fourths inch ($\frac{3}{4}$ ") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Sections 1303-1308

feet (5') from adjacent property lines, shall be provided with doors or windows of one-hour fire-resistive construction as specified in Section 4304. See Section 504 for regulating adjacent buildings on the same property.

Location of Group H occupancies on the property shall meet the requirements of any State laws which are intended to regulate such location.

Sec. 1304. Stairs and exits shall be provided as and when required in Chapter 33. **Exit Facilities**

Smokeproof towers shall be provided as and when required in Chapter 33.

All stairs and exits in Group H occupancies shall open directly upon a street or alley or upon a yard or court not less than four feet (4') in width directly connected to a street or alley by means of a passageway not less in width than the stairway opening into such passageway and not less than seven feet (7') in height.

Sec. 1305. All rooms of Group H occupancies used for eating, living or sleeping purposes shall be provided with light and ventilation by means of windows with an area not less than one-eighth of the total floor area of such room or rooms. **Light, Ventilation and Sanitation**

Every building shall be provided with at least one toilet. Every building and each subdivision thereof where both sexes are accommodated shall be provided with at least two toilets located in such building and one such toilet shall be conspicuously marked "For Women" and the other conspicuously marked "For Men." Not less than one toilet shall be provided for each 15 persons or major fraction thereof that such building is designed to accommodate.

Light, ventilation and sanitation shall be provided as specified by any State laws intended to regulate such light, ventilation and sanitation.

Sec. 1306. All elevator shafts, vent shafts, stairways and other vertical openings shall be enclosed as specified under "Types of Construction," except stairways in buildings two stories in height. **Enclosure of Vertical Openings**

Sec. 1307. Automatic sprinklers, standpipes and basement pipe inlets shall be installed as and when required in Chapter 38. **Fire Extinguishing Apparatus**

Sec. 1308. Chimneys and heating apparatus shall conform to the requirements of Chapter 37. **Special Hazards**

Every boiler room or room containing a central heating plant using solid or liquid fuel shall be separated from the rest of the building by a "Special Occupancy Separation" as defined in Section 503; except, that in buildings of Type V Construction an "Ordinary Occupancy Separation" may be used.

The storage and handling of gasoline, fuel oil and other flammable liquids shall not be permitted in any Group H occupancy unless such storage and handling comply with the suggested

Sections 1308-1310

Fire Prevention Ordinance, Edition of 1938,¹ recommended by the National Board of Fire Underwriters.

All doors leading into rooms in which volatile flammable liquids are used or kept shall be of one-hour fire-resistive construction as specified in Section 4304 and shall be kept normally closed.

Exceptions and Deviations

Sec. 1309. Furnaces may be used without an "Occupancy Separation" in buildings not more than two stories in height.

Mixed Occupancies

Sec. 1310. Separations between Group H occupancies and all other occupancies shall be provided as specified in Section 503.

¹See Specification Documents, for provisions for handling flammable liquids.

CHAPTER 14 — REQUIREMENTS FOR GROUP I OCCUPANCIES

Sec. 1401. Group I occupancies shall be dwellings.	Group I Occupancies Defined
See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.	
Sec. 1402. Buildings or parts of buildings classed in Group I because of use or the character of the occupancy shall be one of the "Types of Construction." The floor area of Types I and II buildings shall be unlimited, the floor area of Type III buildings shall be limited to ten thousand square feet (10,000 sq. ft.), and the floor area of Types IV and V buildings shall be limited to seventy-five hundred square feet (7500 sq. ft.).	Construction and Area Allowable
Sec. 1403. All exterior walls or parts of walls except on street fronts of Group I occupancies which are less than three feet (3') from adjacent property lines shall have no openings therein, shall be of not less than one-hour fire-resistive construction as set forth in Chapter 43, and shall be constructed as set forth in Parts V, VI and VII of this Code. See Section 504 for regulating adjacent buildings on the same property.	Location on Property
Sec. 1404. Stairs and exits shall be provided as and when required in Chapter 33.	Exit Facilities
Sec. 1405. All rooms of Group I occupancies used for eating, living or sleeping purposes shall be provided with light and ventilation by means of windows with an area not less than one-eighth of the total floor area of such room or rooms.	Light, Ventila- tion and Sanitation
Light, ventilation and sanitation shall be provided as required by any state laws which are intended to regulate such light, ventilation and sanitation.	
Sec. 1406. Stairs in Group I occupancies need not be enclosed. Dumb-waiter shafts, clothes chutes and other similar vertical openings shall be protected as specified in Section 3003.	Enclosure of Vertical Openings
Sec. 1407. Fire extinguishing apparatus when installed shall conform to the requirements of Chapter 38.	Fire Extinguishing Apparatus
Sec. 1408. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.	Special Hazards
Flammable liquids shall not be stored or used in Group I occupancies in quantities in excess of one gallon and all such flammable liquids shall be kept in tight or sealed containers when not in actual use.	
Sec. 1409. Group I occupancies constructed on the roof of multiple storied buildings shall be considered as an additional story in so far as the construction, location, exposure, stairs, exits and fire extinguishing apparatus are concerned.	Exceptions and Devia- tions
Sec. 1410. Separation of Group I occupancies from all other occupancies shall be provided as specified in Section 503.	Mixed Occupancies

CHAPTER 15 — REQUIREMENTS FOR GROUP J OCCUPANCIES

Group J Occupancies Defined	Sec. 1501. Group J occupancies shall be: Division 1—Private garages, sheds and minor buildings used as accessories only when not over one thousand square feet (1000 sq. ft.) in area. Division 2—Fences over six feet (6') high, tanks and towers. See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.
Construction, Height and Area Allowable	Sec. 1502. Buildings or parts of buildings classed in Group J because of the use or character of the occupancy shall be one of the "Types of Construction." The floor area shall not exceed one thousand square feet (1000 sq. ft.). The height shall not exceed one story. When any building exceeds the limit set forth in this Chapter it shall be classed in the occupancy group other than Group J that it most nearly resembles.
Location on Property	Sec. 1503. All exterior walls or parts of walls except on street fronts of Group J occupancies which are less than three feet (3') from adjacent property lines shall have no openings therein, and shall be constructed as specified in Parts V, VI and VII of this Code. See Section 504 for regulating adjacent buildings on the same property.
Exit Facilities	Sec. 1504. Stairs and Exits shall be provided as and when required in Chapter 33.
Light and Venti- lation	Sec. 1505. Private garages which are constructed in conjunction with any Group H or I occupancies and which have openings into such buildings shall be equipped with fixed louvered or screened openings or exhaust ventilation with exhaust openings located within six inches (6") of the floor. The clear area of the louvered opening or of the openings into the exhaust ducts shall be not less than sixty square inches (60 sq. in.) per car stored in such private garage. Under no circumstances shall a private garage have any opening directly into a room used for sleeping purposes.
Enclosure of Vertical Openings Fire Extn- guishing Apparatus	Sec. 1506. Enclosure of vertical openings shall not be required. Sec. 1507. Fire extinguishing apparatus shall be installed as and when required in Chapter 38. Where more than three automobiles are stored in any private garage there shall be installed not less than one two-and-one-half gallon chemical extinguisher to each five cars or major fraction thereof.
Special Hazards	Sec. 1508. Chimneys and heating apparatus shall conform to the requirements of Chapter 37. Flammable liquids shall not be stored, handled or used in Group J occupancies unless such storage or handling shall comply with the suggested Fire Prevention Ordinance recommended by the National Board of Fire Underwriters, Edition of 1938.¹

¹See Specification Documents, for provisions for handling flammable liquids.

Sections 1509-1510

Sec. 1509. When storage space termed in this Code a private garage is provided in any building of mixed occupancies, such storage space shall be limited to six hundred and fifty square feet (650 sq. ft.) of floor area unless such storage space is separated from other portions of the building as required for public garages.

**Exceptions
and
Deviations**

Sec. 1510. Separation of Group J occupancies from any other occupancies shall be provided as specified in Sections 503 and 1509.

**Mixed
Occupancies**

PART IV

REQUIREMENTS BASED ON LOCATION IN FIRE ZONES

CHAPTER 16—RESTRICTIONS IN FIRE ZONES

Fire Zones Defined

Sec. 1601. (a) General. For the purpose of this Code, the entire city is hereby declared to be and is hereby established a Fire District and said Fire District shall be known and designated as Fire Zones One, Two and Three, and shall include such territory or portions of said City as outlined in an ordinance of said City, entitled: "An Ordinance Creating and Establishing Fire Zones." Whenever in such ordinance creating and establishing fire zones, reference is made to any fire zone, it shall be construed to mean one of the three fire zones designated and referred to in this Chapter.

(b) Buildings Located in More than One Fire Zone. A building or structure which is located partly in one fire zone and partly in another shall be considered to be in the more highly restricted fire zone when more than one-third of its total floor area is located in such zone.

(c) Moved Buildings. Any building or structure moved within or into any Fire Zone shall be made to comply with all the requirements for new buildings in that Fire Zone.

(d) Temporary Buildings. Temporary buildings such as reviewing stands and other miscellaneous structures conforming to the requirements of this Code, and sheds, canopies or fences used for the protection of the public around and in conjunction with construction work may be erected in Fire Zones Nos. 1 or 2 by special permit from the Building Inspector for a limited period of time, and such building or structure shall be completely removed upon the expiration of the time limit stated in such permit.

Restrictions in Fire Zone No. 1

Sec. 1602. (a) General. Buildings or structures hereafter erected, constructed, moved within or into Fire Zone No. 1 shall be only of Type I, II, III or IV construction and shall meet the requirements of this Section.

(b) Limitation of Types of Construction. 1. Type III. Buildings or structures of Type III construction hereafter erected shall have all walls and partitions and floors over usable spaces of not less than one-hour fire-resistive construction as set forth in Chapter 43.

2. Type IV. No building of Type IV construction having an area greater than four hundred square feet (400 sq. ft.) shall be erected, constructed in, or moved into or within Fire Zone No. 1.

(c) Openings. All openings in exterior walls within twenty feet (20') of adjacent property lines or other buildings on the same property or within fifty feet (50') of the opposite side of a street or public place or in courts which are less than twenty feet (20') in least dimension, shall be provided with doors or

Sections 1602-1603

windows of one-hour fire-resistive construction as set forth in Section 4304.

For the purpose of this subsection, the center line of an adjoining alley may be considered as the adjacent property line. All distances in this subsection shall be measured at right angles to the plane of the wall in which the opening occurs.

(d) **Alterations.** Any building or structure which is enlarged, altered, raised, repaired or built upon to an extent exceeding an expenditure of 20 per cent of the value of the building or structure, shall be made to comply with all the requirements of a new building or structure erected in Fire Zone No. 1.

No building of Type IV construction in excess of four hundred square feet (400 sq. ft.) in floor area nor any building of Type V construction already erected in Fire Zone No. 1 shall hereafter be altered, raised, enlarged, added to or moved, except as follows:

1. Such Type IV building may be made to conform to all the provisions of subsections (b) and (c) of this Section.

2. Changes, alterations and repairs to the interior of such building or to the front thereof facing a public street may be made, provided such changes do not, in the opinion of the Building Inspector, increase the fire hazard of such building.

3. Roofs of such buildings may be covered only with a "Fire Retardant" roofing as set forth in Section 4305. See Section 104 (e) for repairs.

4. Such building may be moved entirely outside the limits of Fire Zone No. 1.

5. Such building may be demolished.

(e) **Occupancies Prohibited.** No Group E Occupancies except garages or gasoline filling stations shall be permitted in Fire Zone No. 1.

Sec. 1603 (a) General. Buildings or structures hereafter erected, constructed, moved within or into Fire Zone No. 2 shall be one of the Types of Construction and shall meet the requirements of this Section. **Restrictions in Fire Zone No. 2**

(b) **Limitation of Types of Construction. 1. Type IV.** Buildings of Type IV construction having an area greater than seventy-five hundred square feet (7,500 sq. ft.) shall not be erected, constructed, moved within or into Fire Zone No. 2 and such buildings over one thousand square feet (1000 sq. ft.) in area, erected, constructed, moved within or into Fire Zone No. 2 shall have all exterior walls of not less than one-hour fire-resistive construction; provided that when such exterior walls are less than three feet (3') from adjacent property lines or less than six feet (6') from buildings on the same property, the exterior walls shall be of not less than four-hour fire-resistive construction, as set forth in Chapter 43.

2. **Type V.** Buildings or structures of Type V construction hereafter erected, constructed, moved within or into Fire Zone No. 2 shall have all exterior walls of not less than one-hour fire-resistive construction as specified in Section 4302; provided, that when such exterior walls are less than three feet (3') from adjacent property lines or less than six feet (6') from buildings on the same property the exterior walls shall be of not less than

four-hour fire-resistive construction as specified in Chapter 43. In all cases the roofs of such buildings shall be covered with a "Fire Retardant" roofing as set forth in Section 4305.

(c) **Alterations.** Any building or structure which is enlarged, altered, raised, repaired or built upon to an extent exceeding an expenditure of 50 per cent of the value of the building shall be made to comply with all the requirements of a new building or structure erected in Fire Zone No. 2.

No building of Type IV construction in excess of one thousand square feet (1000 sq. ft.) in floor area nor any building of Type V construction except as set forth in subsection (b) already erected in Fire Zone No. 2, shall hereafter be altered, raised, enlarged, added to or moved except as follows:

1. Such building may be made to conform to the provisions of subsection (b) of this Section.

2. Changes, alterations and repairs to the interior of such building or to the front thereof facing a public street may be made provided such changes do not, in the opinion of the Building Inspector, increase the fire hazard of such building.

3. Roofs of such buildings may be covered only with a "Fire Retardant" roofing as set forth in Section 4305. See Section 104 (e) for repairs.

4. Such building may be moved entirely outside the limits of Fire Zone No. 2.

5. Such building may be demolished.

d. **Occupancies Prohibited.** No Group E Occupancies except garages or gasoline filling stations shall be permitted in Fire Zone No. 2.

Restrictions in Fire Zone No. 3

Sec. 1604. (a) General. Any building or structure complying with the requirements of this Code may be erected, constructed, moved within or into Fire Zone No. 3.

PART V

REQUIREMENTS BASED ON TYPES OF CONSTRUCTION

CHAPTER 17 — CLASSIFICATION OF ALL BUILDINGS BY TYPES OF CONSTRUCTION

Sec. 1701. The requirements of Part V are the minimum requirements for the various Types of Construction. In order that a building may be classed in any specific Type of Construction, it shall comply with all of the requirements for that Type of Construction, as set forth in this Code.

General

No building or portion thereof shall be required to conform to the details of a Type of Construction higher than that Type which meets the minimum requirements based on Occupancy (Part III) or Location in Fire Zone (Part IV) even though certain features of such building actually conform to a higher Type of Construction.

The various Types of Construction herein defined represent varying degrees of public safety and resistance to fire. Where specific materials, types of construction or fire-resistive protection are required, such requirements shall be the minimum requirements and any materials, types of construction or fire-resistive protection which will afford equal or greater public safety or resistance to fire, as specified in this Code, may be used.

Any system or method of construction to be used shall admit of a rational analysis in accordance with well established principles of mechanics.

Sec. 1702. All buildings shall be divided into the following Types of Construction based upon their resistance to fire, and Type I shall be deemed to be the most fire-resistive and Type V the least fire-resistive Type of Construction.

Classification by Types of Construction

Type I—FIRE-RESISTIVE Construction.

Type II—HEAVY TIMBER Construction.

Type III—ORDINARY MASONRY Construction.

Type IV—LIGHT INCOMBUSTIBLE FRAME Construction.

Type V—WOOD FRAME Construction.

When two or more types of construction occur in the same building and are not separated by an unpierced wall of four-hour fire-resistive construction, the entire building shall be classed in the least fire-resistive type of construction and such buildings shall be subject to the restrictions of such type. Any building erected prior to the passage of this Code, which by its construction cannot be classified definitely as Type I, II, III, IV or V as defined herein, shall for the purpose of this Code be deemed to belong to the least fire-resistive class of the two types to which it most nearly conforms. Any building which cannot be classed as Type I, II, III or IV construction shall be considered to be of Type V construction.

CHAPTER 18 — TYPE I BUILDINGS (Fire-Resistive)

Definition

Sec. 1801. In "Type I Buildings," the structural frame shall be of structural steel or iron which shall be fire-protected, or shall be of reinforced concrete. The exterior walls, inner court walls, and walls enclosing vertical openings, shall be of fire-resistive construction. The roof construction and floors shall be of fire-resistive materials. Exterior doors and windows, except as specified in Section 1813 shall be of fire-resistive construction.

Note: Fire-resistive materials and fire-resistive construction have a specific meaning in this Code, as specified in Chapters 42 and 43.

Height Allowable

Sec. 1802. The height of Type I buildings shall not be limited.

Area Allowable

Sec. 1803. The floor area of Type I buildings shall not be limited.

Foundations

Sec. 1804. Footings shall be of solid masonry as specified in Chapter 24 or of reinforced concrete as specified in Chapter 26, and shall be designed as specified in Section 2311 and Chapter 28. Foundation walls shall be of masonry or reinforced concrete as specified in Chapter 29.

Exterior and Inner Court Walls

Sec. 1805. Exterior walls of masonry or reinforced concrete as set forth in Chapter 29 shall be provided, and shall be of not less than four-hour fire-resistive construction as set forth in Section 4302, except that walls fronting on streets having a width of at least 50 feet in Fire Zone No. 1 or 30 feet in Fire Zones No. 2 and No. 3 may be of incombustible construction with all structural members fire-protected as required in Section 1809.

Inner court walls shall be of masonry or reinforced concrete of not less than three-hour fire-resistive construction as specified in Section 4302.

Partitions

Sec. 1806. Interior partitions shall be constructed of incombustible materials and shall be of not less than one-hour fire-resistive construction as specified in Section 4302.

Exceptions: Partitions dividing portions of stores, offices or similar places occupied by one tenant only may be constructed of wood panels or similar light construction up to three-fourths the height of the room in which placed; when more than three-fourths the height of the room, such partitions shall have not less than the upper one-fourth of the partition constructed of plain glass set in sash.

Enclosure of Vertical Openings

Sec. 1807. Enclosures for elevator shafts, vent shafts, stair wells and other vertical openings, when required because of Occupancy in Part III shall be of two-hour fire-resistive construction and all openings therein shall be protected by fire-resistive doors or windows as specified in Chapters 30 and 43.

A parapet wall or hand rail at least thirty inches (30") in

Sections 1807-1809

height above the roof shall be provided around all open shaft enclosures extending through the roof.

Sec. 1808. Structural framework shall be of structural steel or iron as specified in Chapter 27 or shall be of reinforced concrete as specified in Chapter 26. **Structural Frame**

The structural frame shall be considered as the columns, and all girders, beams, trusses or spandrels having rigid connections to the columns and all other members essential to the stability thereof. The members of floor or roof panels which have no connection to the columns, shall be considered secondary members. The structural frame and secondary members shall be designed and constructed to carry all dead, live and other loads to which they may be subjected both during erection and after completion of the structure. Unless otherwise provided for in the structural frame the floor and roof panel construction shall be designed and constructed to carry the horizontal forces to such parts of the structural frame as are designed to carry the horizontal forces to the foundations.

The entire structural frame and each member which is a part of such frame shall be so designed and constructed that the stresses may be satisfactorily determined by a rational analysis in accordance with well established principles of mechanics and sound engineering practice.

Sec. 1809. (a) **Structural Steel or Iron Members.** All structural steel or iron members, not including forms or structural members for elevators and elevator enclosures, shall be thoroughly fire-protected with not less than four-hour fire-resistive protection for columns, beams and girders and three-hour fire-resistive protection for floors, for all buildings more than eight stories or eighty-five feet (85') in height; and with three-hour fire-resistive protection for columns, beams and girders and two-hour fire-resistive protection for floors; for all buildings which are eight stories or eighty-five feet (85') or less in height; and all such fire-resistive protection shall be as specified in Chapter 43. **Fire-protection of Structural Members**

Exceptions: 1. The thickness of the fire-protection on the outer edge of lugs or brackets on columns may be reduced to not less than one inch (1").

2. The masonry over window openings may be supported by a steel plate, angle or similar member which is not fire-protected on the under side, provided the member is supported at proper intervals from a structural beam or girder which is fire-protected on all sides. For openings in masonry bearing walls not exceeding four feet (4') in width, an angle or similar member supported by masonry and not fire-protected on the under side may be used.

3. Where every part of the structural steel framework of the roof of a Group A, B or C occupancy is not less than twenty-five feet (25') above any floor, balcony or gallery, fire-protection of all members of the roof construction may be omitted.

4. Where every part of the structural steel framework of the roof of a Group A, B or C occupancy is more than eighteen feet (18') and less than twenty-five feet (25') above

Sections 1809-1812

any floor, balcony or gallery, the roof construction shall be protected by a suspended ceiling of not less than one-hour fire-resistive construction as specified in Chapter 43, and such ceiling shall be not less than six inches (6") distant from any part of such roof construction.

(b) **Reinforced Concrete Members.** All reinforced concrete columns, beams and girders shall be thoroughly fire-protected with four-hour fire-resistive protection and all floors, joists and slabs shall be thoroughly fire-protected with not less than three-hour fire-resistive protection, for all buildings more than eight stories or eighty-five feet (85') in height; and all reinforced concrete columns, beams and girders shall be thoroughly fire-protected with not less than three-hour fire-resistive protection and all floors, joists and slabs shall be thoroughly fire-protected with not less than two-hour fire-resistive protection, for all buildings which are eight stories or eighty-five feet (85') or less in height; and all such fire-resistive protection shall be as specified in Chapter 43.

Floor Construction

Sec. 1810. Floors shall be constructed of reinforced concrete, brick or hollow tile arches, reinforced gypsum or may be composite floors of those materials in combination with structural steel or iron or reinforced concrete; or such floor panel construction shall consist of any floor system providing not less than two-hour fire-resistive construction as specified in Section 4303 for buildings which are eight stories or eighty-five feet (85') or less in height and providing not less than three-hour fire-resistive construction is used as specified in Section 4303 for all buildings more than eight stories or eighty-five feet (85') in height.

The type of floor construction used shall provide means to keep the beams and girders from spreading, by installing either ties or bridging, with no laterally unsupported length of joists being permitted to exceed eight feet (8') except as otherwise provided in Sections 3102 and 3103. The floor and roof panel construction shall be so designed and constructed as to transfer horizontal forces to such parts of the structural frame as are designed to carry the horizontal forces to the foundations, unless such forces are provided for otherwise.

Where wood sleepers are used for laying wood floors the space between the floor slab and the underside of the wood flooring shall be filled with incombustible material in such a manner that there will be no open spaces under the flooring which will exceed one hundred square feet (100 sq. ft.) in area and such space shall be filled solidly under all partitions so that there is no communication under the flooring between adjoining rooms.

Roof Construction

Sec. 1811. Roofs shall be constructed of any materials or combination of materials as allowed for floors in Section 1810.

Roof Covering shall be a "Fire Retardant" roofing as specified in Section 4305.

Any drainage fill placed on a roof deck of any building shall be of incombustible material and such fill shall be considered as a part of the dead load in designing the roof framing.

Stair Construction

Sec. 1812. Stairs and stair platforms shall be constructed of reinforced concrete, iron or steel with treads and risers of con-

Sections 1812-1816

crete, iron or steel. Brick, marble, tile or other hard incombustible materials may be used for the finish of such treads and risers.

All stairs shall be designed and constructed as specified in Chapter 33 and as required under Occupancy in Part III.

Sec. 1813. Doors, windows and other openings in the exterior walls shall be protected by one-hour fire-resistive construction as specified in Section 4304.

**Doors
and
Windows**

Exceptions: 1. The provisions of this Section shall not apply to doors, windows and other openings which face directly upon, and are not within fifty feet (50') in Fire Zone No. 1 or are not within thirty feet (30') in Fire Zones No. 2 and 3, of the opposite side of a public street or other public place, this distance to be measured at right angles to the plane of the wall in which such openings occur.

2. The provisions of the first paragraph of this Section shall not apply to openings in an outer court twenty feet (20') or more in width parallel to and facing upon a street or public place, provided such openings are not within twenty feet (20') of an adjacent property line.

Sec. 1814. Bays, oriels and similar projections shall be constructed of incombustible materials with walls, floors and roofs as specified in this Chapter and as specified in Chapter 35.

**Projections
from the
Building**

Porches and exterior balconies shall be constructed of incombustible materials but structural steel or iron members need not be fire-protected; provided, that loading platforms for warehouses, freight depots and similar buildings may be of heavy timber construction with wood floors not less than one and five-eighths inches (1½") thick. Such wood construction shall not be carried through the exterior walls of any Type I building.

Cornices, marques and similar appendages which are a part of a Type I building shall be constructed of substantial incombustible materials and as required in Chapter 45.

Sec. 1815. Penthouses and other roof structures shall be constructed of masonry or reinforced concrete, and all doors, windows and other openings therein shall be protected by one-hour fire-resistive construction or shall have one-hour fire-resistive windows as specified in Chapters 36 and 43.

**Penthouses
and Sky-
lights**

Skylights shall be constructed of one-hour fire-resistive materials as specified in Chapter 43 and in Section 3402.

Sec. 1816. Wood or unprotected steel or iron shall be permitted in the following places:

**Combustible
Materials
Regulated**

1. Mezzanine floors may be of wood or unprotected steel provided that there shall be not more than two such mezzanines in any room of any building and provided, further, that no such mezzanine floor or floors shall cover more than 33½ per cent of the area in the room where located. Such mezzanine floors constructed in Fire Zone No. 1 shall be of heavy timber construction as required for floor construction in Type II buildings.

2. Show window frames and aprons, also show cases and other appurtenances on the first floors of stores or other similar

Section 1816

buildings may be of wood with or without unprotected steel or iron.

3. Trim, picture molds, chair rails, wainscoting, baseboards, hand rails, show window backing, temporary partitions, floors, and sleepers may be of wood. Wood doors may be used except in stair, elevator or other shaft enclosures or where not specifically prohibited under Occupancy in Part III.

4. Roofs may be sheathed by wood planks of two and one-half inch ($2\frac{1}{2}$ ") nominal thickness when such sheathing is more than thirty feet (30') distant from any floor, balcony or gallery and when such plank sheathing is protected on the underside by a ceiling of not less than one-hour fire-resistive construction as specified in Section 4301.

CHAPTER 19 — TYPE II BUILDINGS

(Heavy Timber Construction)

Sec. 1901. In "Type II Buildings" the structural frame shall be of structural steel or iron which shall be fire-protected, of reinforced concrete, of masonry or of heavy timbers, provided, that in buildings not exceeding one story and sixty-five feet (65') in height the structural steel or iron may have the fire-protection omitted. Exterior walls shall be of fire-resistive construction. Inner court walls shall be of incombustible materials or protected solid wood. Roof construction shall be of wood, or incombustible materials. Floors and non-bearing partitions shall be of wood or incombustible materials.

Definition

Sec. 1902. Type II buildings shall not exceed a height of seventy-five feet (75') in which height there shall be not more than seven stories; provided, that the height of a building erected on sloping ground may be not to exceed seventy-five feet (75') plus a vertical distance equal to the vertical change in slope along the length of any side of such building but in no case shall such height exceed eighty-five feet (85') above the adjacent finished ground level; provided, further, that no one-story building shall exceed a height of sixty-five feet (65').

Height Allowable

Towers, spires and steeples erected as a part of the building and not used for habitation or storage may extend not to exceed twenty feet (20') above such height limit.

Sec. 1903. The floor area of Type II buildings shall be limited according to occupancy as required in Part III of this Code.

Area Allowable

Sec. 1904. Footings shall be of solid masonry as set forth in Chapter 24 or of reinforced concrete as set forth in Chapter 26, and shall be designed as set forth in Section 2311 and Chapter 28. Foundation walls shall be of masonry or reinforced concrete as set forth in Chapter 29.

Foundations

Sec. 1905. Exterior walls of masonry or reinforced concrete as set forth in Chapter 29 shall be provided, and shall be of not less than four-hour fire-resistive construction as set forth in Section 4302, except that walls fronting on streets having a width of at least fifty feet (50') in Fire Zone No. 1 or thirty feet (30') in Fire Zones No. 2 and No. 3 may be of incombustible construction, with columns having not less than three-hour fire-resistive protection and beams and girders not less than two-hour fire-resistive protection as set forth in Chapter 43.

Exterior and Inner Court Walls

All walls within five feet (5') of adjacent property lines (excepting property lines abutting a street or an alley) and all walls within ten feet (10') of other buildings on the same property shall be provided with a parapet wall at least thirty inches (30") high above the roof at all points, provided that parapet walls need not be constructed on buildings twenty feet (20') or less in height or where the roof slopes more than 20 degrees from the horizontal back from the exterior wall of such building.

Inner court walls shall be constructed the same as exterior walls or shall be of not less than four-inch solid wood laminated

construction protected on the weather side thereof by incombustible fire-resistive materials as provided in Section 4202.

Partitions

Sec. 1906. Interior partitions shall be of one-hour fire-resistive construction as specified in Section 4302 or may be of solid wood construction formed of two layers of one-inch (1") nominal matched boards or of two-inch (2") nominal tongued and grooved wood planking or of solid wood laminated construction not less than three and five-eighths inches (3 $\frac{5}{8}$ ") thick.

Where wood partitions abut or adjoin masonry walls they shall be tied as required in Section 2518.

Temporary partitions as specified in Section 1806 may be used.

Enclosure of Vertical Openings

Sec. 1907. Enclosures for elevator shafts, vent shafts, stair wells and other vertical openings shall be of two-hour fire-resistive construction as specified in Chapters 30 and 43; provided, that in buildings not more than three stories in height which are completely sprinklered as specified in Chapter 38 such enclosure walls may be of any construction permitted for interior partitions.

A parapet wall or hand rail at least thirty inches (30") in height above the roof shall be provided around all open shaft enclosures extending through the roof.

Structural Framework

Sec. 1908. The structural frame shall be as specified in Chapter 26 for reinforced concrete, Chapter 27 for structural steel and Chapter 25 for solid wood.

All wood columns in such structural frame shall be directly superimposed, one above the other, (no girders or bolsters between columns) and shall be provided with steel or cast iron caps or pintles which shall be self-releasing wherever any horizontal members are framed into such columns. No wood column shall be less than eight inches (8") nominal in its least dimension and no beam, girder or joist shall be less than six inches (6") nominal in its least dimension nor less than forty-eight square inches (48 sq. in.) nominal in cross-sectional area. In no case shall masonry or reinforced concrete be supported on wood construction, except tile or concrete floor finishes not more than three inches (3") in thickness.

Fire-protection of Structural Members

Sec. 1909. (a) Structural Steel or Iron Members. All structural steel or iron members (not including frames and structural members for elevators and elevator enclosures) shall be thoroughly fire-protected. Such fire-protection shall be of three-hour fire-resistive protection for columns, and two-hour fire-resistive protection for beams, girders and floor systems, and all fire-protection shall be determined as specified in Chapter 43; provided, that such fire-protection may be omitted when the building does not exceed a height of one story and sixty-five feet (65').

Exceptions: 1. The thickness of the fire-protection on the outer edge of lugs or brackets on columns may be reduced to not less than one inch (1").

2. The masonry over window openings may be supported

by a steel plate, angle or similar member which is not fire-protected on the under side, provided the member is supported at proper intervals from a structural beam or girder which is fire-protected on all sides. For openings in masonry bearing walls not exceeding four feet (4') in width, an angle or similar member supported by masonry and not fire-protected on the under side may be used.

3. Where the structural steel framework of the roof of a Group A, B, or C occupancy is not less than twenty-five feet (25') above any floor, balcony or gallery, fire-protection of all members of the roof construction may be omitted.

4. Where the structural steel framework of the roof of a Group A, B or C occupancy is more than eighteen feet (18') and less than twenty-five feet (25') above any floor, balcony or gallery, the roof construction shall be protected by a suspended ceiling of not less than two-hour fire-resistive construction as specified in Chapter 43, and such ceiling shall be not less than six inches (6") distant from any part of such roof construction.

(b) **Wood Structural Members.** Wood structural members shall not be required to be fire-protected.

(c) **Reinforced Concrete Members.** All reinforced concrete columns shall be thoroughly fire-protected with not less than three-hour fire-resistive protection and all joists, beams, girders and slabs shall be thoroughly fire-protected with not less than two-hour fire-resistive protection outside of all steel reinforcing as specified in Section 4301.

Sec. 1910. Floor construction shall be as required for Type I buildings or shall be of one of the types noted below:

Floor Construction

1. Floor construction shall be of tongued and grooved or splined lumber not less than three inches (3") nominal thickness with a top layer of flooring of one inch (1") nominal thickness laid thereon.

2. Construction of solid lumber placed on edge and securely spiked together to make a floor not less than four inches (4") nominal thickness.

If such floor is six inches (6") nominal or more in thickness the lumber shall be air seasoned or kiln dried.

A space of one-half inch ($\frac{1}{2}$ ") shall be required between all floor construction and the wall which it adjoins, to allow for swelling in case the floor becomes wet. This space shall be properly covered by a molding so arranged that it will not interfere with the swelling and shrinking movements of the flooring.

Wood joists, beams and girders supported by masonry walls shall be anchored thereto as required in Chapter 25. Ventilation shall be provided between the ground and a wood floor as required in Section 2527.

The timbers and planking shall be self-releasing at end support on walls and no planking or timber shall extend through or across any party or occupancy separation walls.

Sec. 1911. Roof construction shall be as required for floor construction in Section 1910 except that the minimum allowable thickness of sheathing shall be not less than two and one-half inches ($2\frac{1}{2}$ ").

Roof Construction

Sections 1911-1916

Attic or roof spaces shall be divided into areas not exceeding twenty-five hundred square feet (2500 sq. ft.) as specified in Section 3205.

Roof covering shall be a "Fire-Retardant" roofing as specified in Section 4305 and shall be required over all combustible roof construction.

Stair Construc- tion

Sec. 1912. Stair construction may be of wood in buildings not exceeding three stories in height.

In buildings four or more stories in height all stairs and stair construction shall be as required for Type I buildings.

All stairs and exits shall be designed and constructed as specified in Chapter 33 and as required under Occupancy in Part III.

Doors and Windows

Sec. 1913. Doors, windows and other openings in the exterior walls shall be protected by one-hour fire-resistive construction as specified in Section 4304.

Exceptions:

1. The provisions of this Section shall not apply to doors, windows and other openings which face directly upon the opposite side of a public street, and are not within fifty feet (50') of the opposite side of a public street in Fire Zone No. 1, or are not within thirty feet (30') of the opposite side of a public street in Fire Zones No. 2 and 3. This distance shall be measured at right angles to the plane of the wall in which such openings occur.

2. The provisions of the first paragraph of this section shall not apply to openings in an outer court twenty feet (20') or more in width parallel to and facing upon a street or public place, provided such openings are not within twenty feet (20') of an adjacent property line.

Projections from the Building

Sec. 1914. Bays, oriels and similar projections shall be constructed of incombustible materials with walls, floors and roofs as specified in this Chapter and in Chapter 35.

Porches and exterior balconies shall be constructed of incombustible materials but structural steel or iron members need not be fire-protected; provided, that loading platforms for warehouses, freight depots and other similar buildings may be of heavy timber construction with wood floors not less than one and five-eighths inches (1 $\frac{5}{8}$ ") thick. Such wood construction shall not be carried through the exterior walls of any Type II building.

Cornices, marquees and similar appendages which are a part of a Type II building shall be constructed of substantial incombustible materials and as specified in Chapter 45.

Penthouses and Sky- lights

Sec. 1915. Penthouses shall be as required for Type I construction or shall be constructed with two-hour fire-resistive combustible materials and as required in Chapter 45.

Skylights shall be of one-hour fire-resistive construction as specified in Chapters 34 and 43.

Combustible Materials Regulated

Sec. 1916. No wood lath or wood furring shall be allowed in any building of Type II construction, but unprotected steel or iron or wood will be allowed in the following places:

Section 1916

1. Mezzanine floors may be of wood or unprotected steel, provided that there shall be not more than two such mezzanines in any room of any building, and provided, further, that no such mezzanine floor or floors shall cover more than $33\frac{1}{2}$ per cent of the area in the room where located.

2. Show window frames and aprons, also show cases and other appurtenances on the first floors of stores and other similar buildings may be of wood, with or without unprotected steel or iron.

3. Trim, hand rails, show window backing and temporary partitions as specified in Section 1906, picture molds, chair rails and wainscoting or baseboards may be of wood. Wood doors may be used, except in stair, elevator and other shaft enclosures, or where not specifically prohibited under Occupancy in Part III.

CHAPTER 20 — TYPE III BUILDINGS

(Ordinary Masonry)

Definition

Sec. 2001. In "Type III Buildings," the interior load bearing construction may be masonry or reinforced concrete walls or a structural frame of steel, reinforced concrete or wood. Exterior walls shall be of fire-resistive materials. Partitions, floors and roof framing may be of wood.

Height Allowable

Sec. 2002. Type III buildings shall not exceed a height of fifty-five feet (55') in which height there shall be not more than five stories; provided, that the height of a building erected on sloping ground may be fifty-five feet (55') plus a vertical distance equal to the vertical change in slope along and in the length of any side of such building, but in no case shall such height exceed sixty-five feet (65') above the adjacent finished ground level; and provided, further, that towers, spires and steeples erected as a part of such building and not used for habitation or storage may extend not to exceed fifteen feet (15') above such height limit.

Area Allowable

Sec. 2003. The floor area of Type III buildings shall be limited according to Occupancy as required in Part III.

Foundations

Sec. 2004. Footings shall be of solid masonry as set forth in Chapter 24 or of reinforced concrete as set forth in Chapter 26, and shall be designed as set forth in Section 2311 and Chapter 28. Foundation walls shall be of masonry or reinforced concrete as set forth in Chapter 29.

Exterior Walls and Inner Court Walls

Sec. 2005. Exterior walls of masonry or reinforced concrete as specified in Chapter 29 shall be provided, and shall be not less than four-hour fire-resistive construction as specified in Section 4302, except that walls fronting on streets having a width of at least fifty feet (50') in Fire Zone No. 1 or thirty feet (30') in Fire Zones No. 2 and No. 3 may be of incombustible construction with all structural members having not less than one-hour fire-resistive protection, as specified in Chapter 43.

All walls within five feet (5') of adjacent property lines (except property lines abutting a street or alley) and all walls within ten feet (10') of other buildings on the same property shall be provided with parapet walls at least thirty inches (30") high above the roof at all points; provided, that parapet walls need not be constructed on buildings twenty feet (20') or less in height or where the roof slopes more than 20 degrees from the horizontal back from the exterior wall of such building.

Inner court walls and all other walls not forming the exterior walls of the building may be constructed as required for Type I or Type II buildings, or shall be of not less than one-hour fire-resistive construction as specified in Chapter 43.

Partitions

Sec. 2006. Partitions of wood shall be constructed as required in Chapter 25. In buildings of four stories or more in height all partitions shall be of one-hour fire-resistive construction as specified in Section 4302. Bearing partitions, when constructed of wood, shall not support more than two stories and a roof.

Temporary partitions as set forth in Section 1806 may be used.

Sections 2007-2012

Sec. 2007. Enclosures for elevator shafts, vent shafts, stair wells and other vertical openings when required because of Occupancy in Part III shall be of one-hour fire-resistive construction as specified in Chapters 30 and 43.

**Enclosure
of
Vertical
Openings**

A parapet wall or hand rail at least thirty inches (30") in height above the roof shall be provided around all open shaft enclosures extending through the roof.

Sec. 2008. Structural framework shall be of steel, iron, reinforced concrete, masonry or wood and shall be designed and erected as specified in Chapter 26 for reinforced concrete, Chapter 27 for steel and iron, Chapters 22 and 25 for wood and Chapters 24 and 29 for masonry.

**Structural
Frame-
work**

Sec. 2009. Fire-protection of steel, iron, or wood structural members may be omitted unless otherwise provided, because of location as in Part IV or occupancy as in Part III, or as required in this chapter.

**Fire
Protection of
Structural
Members**

All members carrying masonry in buildings over one story in height shall be fire-protected with not less than one-hour fire-protection. Bottom flanges of exterior lintels need not be fire-protected.

Sec. 2010. Floors may be constructed as specified in Chapter 26 for reinforced concrete, Chapter 24 for masonry, Chapter 25 for wood, and Chapter 27 for steel or iron.

**Floor Con-
struction**

In buildings of four stories or more in height the lower side of all metal or wood floor or roof construction shall be entirely protected by a ceiling of one-hour fire-resistive construction as required in Chapter 43.

In all buildings having a usable space under the first floor, except Groups I and J occupancies, the underside of such floor construction when of metal or wood shall be protected by a ceiling of one-hour fire-resistive construction as set forth in Chapter 43.

Wood joists, beams and girders supported by masonry walls shall be anchored thereto as required in Section 2518. Ventilation shall be provided between the ground and a wood floor as required in Section 2527.

Sec. 2011. Roof construction shall be of any Type of Construction permitted for floors except in buildings four stories or more in height as specified in Section 2010 and except where otherwise required because of Occupancy in Part III.

**Roof Con-
struction**

Wood rafters, joists, purlins, beams and girders supported by masonry walls shall be anchored thereto as required in Chapter 25.

Attic or roof spaces shall be divided into areas not exceeding twenty-five hundred square feet (2500 sq. ft.) as required in Section 3205.

Roof covering shall be a "Fire-Retardant" roofing as specified in Section 4305.

Sec. 2012. Stairs may be of steel, iron, reinforced concrete, masonry or wood and shall be designed and constructed as specified in Chapter 33, and as required under Occupancy in Part III.

**Stair Con-
struction**

Sections 2013-2016

Doors and Windows

Sec. 2013. Doors, windows and other openings in exterior walls may be of wood or of plain glass and wood sash unless otherwise required under Occupancy in Part III or Location in Part IV.

Projections from the Building

Sec. 2014. Bays, oriel and similar projections shall be constructed of incombustible materials with walls, floors and roof as required in this Chapter and in Chapter 35.

Porches and exterior balconies shall be constructed of incombustible materials but structural steel or iron members need not be fire-protected; provided that loading platforms for warehouses, freight depots and similar buildings may be of heavy timber construction with wood floors not less than one and five-eighths inches (1 $\frac{5}{8}$ ") thick. Such wood construction shall not be carried through the exterior walls of any Type III building.

Cornices, marquees and similar appendages which are a part of a Type III building shall be constructed of substantial incombustible materials and as required in Chapter 45.

Penthouses and Sky- lights

Sec. 2015. Penthouses and other roof structures shall be of not less than one-hour fire-resistive construction as specified in Chapters 36 and 43.

Skylights shall be of not less than one-hour fire-resistive construction as specified in Chapters 34 and 43.

Combustible Materials Regulated

Sec. 2016. Wood shall be permitted in a building of Type III Construction except where specifically prohibited under Occupancy in Part III or Location in Part IV.

No enclosed air space in any vertical wood framing shall have any dimension greater than seven feet (7').

Combustible insulating materials may be placed in the partition, floor or roof framing but shall in no way interfere with the fire blocking or fire separations required by this Code.

CHAPTER 21 — TYPE IV BUILDINGS

(Light Incombustible Frame)

Sec. 2101. In "Type IV Buildings" the structural framework shall be of steel, iron, masonry or reinforced concrete and exterior walls shall be of incombustible materials. Partitions, floors and roof construction shall be of incombustible materials except as set forth in this chapter. Foundations shall be of masonry or reinforced concrete. **Definition**

Sec. 2102. Type IV Buildings shall not exceed a height of forty-five feet (45') in which height there shall not be more than three stories; provided that the height of such building erected on sloping ground may be forty-five feet (45') plus a vertical distance equal to the vertical change in slope along and in the length of any side of such building but in no case shall such height exceed fifty-five feet (55') above the adjacent finished ground level. Towers, spires and steeples erected as a part of such building and not used for habitation or storage may extend not to exceed ten feet (10') above such height limit except that the height of such towers on Group G occupancies shall not be limited. **Height Allowable**

Sec. 2103. The floor area of a Type IV Building shall be limited as set forth under Occupancy in Part III and Location in Part IV. **Area Allowable**

Sec. 2104. Footings shall be of solid masonry as set forth in Chapter 24 or of reinforced concrete as set forth in Chapter 26, and shall be designed as set forth in Section 2311 and Chapter 28. Foundation walls shall be of masonry or reinforced concrete as specified in Chapter 29. **Foundations**

Sec. 2105. Exterior Walls. Exterior wall covering shall provide suitable protection from the elements and shall be of incombustible material of such thickness, strength and so anchored to the wall frame as to resist effectively wind and other forces that may be applied to it. Wall coverings may be considered a structural part of the structural frame if designed and constructed to act integrally therewith. **Exterior Walls**

Studs or other similar vertical supports shall in no case be spaced more than four feet (4') on centers. All openings wider than the regular stud spacing in the wall shall be trussed or provided with lintels with proper end support, provided that where no studs are used the structural frame shall be designed in accordance with Chapter 24, Chapter 26 or Chapter 27. All walls shall be thoroughly and effectively braced; and effectively fire-stopped at all floor and ceiling levels with incombustible materials. All steel studs shall be designed in accordance with Chapter 27.

All roof and floor loads shall be transmitted to the steel studs or other supporting members, either directly or by means of a load distributing member. Maximum wall height between horizontal supports perpendicular to bearing walls shall not exceed forty-five (45) times the structural thickness of the wall.

Exterior wall construction in Type IV Buildings more than one story in height, except for Group I occupancy, shall be of not less than one-hour fire-resistive construction.

Sections 2111-2116

Portland cement plaster not less than one and one-half inch ($1\frac{1}{2}$ ") in thickness reinforced in two directions with not less than three-tenths per cent of steel may be considered to act with the studs to resist bending and shear under horizontal forces when said reinforcement is anchored to the stud in such a manner as to resist effectively the stresses developed. The unit stresses for such reinforced plaster shall not be more than 50 per cent of those allowed for concrete beams in Table No. II, Section 2613, based on a compressive strength of such plaster of 1500 pounds per square inch.

Partitions

Sec. 2106. Bearing partitions shall be constructed as required for exterior walls. Interior non-bearing partitions shall be of incombustible materials.

Enclosure of Vertical Openings

Sec. 2107. Enclosures for elevator shafts, stair wells and other vertical openings when required because of Occupancy in Part III shall be of incombustible one-hour fire-resistive construction as specified in Chapters 30 and 43.

A parapet wall or hand rail at least thirty inches (30") in height above a flat roof shall be provided around all open shaft enclosures extending through the roof.

Structural Framework

Sec. 2108. The structural framework shall be as specified in Chapter 27 for iron and steel, Chapters 24 and 29 for masonry and Chapter 26 for reinforced concrete.

Fire-Protection of Structural Members

Sec. 2109. All structural steel or iron members in buildings more than one story in height shall be thoroughly fire-protected with not less than one-hour fire-resistive protection except as follows:

Exceptions: 1. Bottom flanges of exterior lintels carrying masonry need not be fire-protected.

2. Steel studs, steel joists, cellular members and other steel members in walls, floors, ceilings and roofs need not be individually fire-protected.

3. Frames and members for elevators and elevator equipment need not be fire-protected.

For fire-protection of walls, partitions, floors and ceilings see Sections 2105, 2106, 2110 and 2111 respectively.

Floor Construction

Sec. 2110. Floor construction shall be of incombustible material, provided, however, that wood flooring may be used.

Floor construction over usable spaces except in Group I occupancies, shall have the underside thereof protected with a ceiling of metal lath and three-fourths inch ($\frac{3}{4}$ ") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Roof Construction

Sec. 2111. Roof construction may be of any type of construction permitted by this code.

Roof construction in buildings more than one story in height, except for Group I occupancy, shall be protected with a ceiling of metal lath and three-fourths inch ($\frac{3}{4}$ ") gypsum or portland cement plaster or its equivalent in fire-resistiveness.

Roof covering shall be a "Fire Retardant" roofing as specified in Section 4305.

Sections 2112-2115

Sec. 2112. Stairs shall be of any type permitted by this code and shall comply with the requirements of Chapter 33, and shall be fire-protected as required for floors in this Chapter. **Stair Construction**

Sec. 2113. Doors, windows and other openings in exterior walls may be of any type permitted by this code, unless otherwise required under Occupancy in Part III, and Fire Zones in Part IV. **Doors and Windows**

Sec. 2114. Porches, cornices, marquees, canopies and all other similar projections from the building shall be of incombustible materials, except that a loading platform not including the roof or roof structure thereof, may be constructed of wood as specified in Section 1914. **Projections from the Building**

Sec. 2115. Penthouses and other roof structures shall be constructed as required for any story above the first floor. Skylights shall be constructed as required in Chapter 34. **Penthouses and Skylights**

CHAPTER 22 — TYPE V BUILDINGS

(Wood Frame)

Definition

Sec. 2201. In "Type V Buildings," enclosing walls, interior walls, partitions, floors and roofs shall be of wood as specified in Chapter 25 or of wood in combination with other materials except where prohibited as specified under Occupancy in Part III. Any building which cannot be classed as Type I, II, III or IV construction shall be considered to be of Type V.

Height Allowable

Sec. 2202. Type V buildings shall not exceed a height of thirty-eight feet (38') in which height there shall be not more than three stories; provided that the height of a building erected on sloping ground may be thirty-eight feet (38') plus a vertical distance equal to the vertical change in slope along and in the length of any side of such building but in no case shall such height exceed forty-five feet (45') above the adjacent finished ground level; provided, further, that spires, towers or steeples erected as a part of such building and not used for habitation or storage may extend not to exceed ten feet (10') above such height limit.

Area Allowable

Sec. 2203. The maximum floor area allowable for a Type V building shall in no case exceed that specified under Occupancy in Part III or Location in Part IV.

Foundations

Sec. 2204. All exterior walls and interior bearing walls of type V buildings shall be supported on continuous solid masonry or reinforced concrete footings which shall be of sufficient size to support safely the loads imposed as determined from the character of the soil. Masonry foundation walls shall extend at least six inches (6") above the finished grade adjacent to the wall at all points. Mudsills shall be bolted to the foundation or foundation wall with not less than one-half inch ($\frac{1}{2}$ ") bolts, embedded at least seven inches (7") into the masonry and spaced not more than six feet (6') apart. (See appendix for table of minimum foundation requirements for Type V buildings.)

All mudsills shall be all-heart cedar, all-heart cypress or Foundation Grade redwood, or any species of wood if treated under pressure with an approved preservative.

Foundations for all buildings where the surface of the ground slopes more than one foot (1') in ten feet (10') shall be level or shall be stepped so that both top and bottom of such foundation are level.

Foundation walls and all other walls used as retaining walls in connection with Type V buildings shall be not less than eight inches (8") in thickness. All such walls shall be designed for the loads specified in Section 2310.

Foundations of Type V Buildings may be of piles, constructed as provided in Chapter 28.

Exceptions: 1. Interior bearing walls in one-story buildings may be supported on piers.

2. For Type V buildings, (except Group H and I occupancies) isolated piers of solid masonry or reinforced concrete may be used for post and girder construction.

Sections 2204-2205

3. A one-story building (except a Group I occupancy) which does not exceed four hundred square feet (400 sq. ft.) in area, including additions, may be constructed without a masonry or reinforced concrete foundation if the walls are supported on a wood mudsill.

Sec. 2205. Exterior walls of all Type V buildings having a floor area of four hundred square feet (400 sq. ft.) or more, including additions, shall be constructed with studding not less than two inches by four inches (2"x4") spaced not more than sixteen inches (16") on centers, or such walls may be constructed of not less than four inch by four inch (4"x4") posts spaced not more than five feet (5') on centers or of larger members designed as required in Chapter 25, or may be of post and beam framing with plank sheathing not less than one and one-half inches (1½") thick or may be of laminated construction not less than four inches (4") nominal in thickness with the structural assembly properly designed to support all loads.

**Exterior
Walls and
Wall Coverings**

Buildings two stories in height shall have walls constructed as specified above. Buildings three stories in height shall have the first story studs not less than two inches by six inches (2"x6") spaced not more than sixteen inches (16") on centers.

Underpinning shall be not less in size than the studding of the story above; provided, that all underpinning exceeding four feet (4') in height shall be not less in size than the studding required for an additional story. All such underpinning shall be effectively braced.

Where studs continue through more than one story, joists shall be nailed securely to the studs and shall be supported upon a one inch by four inch (1"x4") ribbon notched into the studs and securely nailed thereto, or by other means affording equivalent strength and rigidity. Where stories are framed separately, each tier of studding shall have top and bottom plates and the top plates shall be doubled and lapped at all corners and intersections. Laps in separate pieces of the top plate shall be staggered not less than four feet (4').

All exterior walls and partitions shall be thoroughly and effectively braced.

Maximum allowable height of two inch by four inch (2"x4") stud framing shall be fourteen feet (14') and of two inch by six inch (2"x6") stud framing shall be twenty feet (20') unless the wall is supported laterally by adequate framing in a horizontal direction, perpendicular to the direction of the stud wall.

All walls shall be fire-stopped effectively as required in Section 2526.

All openings four feet (4') wide or less shall be provided with double headers not less than two inches (2") thick placed on edge, and such headers shall have two inch (2") solid bearing to the floor or bottom plate. All openings more than four feet (4') wide shall be trussed or provided with lintels which shall have not less than two inch (2") solid bearing to the floor or bottom plate.

Ventilating openings under first floor joists shall be provided as required in Section 2527.

Section 2205

Exterior Walls and Wall Coverings (Con't)

A wood mudsill, not less than two inches (2") thick and not less in width than the wall framing supported thereon, and of the quality required in Section 2204 shall be placed under all wood frame walls or partitions directly supported by masonry or reinforced concrete foundations.

Sheathing where required for exterior walls shall be applied solidly over the wall surface and shall be one or more of the following materials:

Wood not less than five-eighths inch ($\frac{5}{8}$ ") thick.

Approved fiber board not less than seven-sixteenths inch ($\frac{7}{16}$ ") thick.

Approved gypsum sheathing not less than one-half inch ($\frac{1}{2}$ ") thick.

Approved plywood not less than five-sixteenths inch ($\frac{5}{16}$ ") thick.

All Type V buildings three stories in height shall have the exterior walls covered with a solid sheathing as set forth in this section.

All exterior walls shall be covered on the outside with weatherboarding, shingles, stucco, masonry veneer or galvanized metal as specified in this section or by other similar approved materials, provided that one-story buildings having a total floor area of not more than four hundred square feet (400 sq. ft.) may have exterior walls of vertical one inch (1") boards and battens without studs.

The minimum requirements for wall coverings for Type V buildings are as specified in parts (a), (b), (c), (d), and (e) of this Section.

(a) **Weatherboarding.** Studs shall be covered on the outside face with one layer of approved waterproofed building paper applied and tacked shingle fashion with joints horizontal. Horizontal joints of the paper shall be lapped at least two inches (2") and perpendicular joints at least six inches (6"). Weatherboarding, when in place, shall have an average thickness of not less than five-eighths inch ($\frac{5}{8}$ ") and a minimum thickness of not less than three-eighths inch ($\frac{3}{8}$ "). Such weatherboarding shall be placed over the paper and shall be securely nailed to the studding with not less than two nails to each stud in each piece of such weatherboarding. Horizontal joints in the weatherboarding shall be tongued and grooved or shiplapped joints, or such weatherboarding shall be laid shingle fashion and lapped not less than one-half inch ($\frac{1}{2}$ "). Building paper may be omitted where the interior face of the studs is not covered or where there is no human occupancy. Siding patterns known as rustic, drop siding or shi lap shall have an average thickness in place of not less than nineteen thirty-seconds inch ($\frac{19}{32}$ ") and a minimum thickness of not less than three-eighths inch ($\frac{3}{8}$ "). Bevel siding shall have a minimum thickness measured at the butt section of not less than twenty-one thirty-seconds inch ($\frac{21}{32}$ ") and a tip thickness of not less than one-quarter inch ($\frac{1}{4}$ "). Siding of lesser dimensions may be used, provided the outside face of the stud is first covered with sheathing as provided in this section.

(b) **Shingles or Shakes.** Shingles or shakes may be used for the exterior wall covering when applied as follows: The

outside face of the studs shall be first sheathed with boards of uniform thickness not less than twenty-five thirty-seconds inch ($\frac{5}{16}$ ") thick and such sheathing shall be securely nailed to the studding with not less than two eightpenny common nails to each stud in each piece of sheathing eight inches (8") or less in width and not less than three such nails when such sheathing boards exceed eight inches (8") in width. In all cases, except where the building is not intended for human occupancy, or where the interior face of the studs is not covered, an approved waterproof building paper shall be applied directly over the outer face of the sheathing in the same manner as specified in Subsection (a) of this Section. Shingles or shakes shall be nailed securely to the wall sheathing with at least two nails in each piece.

**Exterior
Walls and
Wall Cov-
erings
(Con't)**

(c) **Stucco.** Stucco may be applied with or without sheathing or similar backing.

In all cases except in back-plastered construction an approved waterproof paper or asphalt saturated felt weighing not less than fourteen pounds per one hundred square feet (100 sq. ft.) or any substantial waterproof paper which successfully passes a 60-pound Mullen test shall be applied weatherboard fashion directly over the studs or sheathing. Horizontal joints shall be lapped not less than two inches (2") and vertical joints not less than six inches (6"). Where sheathing or similar backing is not used an 18 W. & M. gauge wire stretched taut horizontally across the stud frame at not more than six inch (6") centers shall be securely fastened in place before the paper or felt is applied; provided, that where such paper or felt is fastened to the metal reinforcing in such a manner as not to affect the waterproof qualities of such paper or felt the wire need not be installed. Skeleton sheathing shall be of boards not less than four inches (4") wide, spaced not to exceed four inches (4") apart.

In all cases a metal reinforcement of either expanded metal or wire fabric shall be used as follows:

1. Expanded metal cut from sheets not less than 20 U. S. gauge in thickness with mesh not less than three-fourths inch ($\frac{3}{4}$ ") in least dimension, nor more than four inches (4") in greatest dimension and not exceeding six square inches (6 sq. in.) in area; the fabric shall weigh not less than one and eight-tenths pounds per square yard.

2. Wire fabric composed of wires with no openings or mesh therein less than three-fourths inch ($\frac{3}{4}$ ") nor greater than two inches (2"). The minimum allowable gauge of the wire for the various meshes shall be as follows:

For openings not exceeding 1 inch—18 W. & M. Gauge.

For openings not exceeding 2 inches—16 W. & M. Gauge.

3. Expanded metal lath weighing not less than three pounds per square yard.

4. Electrically welded wire of 16 W. & M. gauge with openings not exceeding two inches (2") in greatest dimension and not exceeding four square inches (4 sq. in.) in area.

Metal reinforcing shall be securely fixed in place using a furring device that will positively fur the metal reinforcing at least one-fourth inch ($\frac{1}{4}$ ") from the studs, sheathing or other

Section 2205

**Exterior
Walls and
Wall Coverings
(Con't)**

backing. No form of strips or metal rods shall be used for furring which will serve to weaken the stucco. Metal reinforcing shall be secured with not less than fourpenny nails driven to at least three-fourths inch ($\frac{3}{4}$ ") penetration in the studs or sheathing. Nails and furring devices shall be not more than six inches (6") apart vertically. Horizontal and vertical joints of the metal reinforcing shall be lapped at least one full mesh. All horizontal joints between studding shall have not less than one tie with number 18 annealed tie wire, except when building is sheathed, and all vertical joints shall be made at the studs when attached directly thereto.

Stucco shall consist of three coats: (1) First or scratch coat, (2) Second or brown coat, (3) Finish coat. The total thickness of the three coats shall be not less than seven-eighths inch ($\frac{7}{8}$ ") at every point. No one coat of stucco shall be less than one-fourth inch ($\frac{1}{4}$ ") thick, except the finish coat, which shall be not less than one-eighth inch ($\frac{1}{8}$ ") in thickness at any point.

The stucco shall be of portland cement and sand as specified in Chapter 26, with an addition of not more than 10 per cent of hydrated lime or similar material based on volume of cement in either the scratch coat or brown coat and with not more than 33 $\frac{1}{4}$ per cent of hydrated lime or similar material based on volume of cement in the finish coat.

The first or scratch coat of stucco shall be shoved thoroughly through the metal reinforcing until all space between the metal and the backing is filled solidly and such coat shall be kept thoroughly moist during the first 24 hours after being applied. The brown coat shall be kept thoroughly moist during the first twenty-four hours after being applied and at least seven days shall elapse between the application of the scratch coat and the brown coat, except when an approved high-early-strength cement is used, when at least 48 hours shall elapse between the application of the scratch coat and brown coat.

The above requirements shall not apply to stucco placed on masonry backing. Before applying stucco on any masonry backing such backing shall be thoroughly washed and cleaned. (For complete plastering provisions see Appendix. Refer to Chapter 47.)

Gunitite, as defined in Chapter 26, shall be applied in not less than two coats, and shall be reinforced as specified for "Stucco" in this Section. Gunitite shall be not less than three-fourths inch ($\frac{3}{4}$ ") in thickness on one or two-story buildings and not less than one inch (1") in thickness on three-story buildings.

(d) **Masonry Veneer.** Masonry veneer on wood frame construction shall be not less than two inches (2") thick for one-story only, and not less than three and three-fourths inches (3 $\frac{3}{4}$ ") thick for more than one-story. The masonry shall be bonded to the studs by means of 30d large head nails driven to a two-inch (2") penetration not more than twelve inches (12") on center vertically nor more than sixteen inches (16") on center horizontally. Corrugated metal clips and other forms of ties are prohibited unless approved by the Building Inspector. Such veneer shall not be permitted above two stories, except for

gables. The veneer shall be supported directly on the foundation.

In all cases before applying masonry veneer an approved waterproof paper or asphalt-saturated felt weighing not less than 14 pounds per one hundred square feet (100 sq. ft.) shall be applied weatherboard fashion directly over the studs, sheathing or backing as specified for "Stucco" under part (c) of this Section, except that no wire need be stretched back of such paper.

(e) **Galvanized Iron.** Galvanized iron not less than 28 gauge may be used on stud walls without sheathing. Walls shall be effectively braced and nailing strips shall be placed in such manner as to permit the metal to be nailed at vertical intervals of not more than four feet (4').

Sec. 2206. Interior partitions may be of any material permitted for exterior walls in this Code. If of wood, interior partitions shall be constructed, framed and firestopped as required for exterior walls as specified in Chapter 25, except that interior non-bearing partitions may have a single top plate, and except that where non-bearing partitions are approximately parallel and not more than four feet (4') apart, two-inch by three-inch (2"x3") studs sixteen inches (16") on centers, may be used.

Interior Partitions

Section 2207. Enclosure walls for elevator shafts, vent shafts, stair wells and similar vertical openings through a building shall be of not less than one-hour fire-resistive construction as specified in Chapters 30 and 43 and where required under Occupancy in Part III, except that chutes and dumb-waiter shafts with a cross sectional area of not more than nine square feet (9 sq. ft.) may be lined with approved incombustible materials covered with not less than 26 U. S. gauge sheet metal with all joints in such sheet metal lock-lapped. All openings into any such vertical enclosures shall be protected by metal or metal-clad doors with either metal or metal-clad jambs, casings or frames.

Enclosure of Vertical Openings

Sec. 2208. Structural framework may be of any type of construction permitted in this code.

Structural Framework

Sec. 2209. Fire-protection of structural framework shall not be required except as provided under Occupancy in Part III.

Fire-Protection of Structural Members

Sec. 2210. Floors may be of any type of construction permitted in this code.

Floor Construction

Sec. 2211. Roof construction may be of any type of construction permitted in this code. When roof construction is of wood it shall conform to the requirements of Chapter 25.

Roof and Ceiling Construction

Attic or roof spaces shall be divided into areas not exceeding twenty-five hundred square feet (2500 sq. ft.) as required in Section 3205.

Roof covering shall be a "Fire Retardant" roofing, except that for Groups H, I and J occupancies, an ordinary roofing may be used as specified in Section 4305. Wherever a composition roofing is used, the roof construction shall be solidly

Sections 2212-2216

sheathed with wood, sheathing to be not less than twenty-five thirty-seconds inch ($\frac{5}{16}$ ") thick.

Stair Construction Sec. 2212. Stair construction may be of any type permitted in this code and shall conform to the requirements of Chapter 33.

Doors and Windows Sec. 2213. Doors and windows may be of any type permitted in this code.

Projections from Building Sec. 2214. Any projections from the building shall conform to the requirements for exterior walls, as required in Chapter 45.

Penthouses and Skylights Sec. 2215. Penthouses and skylights may be of any material permitted in Chapters 34 and 36 of this Code.

Combustible Materials Regulated Sec. 2216. Combustible insulating materials may be used in any part of the building but shall not be installed in such a manner as to interfere with the firestopping elsewhere herein required.



*"Broadcasting"
your program of-*

SAFETY PLUS PERFORMANCE

The AGA Blue Star Seal is like a microphone that broadcasts to the Nation your own "program" for public welfare. ★ To merit this seal, gas equipment must pass the stringent requirements of the American Gas Association for construction, efficiency and safe operation. Testing is relentless, impartial, conducted with the finest scientific facilities. ★ Result: "AGA approved" is today a national symbol borne by over 95% of all gas appliances—your assurance that such equipment far exceeds your local strength-and-safety standards.

Visit the Pacific Coast AGA testing laboratories in Los Angeles. See how this rigid testing backs your inspection on the job.

THE PACIFIC COAST GAS ASSOCIATION


*(A non-profit service organization of which your
Gas Company is a member)*

447 SUTTER ST., SAN FRANCISCO

PALCO INSULATION WOOL

REG. U. S. PAT. OFF.

NOW
SAFERIZED
to make it
Flame-Proof

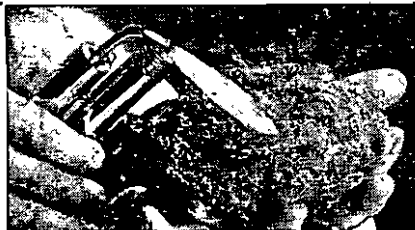

Blow torch tests show that when a sample of PALCO WOOL is held in the hand and the flame blown directly into it, no fire results when the torch is removed. ★ Insulation Manual and free sample sent on request.

THE PACIFIC LUMBER COMPANY
100 Bush Street San Francisco

FROM DURABLE REDWOOD BARK

FOR FIRE PROTECTION AND INSULATION



SCHUMACHER WALL BOARD CORPORATION

Concrete Making Architectural News

Architectural Expression

Many of today's buildings have new treatments of line and mass to express their purpose. Concrete gives the designer equal freedom in the development of flat surfaces and fitting decorative motifs. Decorative use of concrete has been perfected by the patience and skill of architectural and sculptural craftsmen.

Structural Adaptability

The successful use of concrete—whether for hidden girders or the severest exposure—is controlled by basic principles which, though exacting, are simple. Carefully observed, they permit the design of enduring buildings to meet every requirement, structural as well as architectural. For example: the rigid frame of hollow box-girder type, with 77-ft. span, used in the new auditorium of a school at Placentia, California.

And Now Beautiful Colors

Recent developments in the manufacture of colored aggregates and in concrete making technique have opened up a new vista of possibilities in the use of concrete for fadeless color effects.

The Portland Cement Association, through its own laboratories and cooperation with the engineering profession, is constantly striving to perfect and broaden the applications of concrete in the building arts. It is a SERVICE organization, supported by the manufacturers of Portland Cement. Its facilities are offered to building officials, architects and structural engineers.

PORTLAND CEMENT ASSOCIATION

DEPT. I 1-30 • 816 W. FIFTH STREET • LOS ANGELES, CALIFORNIA

Do You
Know

The 8 important ADVANTAGES = of =

STEELTYD·MASONRY

1 LIGHT·WEIGHT·SHALE·CLAY· Used in manufacturing contains about 20% Alumina, which lightens the units one to two pounds, according to size, thus reducing structural weight, affecting a saving in building costs.


2 CORRUGATIONS· Give added adhesion area, and form keys which lock the wall in all directions.

3 WIDE·VERTICAL·CENTER·JOINTS· Allow more grout completely housing vertical & horizontal steel.

4 RATT·FACE· Gives textured finish for outside walls, also provides bond for damp-proofing, plastering, and brush coat finishes.

5 STEEL·TIES· Add a 500 pound pull, locks the wall, acts as headers, and holds units in place during the pouring of grout.

6 PIER·BRICK· Permits steel to be placed within 25" of face of wall, thus giving a greater spread of column steel, permitting heavier loads and greater stresses on minimum size piers.

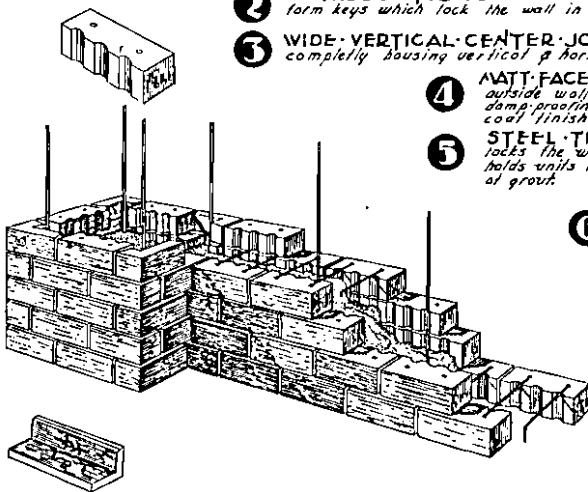

7 ANGLE·BRICK· Are designed for band beam and lintel construction. Permits reinforcing steel to be placed within 13" of face of wall, thus giving greater beam depth.

8 DAVIDSON·SPECIAL·UNITS· Are the only brick units used in combination that answer the engineering and architectural problems calling for durable, modern, reinforced brick masonry.

DAVIDSON·BRICK·COMPANY

· ANGELES 11178 ·

4701 FLORAL DRIVE ·

LOS ANGELES ·

EXPANDED AND SHEET

METAL LATH

FOR PROTECTION AGAINST FIRE, EARTHQUAKE,
HURRICANE, TERMITES AND VERMIN

The Metal Lath Manufacturers Association has, for your service, data on official test results on which you can rely in connection with the maintenance and enforcement of your building code.

The Association will welcome an opportunity to aid you with trustworthy information.

THE NEW PARTITION HANDBOOK

sent free to Building Officials,

Architects and Engineers.

Price, to others, One Dollar.



METAL LATH MANUFACTURERS ASSOCIATION

208 South LaSalle St.

Chicago, Illinois

PACIFIC COAST OFFICE: 816 WEST 5TH STREET, LOS ANGELES, CALIF.

SOUTH-EAST: 1102 NATIONAL PRESS BUILDING, WASHINGTON, D. C.

Trade Mark  of Quality

Approved by

**PACIFIC COAST BUILDING OFFICIALS
CONFERENCE
NATIONAL BOARD OF FIRE UNDERWRITERS**

PRODUCTS OF FRANK X. ENDERLE, INC., LTD.:

1. Enderle Vent and Flue Pipe
2. Enderle Cased Vent
3. Gravity Furnace Pipe and Fittings
4. Forced Air Furnace Pipe and Fittings.




*All products carry the traditional Enderle
guarantee of superior quality and
workmanship.*

Frank X. Enderle, Inc. Ltd.

1715 San Fernando Road (CA. 4141) Los Angeles, California

UNIFORM BUILDING CODE STANDARD

PACIFIC COAST BUILDING OFFICIALS' CONFERENCE

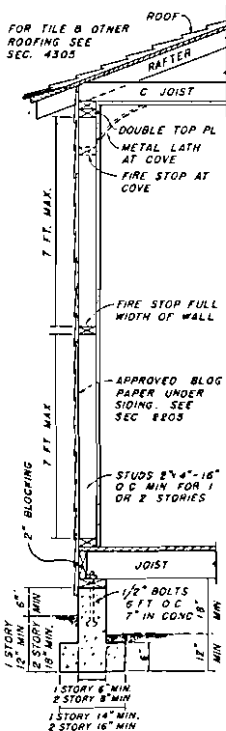

TYPICAL WALL SECTION

FOOTING MAY BE L OR L SHAPE WITH SAME DIMENSIONS


FOR DWELLINGS UNDER 400 SQ. FT. IN AREA SEE CHAPTER 22.

RAFTER & JOIST TABLE
SURFACED FOUR SIDES

MAXIMUM ALLOWABLE SPAN FOR DOUGLAS FIR


SIZE	SPACING	FLOOR JOISTS PLAS. CEIL. UNPLAS.	CEILING JOISTS	ROOF RAFTERS
2"x4"	12"		11' 0"	11' 8"
	16"		10' 0"	10' 1"
	24"		8' 11"	8' 4"
	32"		7' 10"	7' 2"
2"x6"	12"	10' 0"	12' 0"	16' 7"
	16"	9' 1"	10' 0"	15' 4"
	24"	8' 0"	8' 7"	13' 8"
	32"			12' 0"
2"x8"	12"	13' 0"	15' 11"	21' 8"
	16"	12' 1"	13' 11"	20' 2"
	24"	10' 8"	11' 5"	18' 0"
	32"			15' 10"
2"x10"	12"	16' 8"	19' 11"	26' 10"
	16"	15' 3"	17' 4"	25' 0"
	24"	13' 5"	14' 5"	22' 6"
	32"			21' 3"
2"x12"	12"	20' 1"	23' 11"	
	16"	18' 5"	20' 11"	
	24"	16' 2"	17' 5"	
	32"			

LIVE LOAD - FLOOR 40^{PSF}, ROOF 20^{PSF}

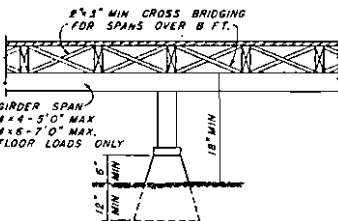

INTERIOR PIER FTG.

NOTES: FOUNDATION DIMENSIONS FROM APPENDIX.
MINIMUM GRADE OF FRAMING LUMBER:
2" COMMON FOR HORIZONTAL MEMBERS
2" COMMON FOR VERTICAL MEMBERS
2"x3" STUDS ONLY FOR INTERIOR NON-BEARING PARTITIONS WITHIN 4' OF OTHER PARTITIONS
SCREENED UNDER FLOOR VENTS, EXCEPT ON FRONT OF BLOC, MUST BE 2 SQ. FT. FOR EACH 25 LINEAR FT. OF WALL

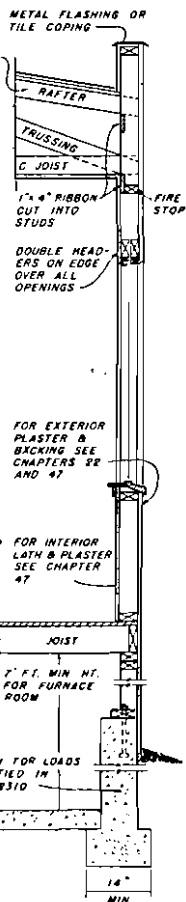

RETAINING WALL & BALLOON FRAMING

HOUSE DETAILS

MINIMUM REQUIREMENTS


DRAWN BY C. H. T.

FEBRUARY 3, 1941

ANDREWS VENTILATING WALL TYPE HEATERS

See This New Modernistic Design Front

Made in five sizes to fit any room. Adaptable to any type of building. Most economical to install and operate. Acknowledged superior for over fifteen years by Architects, Builders, Contractors and Users.




GOOD HEAT with GOOD HEALTH

The only wall heater that brings in fresh air while radiating pure odorless warmth for the room. This System Patented by us and used on all our heaters.

ANDREWS BALANCED-HEAT FLOOR FURNACE

With FINGER-TIP Gas Control — High, Medium, Low and Off. They are made in both floor type and single and dual wall types.

THE PICTURE BELOW SHOWS ANDREWS VENTILATING
CONCEALED WALL TYPE UNIT

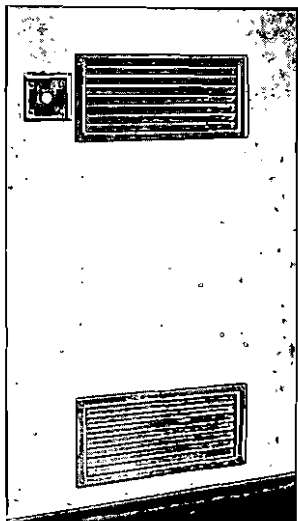

A NEW AND DIFFERENT HEATING UNIT

This furnace builds into the partition wall above the floor and is concealed by the plaster excepting for the grill at top and bottom. The same ventilating feature as used on our wall type heaters is used on this Unit. Vents through the roof.

Is a size and capacity to heat 5,000 cubic feet of space. Input rating 36,000 B. T. U.

Made in both single and dual type, Manual, Electric and Thermostatic Control.

Every heater equipped with ANDREWS Special Automatic Safety Pilot 100% Shutoff.

*All Andrews Heaters Passed by the
American Gas Association Testing
Laboratory*

ANDREWS HEATER CO.

2231 Market Street
HEmlock 2929
SAN FRANCISCO

1750 West Jefferson Blvd.
Parkway 9157
LOS ANGELES

FOR PERMANENT, ECONOMICAL, EASILY INSTALLED GAS VENTING . . .

Use Johns-Manville Transite Flue Pipe

Made of Asbestos fibres and Cement, Transite Flue Pipe is strong, durable and highly resistant to the destructive agencies that shorten the life of ordinary flue pipe. It successfully withstands the corrosive action of acids resulting from condensation of gases carried. Supplied in both round and oval form, Transite Flue Pipe is installed quickly—easily—by standard methods. When necessary, it may be cut on the job with an ordinary hand saw and a complete line of fittings is available to accommodate any unusual structural arrangement. For details write for free brochure.



Johns-Manville

San Francisco

Seattle

Los Angeles

CALWICO STUCCO NETTING

Pioneers in Stucco Reinforcement



Ease of application and proven performance are responsible for the demand for CALWICO quality Netting by Plasterers and Lathers.

THE CALIFORNIA WIRE CLOTH CORP.

Oakland

San Francisco

Los Angeles

Seattle

DISPLICO LIME

surpasses

FEDERAL and A. S. T. M. SPECIFICATIONS

LIME is an essential constituent of MASONRY MORTAR and GROUT. Its liberal use produces a mortar of high plasticity and bonding efficiency with low volume change subsequent to hardening. Insuring against the formation of mortar "pancakes" and consequent water penetration, efflorescence and low masonry strength.

LIME in MORTAR and PLASTER has stood the test of time and is available in higher quality today than ever before.

A DISPLICO product for every LIME requirement.

DIAMOND SPRINGS LIME COMPANY

DIAMOND SPRINGS, CALIFORNIA


Branch Offices:

San Francisco
2652 Harrison Street

Los Angeles
656 East 61st Street

For Better Roofs and Sidewalls...

Certigrade Red Cedar Shingles

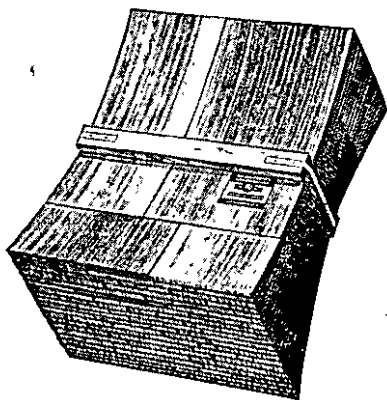

Uniform Building Code Recommended Application for Red Cedar Shingles:

ROOFS—See Section 4305 on Pages 274 and 275

SIDEWALLS—See Section 2205 on Pages 94 and 95



An interesting and valuable 100-page illustrated Handbook on Certigrade shingles will be mailed free on your request.


RED CEDAR SHINGLE BUREAU

**5508 White Building
Seattle, Washington**

**811 Metropolitan Bldg.
Vancouver, B. C.**

A GOOD BUILDING NEEDS

Good Lumber...

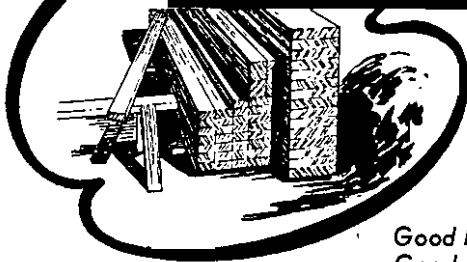

**... properly
joined and fast-
ened in place**

*Good Building Regulations
Good Materials
Good Design and Engineering
Good Workmanship*

Lumber joined with TECO TIMBER CONNECTORS is the modern material for engineering construction, bridges, trusses, roofs, towers, as proved by more than 18,000 structures already built.

Lumber is the economical and permanently available material for framing, and the exterior and interior of the home, business, industrial building, drawn from America's forever replenishable resource, the forests.

TECO TIMBER CONNECTORS are sponsored by the NATIONAL LUMBER MANUFACTURERS ASSOCIATION as a means of more efficient and economical lumber utilization in engineering structures.

For complete information write:

TIMBER ENGINEERING COMPANY

1337 CONNECTICUT AVENUE, N.W.
WASHINGTON, D. C.

Pacific Coast Distributors

TECO TIMBER CONNECTORS

Timber Engineering Company of California
85 SECOND STREET
SAN FRANCISCO, CALIF.



Index to Advertisers

	<i>Page</i>
<i>American Lumber and Treating Company</i>	<i>Third Cover</i>
<i>Andrews Heater Company</i>	106
<i>California Redwood Association</i>	1
<i>California Wire Cloth Corporation</i>	107
<i>Columbia Steel Company</i>	4
<i>Davidson Brick Company</i>	102
<i>Diamond Springs Lime Company</i>	108
<i>Douglas Fir Plywood Association</i>	113
<i>Frank X. Enderle Incorporated, Ltd.</i>	104
<i>Johns-Munville Sales Corporation</i>	107
<i>Metal Lath Manufacturers Association</i>	103
<i>National Lumber Manufacturers Association</i>	110
<i>Pacific Coast Division Gypsum Association</i>	114
<i>Pacific Coast Gas Association</i>	99
<i>Pacific Lumber Company</i>	100
<i>Pacific Wire Products Company</i>	112
<i>Portland Cement Association</i>	101
<i>Red Cedar Shingle Bureau</i>	109
<i>Schumacher Wallboard Corporation</i>	100
<i>Sisalkraft Company</i>	3
<i>Summerbell Roof Structures</i>	<i>Second Cover</i>
<i>Timber Engineering Company</i>	110
<i>United States Steel</i>	4
<i>West Coast Wood Preserving Company</i>	107



- Withstands terrific strain
- More earthquake resisting
- Exceptionally high slab tests
- Heavy grade for exterior plastering
- Light grade for interior plastering
- Ideal for reinforcing under tile work, etc.

*Approved by the Pacific Coast Building Officials Conference
Research Department*



Manufacturers of "Pacific" Insect Screen

There is a grade, a thickness and a size of Douglas Fir Plywood for every construction purpose!

Each panel is manufactured in strict accordance with U. S. Commercial Standard CS45-40 and stamped with one of the "grade trade-marks" shown below. Learn them — specify by them.

Every grade of Douglas Fir Plywood does its particular job better than other materials traditionally used for the same purpose!



Douglas Fir Plywood in home construction is accepted by F.H.A. and approved in the Uniform Building Code!

For free copies of U. S. Commercial Standard CS45-40, Grade Use Guide, Sweet's Reprint, Concrete Form Booklet, Dri-Bilt Manual or other literature about Douglas Fir Plywood and its uses—or for technical assistance—write Douglas Fir Plywood Association, Tacoma Building, Tacoma, Washington.



GYPSUM

A BASIC PRODUCT . . .

Gypsum is a widely distributed mineral which is the basic product used in the manufacture of Gypsum Plasters, Gypsum Lath, and other fireproofing building materials.

FIREPROOFING QUALITY . . .

The fire-resistive quality of Gypsum is inherent in every gypsum product which has been definitely established by tests made by the Underwriters' Laboratories, Inc., the National Bureau of Standards, Columbia University, and by the Bureau of Buildings in many large cities. It is this barrier of any gypsum product which stubbornly resists the progress of fire.

CODE ACCEPTANCE . . .

Recognition is given to the fire-protection value and rigidity to construction by Building Departments of the largest cities in the country and by inclusion in codes such as the Uniform Code and standards of leading fire-protection and construction authorities.

Use Gypsum Products for Fire Protection

**PACIFIC COAST DIVISION OF THE
GYPSUM ASSOCIATION**

PART VI

ENGINEERING REGULATIONS, QUALITY AND DESIGN OF THE MATERIALS OF CONSTRUCTION

CHAPTER 23—LIVE AND DEAD LOADS

Sec. 2301. Dead Load. The dead load of a building shall include the weight of the walls, permanent partitions, framing, floors, roofs and all other permanent stationary construction entering into and becoming a part of a building. (See Appendix for weights of construction materials.)

Definitions

Live Load. The live load includes all loads except dead and lateral loads.

Sec. 2302. (a) General. Buildings and all parts thereof shall be of sufficient strength to support the estimated or actual imposed dead and live loads in addition to their own proper dead load, without exceeding the stresses noted elsewhere in this Code, provided that no building or part thereof shall be designed for live loads less than those specified in the following sections. Impact shall be considered in the design of any structure where impact loads occur.

Loads

(b) Special. Provision shall be made in designing office floors for load of 2000 pounds placed upon any space two and one-half feet ($2\frac{1}{2}'$) square wherever this load upon an otherwise unloaded floor would produce stresses greater than those caused by a uniformly distributed load of 50 pounds per square foot.

In designing floors to be used for industrial or commercial purposes the actual live load caused by the use to which the building or part of the building is to be put, shall be used in the design of such building or part thereof, and special provision shall be made for machine or apparatus loads when such machine or apparatus would cause a greater load than specified for such use in Section 2304.

Floors in office buildings and in other buildings, where partition locations are subject to change, shall be designed to support in addition to all other loads, a uniformly distributed load equal in pounds per square foot to one-twelfth of the weight of one linear foot of the partition.

Public garages and commercial or industrial buildings in which loaded trucks are placed, used or stored shall have the floor systems designed to support a concentrated rear wheel load of a loaded truck placed in any possible position.

Sec. 2303. Any system or method of construction to be used shall admit of a rational analysis in accordance with well established principles of mechanics.

Method of Design

Sec. 2304. The following unit loads shall be taken as the minimum live loads in pounds per square foot to be used in the design of buildings for the occupancies listed, and loads at least equal shall be assumed for uses not listed in this Section but which create or accommodate similar loadings.

Unit Live Loads

Sections 2304-2305

Apartments	40
Armories	150
Auditoriums—Fixed Seats	50
Movable Seats	100
Balconies and Galleries—Fixed Seats	50
Movable Seats	100
Dance Halls	100
Drill Rooms	100
Dwellings	40
Exterior Balconies	100
Fire Escapes	100
Garages	100
Gymnasiums	100
Hospitals—Wards and Rooms	40
Corridors and Public Rooms	100
Hotels—Guest Rooms and Private Corridors	40
Public Rooms	100
Corridors (Public)	100
Libraries—Reading Rooms	60
Corridors	100
Stack Rooms	125
Loft Building	100
Manufacturing — Light	75
Heavy	125
Marquees	60
Offices	50
Printing Plants—Press Rooms	150
Composing and Linotype Rooms	100
Public Rooms	100
Rest Rooms	50
Reviewing Stands and Bleachers	100
Roof Loads	(See Section 2305)
Schools—Class Rooms	40
Corridors	100
Sidewalks	250
Skating Rinks	100
Stairways	100
Storage — Light	125
Heavy (Load to be determined from pro- posed use or occupancy, but never less than)	250
Stores—Retail (Light Merchandise)	75
Wholesale (Light Merchandise)	100

Railings

All balcony railings shall be designed to withstand a horizontal force of 20 pounds per lineal foot, applied at the top of the railing.

**Roof
Loads**

Sec. 2305. Roofs shall be designed for a vertical live load of 20 pounds per square foot of horizontal projection applied to any and all slopes, except as hereinafter provided.

Where the rise exceeds twelve inches (12") per foot no vertical live loads need be assumed, but the roof shall be designed for the dead load and for a wind load of 15 pounds per square foot of vertical projection.

Where snow loads occur, roofs shall be designed for the increase in loading.

Sec. 2306. The following reductions in assumed live loads shall be permitted in designing of columns, piers, walls, foundations, trusses and girders. **Reduction of Live Loads**

1. No reduction of the assumed live load shall be allowed in the design of any slabs, joists or beams.

2. A reduction of the total live load used in the design of girders based on a certain tributary floor area shall be permitted as noted in the following schedule. This reduction shall not be carried into the columns nor shall such reduction be used in design of buildings to be used or occupied as warehouses or for storage purposes.

Reduction Allowed	Tributary Floor Area
5%	100 sq. ft.
10%	200 sq. ft.
15%	300 sq. ft. or more

3. For determining the total live loads carried by columns the following reductions shall be permitted, the reductions being based on the assumed live loads applied to the entire tributary floor area:

Allowable Reductions for Warehouses and Storage Buildings

Carrying the roof.....	0 per cent
Carrying 1 floor and roof.....	0 per cent
Carrying 2 floors and roof.....	5 per cent
Carrying 3 floors and roof.....	10 per cent
Carrying 4 floors and roof.....	15 per cent
Carrying 5 or more floors and roof.....	20 per cent

Live Load Reductions for Manufacturing Buildings, Stores and Garages

Carrying the roof.....	0 per cent
Carrying 1 floor and roof.....	0 per cent
Carrying 2 floors and roof.....	10 per cent
Carrying 3 floors and roof.....	20 per cent
Carrying 4 or more floors and roof.....	30 per cent

Allowable Live Load Reductions for All Other Buildings

Carrying the roof.....	0 per cent
Carrying 1 floor and roof.....	0 per cent
Carrying 2 floors and roof.....	10 per cent
Carrying 3 floors and roof.....	20 per cent
Carrying 4 floors and roof.....	30 per cent
Carrying 5 floors and roof.....	40 per cent
Carrying 6 floors and roof.....	45 per cent
Carrying 7 or more floors and roof.....	50 per cent

Sec. 2307. For purposes of design the wind pressure upon all vertical plane surfaces of all buildings and structures shall be taken at not less than 15 pounds per square foot for those portions of the building less than sixty feet (60') above ground and at not less than 20 pounds per square foot for those portions more than sixty feet (60') above ground. **Wind Pressure**

The wind pressure upon sprinkler tanks, sky signs, or other similar exposed structures and their supports shall be taken as not less than 30 pounds per square foot of the gross area of the plane surface, acting in any direction. In calculating the wind pressure on circular tanks, towers or stacks this pressure shall be assumed to act on $\frac{6}{10}$ of the projected area.

The overturning moment resulting from the above calcula-

Sections 2307- 2312

tions shall in no case exceed 50 per cent of the dead load resisting moment.

The weight of earth superimposed over footings may be used to calculate the dead load resisting moment.

For combined stresses due to wind and other loads the allowable unit stresses may be increased $33\frac{1}{3}$ per cent in excess of the values given in Chapters 24, 25, 26, and 27. For members carrying wind stresses only the allowable unit stresses may be increased $33\frac{1}{3}$ per cent. In no case shall the section be less than required if the wind stress be neglected.

Live Loads and Seating Capacity Posted

Sec. 2308. The live loads for which each floor or part thereof of a commercial or industrial building is or has been designed, shall have such designed live loads conspicuously posted by the owner in that part of each story in which they apply, using durable metal signs, and it shall be unlawful to remove or deface such notices. The occupant of the building shall be responsible for keeping the actual load below the allowable limits.

The maximum seating capacity shall be conspicuously posted by the owner of the building by means of durable metal signs placed in each assembly room, auditorium or room used for a similar purpose where fixed seats are not installed, and it shall be unlawful to remove or deface such notice or to permit more than this legal number of persons within such space.

Occupancy Permits for Changed Floor Loading

Sec. 2309. Plans for other than residential buildings filed with the Building Inspector with applications for permits shall show on each drawing the live loads per square foot of area covered, for which the building is designed, and occupancy permits for buildings hereafter erected shall not be issued until the floor load signs, required by Section 2308, have been installed. No changes in the occupancy of a building now existing or hereafter erected shall be made until a revised occupancy permit has been issued by the Building Inspector certifying that the floors are suitable for the loads characteristic of the proposed occupancy. (See Sections 206 and 207.)

Retaining Walls and Basement Floors

Sec. 2310. When earth or water, or earth and water, cause or may cause a pressure on any building or structure, such total pressure created shall be calculated in accordance with the best accepted engineering practice, and such calculations and design shall take into account any possible surcharge due to moving or fixed loads.

Footing Design

Sec. 2311. The base area of the footings of all buildings shall be designed in the following manner: The area of the footing which has the largest percentage of live load to total load shall be determined by dividing the total load by the allowable soil load. From the area thus obtained the dead load soil pressure of such footing is determined and the areas of all other footings of the building shall be determined on the basis of their respective dead loads only and such dead load soil pressure. In no case shall the load per square foot under any portion of any footing, due to the combined dead, live, wind and/or any other loads, exceed the safe sustaining power of the soil upon which the footing rests. The total reduced live load occurring in the column immediately above the footing shall be the live load used in the above computation.

Earthquake Regulations

Sec. 2312. (See Appendix.)

CHAPTER 24—MASONRY

(Quality and Design)

Sec. 2401. The quality and design of masonry construction and materials shall conform to the minimum standards specified in this Chapter. **General**

The following materials shall be classed as masonry, and wherever used in any building, shall conform to the minimum requirements as specified in this Chapter.

When laid up in mortar:

1. Brick.
2. Concrete Block or Tile.
3. Gypsum Block or Tile.
4. Hollow Clay Tile.
5. Stone.
6. Concrete—Plain.
7. Gypsum—Plain poured*.

***Note:** This applies only to gypsum used in roof construction, non-bearing walls or partitions, fire-protection or similar uses where not exposed to the weather.

The term "Brick Masonry" as used in this code shall be defined to mean masonry of burned clay or shale brick, sand-lime brick or concrete brick as specified in Sections 2402, 2403 and 2404, respectively.

The term "Brick" as used in this code shall be defined to mean a structural unit of burned shale or clay, sand lime or concrete, usually solid and about eight inches by three and three-quarters inches by two and one-half inches ($8" \times 3\frac{3}{4}" \times 2\frac{1}{2}"$) in size.

The term "Masonry of Hollow Units" as used in this code shall be defined to mean masonry of hollow clay tile or concrete tile or blocks or gypsum tile or blocks as specified in Sections 2405 and 2406 and Section 2409 respectively.

Tests of materials shall be made in accordance with the standard specifications of the American Society for Testing Materials as such standard specifications are noted in this Chapter.

Sec. 2402. Brick of burned clay or shale, except for thickness, shall meet the requirements for Grade "B" brick given in the "Tentative Specifications for Building Brick" (A. S. T. M. Designation C62-39T)¹ of the American Society for Testing Materials. **Burned Clay or Shale Brick**

Sec. 2403. Sand-Lime brick shall meet the requirements for grade "B" brick given in the "Standard Specifications for Sand Lime Building Brick" (A.S.T.M. Designation C73-39)¹ of the American Society for Testing Materials. **Sand-Lime Brick**

Sec. 2404. Concrete brick shall meet the requirements for Grade "B" brick, given in the "Standard Specifications for Concrete Building Brick", (A.S.T.M. Designation C55-37)¹ of the American Society for Testing Materials. **Concrete Brick**

¹See "Specification Documents".

Sections 2405-2408

Hollow Clay Tile

Sec. 2405. Hollow clay tile used for exterior walls and bearing walls shall meet the requirements for the "5-16" clay tile given in the "Standard Specifications and Tests for Structural Clay Load Bearing Wall Tile" (A.S.T.M. Designation C34-39)¹ of the American Society for Testing Materials. The exterior shell of such tile shall be not less than three-quarters of an inch ($\frac{3}{4}$ ") thick, except that a tolerance of one sixteenth of an inch ($\frac{1}{16}$ ") will be permitted in such shell thickness.

Hollow clay tile used in non-bearing partitions, fire protection and furring, shall meet the requirements of the "Standard Specifications for Structural Clay Non Load-Bearing Tile" (A.S.T.M. Designation C56-39)¹ of the American Society for Testing Materials.

Hollow Concrete Block or Tile

Sec. 2406. Hollow concrete tile or blocks shall be units designed for wall construction and shall meet the requirements of the "Standard Specifications and Tests for Load Bearing Concrete Masonry Units" (A.S.T.M. Designation C90-39)¹ of the American Society for Testing Materials.

"Special Concrete Block or Tile," in addition to meeting the requirements in this section, shall comply with the Underwriters Laboratory Standard for Concrete Masonry Units, dated November, 1938¹, and shall have a compressive strength of not less than 1000 pounds per square inch gross area as laid in the wall. Underwriters Laboratory certificated hollow concrete building units may be considered as special units.

Plain Concrete

Sec. 2407. Monolithic concrete construction containing less than .25 per cent of reinforcement shall be classified as plain concrete. Plain concrete shall have a strength of not less than 2000 pounds per square inch and shall conform to the requirements in Chapter 26.

Cement, fine aggregate and coarse aggregate shall conform to the requirements in Chapter 26.

Cast Stone

Sec. 2408. All cast stone shall be branded with a permanent identification mark of the manufacturer which shall be registered with the Building Inspector.

The average compressive strength of cast stone taken on four representative samples at the age of 28 days or when delivered on the job shall be not less than 5000 pounds per square inch with an individual minimum of 4500 pounds per square inch, and the average absorption of such samples shall be not more than seven per cent of their dry weight with an individual maximum of eight per cent.

Test samples shall consist of two inch by two inch (2" x2") cylinders or two-inch (2") cubes, cut from the stone as delivered on the job or from the regular stock in the yard, and shall be taken in such a manner that they are composed of approximately one-half of the facing and one-half of the backing material and so that they can be tested in the position in which the cast stone will be laid in the masonry. Tests of cast stone

¹See "Specification Documents".

Section 2408-2410

specimens shall be made in accordance with the "Tentative Specifications for Cast Stone," (Serial Designation P-3-A29T) of the American Concrete Institute.

Sec. 2409. Gypsum as used in this section means a product containing not less than 64½ per cent by weight of calcium sulphate combined with water.

Neat gypsum, gypsum fiber concrete, or gypsum coarse aggregate concrete used in floor and roof construction of either the reinforced gypsum suspension system or reinforced gypsum in which the gypsum acts structurally shall develop the following minimum ultimate compressive strength in pounds per square inch when dried to constant weight.

- (a) Neat gypsum (as used in pre-cast tile).....1800
- (b) Gypsum fiber concrete containing not more than three per cent by weight of wood chips, excelsior or fiber 1000
- (c) Gypsum fiber concrete containing not more than twelve and one-half per cent by weight of wood chips, excelsior or fiber..... 500

Gypsum coarse aggregate concrete of the following volumetric mixes:

- (d) 1½ parts gypsum cement; 1 part sand; 3 parts cinders 500
- (e) 1½ parts gypsum cement; 1 part sand; 3 parts slag..... 800
- (f) 1½ parts gypsum cement; 1 part sand; 3 parts gravel..... 800
- (g) 1½ parts gypsum cement; 1 part sand; 3 parts stone.....800

Note: Compressive tests shall be made on cylinders six inches (6") in diameter and twelve inches (12") long. The average compressive strength shall be not less than noted above and no one specimen shall test less than 75 per cent of the average of the lot tested and not less than five samples from the lot shall be tested to determine the average.

Gypsum tile or block used for partitions, walls, furring and enclosures may contain, intimately mixed, not more than 15 per cent by weight of binding material consisting of wood chips, excelsior or fiber. Gypsum partition tile or block shall be equal in quality to that specified in the "Standard Specifications for Gypsum Partition Tile or Block," (A. S. T. M. Designation C52-33)¹ of the American Society for Testing Materials.

The chemical and physical properties of the gypsum and calcined gypsum shall be equal to that specified in the "Standard Specifications for Gypsum and Calcined Gypsum" (A. S. T. M. Designation C22-25)¹ of the American Society for Testing Materials.

Sec. 2410. Mortar All cements and limes used in mortars shall conform to the requirements of the standard specifications for these

TABLE No. I—GRADING LIMITS FOR SAND

		Percentage by Weight
Passing a number 8 sieve, not less than:		90
Passing a number 30 sieve:		20 to 50
Passing a number 50 sieve:		10 to 30
Passing a number 100 sieve, not more than:		5

materials issued by the American Society for Testing Materials, having designations listed as follows:

- "Quicklime for Structural Purposes." (C5-26)¹
- "Hydrated Lime for Structural Purposes." (C6-31)¹
- "Specifications for Portland Cement." (C9-38)¹
- "High Early Strength Portland Cement." (C74-39)¹

Lime putty shall be made from quick lime or from hydrated lime. If made from quick lime the lime shall be properly slaked and then screened through a sieve having not less than 16 meshes per linear inch. After screening and before using, the slaked lime shall be properly stored and protected for not less than 10 days. The resulting lime putty shall weigh not less than 83 pounds per cubic foot.

Sand for mortar shall conform to the "Standard Specifications for Concrete Aggregates" (A. S. T. M. Designation C33-39)¹ except as these requirements may conflict with the following provisions: Sand for mortar shall be graded from coarse to fine within the limits shown in Table No. I of this Chapter.

Water used in mixing mortar shall be clean, and free from deleterious acids, alkalies, salts or organic materials.

All mortar used in unit masonry construction shall be either lime-cement mortar or cement mortar. For isolated piers, footings and exterior foundation walls, and for all unit masonry below the grade where subjected to wet conditions, only cement mortar shall be used.

Cement-lime mortar shall be composed of one part lime putty or hydrated lime, one part portland cement and six parts of sand by volume.

Cement mortar shall be composed of one part of cement and three parts of sand by volume with an allowable addition of lime putty or hydrated lime of not to exceed 20 per cent by volume of the cement content.

Allowable Working Stresses

Sec. 2411. (a) **Unreinforced Brick Masonry.** The maximum allowable working stresses in unreinforced brick masonry due to combined live, dead and other loads, shall not exceed the values given in Table No. II of this Chapter, except as noted in Chapter 23.

The maximum allowable compressive stresses in hollow walls of brick shall not exceed the stresses given in Table No. II of this Chapter based on the effective net cross sectional area of the wall.

¹See "Specification Documents".

TABLE NO. II—ALLOWABLE UNIT WORKING STRESSES
Unreinforced Brick Masonry

Type of Stress	Cement-Lime Mortar	Cement Mortar	Cement Grout
	(Pounds per square inch)		
Compression	250	300	400
Modulus of Rupture.....	20	25	30
Shear	20	25	30
Modulus of Elasticity.....	400,000	500,000	500,000

TABLE NO. III—ALLOWABLE UNIT WORKING STRESSES
Reinforced Brick Masonry

Type of Stress	1C-½L-4½S Mortar	1C-4½S Cement Grout
	Pounds per sq. in.	
Compression (Extreme fibre stress in bending).....	400	500
Direct Compression on Piers.....	300	400
Shear (no web reinforcement).....	25	30
Shear (with web reinforcement, taking entire shear).....	50	60
Bond: Deformed bars, Vertical bars;	60	60
Horizontal bars.....	80	80
Modulus of Elasticity E	1,200,000	1,500,000
Modulus of Rigidity G (Modulus of Elasticity in shear).....	480,000	600,000

(b) **Reinforced Brick Masonry.** The formulas and assumptions used in the design of reinforced brick masonry shall be the same as required for reinforced concrete in Chapter 26.

The unit working stresses used in the design of reinforced brick masonry shall not exceed the values given in Table No. III of this Chapter, except as noted in Section 2307.

Mortar for reinforced brick masonry shall be composed of not more than one-half part by volume of lime putty or hydrated lime to one part by volume of portland cement and the sand content shall be equal to not more than three times the combined volumes of cement and lime.

Cement grout shall be composed of not less than one part portland cement to four and one-half parts of sand by volume. Sufficient water shall be added to produce a proper consistency for pouring without segregation of constituents.

All reinforced brick masonry shall be laid with full header courses at least every fourth course in height or there shall be at least one full header in every 48 square inches of wall surface, except that in brick work laid with all interior joints grouted, headers need not be used. All bed, end and wall joints shall be completely filled with mortar and all reinforcing steel shall be entirely embedded in the mortar. The vertical wall

Section 2411

Allowable
Working
Stresses
(Con't.)**TABLE NO. IV-(a)—ALLOWABLE WORKING STRESSES**
Masonry of Hollow Units (End Construction)

Type of Stress	Cement- Lime Mortar (Pounds per sq. in. gross area)	Cement Mortar
Compression.....	70	80
Modulus of Rupture.....	8	10
Shear.....	8	10

TABLE NO. IV-(b)—ALLOWABLE WORKING STRESSES
Masonry of Hollow Units (Side Construction)

Type of Stress	Cement- Lime Mortar (Pounds per sq. in. gross area)	Cement Mortar
Compression.....	70	80
Modulus of Rupture.....	12	15
Shear.....	12	15

joints in grouted brick masonry shall be not less than three-quarters of an inch ($\frac{3}{4}$ " wide. The clearance between the bar and the brick shall be at least one-half the diameter of the bar.

Reinforcing steel shall be deformed bars and shall be braced and held in place firmly enough to prevent the breaking of bond while brick is being laid.

All brick shall be thoroughly wet not less than one hour before laying and shall be damp at the time of laying.

(c) **Concrete — Plain.** The maximum allowable working stresses in masonry of plain concrete shall be the following percentages of the ultimate strength of the concrete in compression as determined by the requirements of Chapter 26.

Compression	0.20f'
Shear or diagonal tension.....	0.02f'

where f'_c represents the ultimate compressive strength.

(d) **Masonry of Hollow Units.** The maximum allowable working stresses in masonry of hollow units laid with cells vertical (end construction) shall not exceed the values shown in Table No. IV-(a) of this Chapter.

The maximum allowable stresses in masonry of hollow units laid with cells horizontal (side construction) shall not exceed the values shown in Table No. IV-(b) in this Chapter.

(e) **Gypsum.** Gypsum suspension systems, poured-in-place or precast, shall be not less than three inches (3") in thickness, and shall be designed to carry the total estimated dead, live and other loads, with a factor of safety of not less than four, and shall be of such character as to be readily calculable by the use of accepted engineering formulas, in which the stress in the suspension wires or cables shall be determined by the formula:

Section 2411

**Allowable
Working
Stresses
(Cont'd.)**

$$T = \frac{WL}{8d} \sqrt{L^2 + 16d^2}$$

WHERE:

T = Maximum tension in wires or cables in pounds per foot width of slab.

W = Load in pounds per square foot.

L = Clear span in feet between supports.

d = Deflection or "dip" of wires or cables in feet at center of span.

TABLE NO. V—ALLOWABLE UNIT WORKING STRESSES

Gypsum

TYPE OF STRESS	NEAT GYPSUM	GYPSUM FIBER CONCRETE with not more than 3 per cent of wood chips, excelsior or fiber.	GYPSUM FIBER CONCRETE with not more than 12½ per cent of wood chips, excelsior or fiber	GYPSUM, Coarse, Aggregate Concrete
	Pounds per square inch			
Extreme fiber stress in compression in flexure	350	220	125	125
Direct compression or bearing	200	165	100	100
Bond between gypsum and reinforcing	40	30	30	30
Shearing stress	30	25	20	20
Modulus of elasticity	1,000,000	600,000	200,000	200,000
Ratio of modulus of elasticity of steel to that of gypsum (n).	30	50	150	150

TABLE NO. VI—ALLOWABLE UNIT WORKING STRESSES**Ashlar Masonry**

Kind of Stone	Laid in Lime-Cement Mortar	Laid in Cement Mortar
	(Pounds per square inch)	
Granite.....	640	800
Limestone.....	400	500
Marble.....	400	500
Sandstone.....	320	400

The wires or cables used shall be cold drawn steel in which the allowable working stress shall not exceed 20,000 pounds per square inch.

When precast or poured-in-place slabs or tiles of reinforced gypsum, in which the gypsum acts structurally, are used, they shall be designed to carry the total dead, live and other loads in accordance with the formulas for reinforced concrete construction as provided in Chapter 26.

The allowable working stresses shown in Table No. V of this Chapter shall not be exceeded.

(f) **Stone Masonry.** The maximum allowable compressive stresses in rubble stonework, due to combined live and dead loads, shall not exceed 140 pounds per square inch when laid in portland cement mortar, nor 100 pounds per square inch when laid in lime-cement mortar.

The maximum allowable compressive stress in ashlar masonry due to combined live and dead loads shall not exceed the limits given in Table No. VI of this Chapter.

**Special
Requirements**

Sec. 2412. The effects of eccentric loads and lateral forces shall be fully analyzed and allowances made for them in design. Concentrated loads shall be distributed so as not to exceed the allowable working stresses as specified in Sec. 2411 by more than 25 per cent.

CHAPTER 25—WOOD

(Quality and Design)

Sec. 2501. The quality and design of all wood except finish **General**
and millwork, used in the construction of all buildings shall conform to the requirements of this Chapter.

All members shall be so framed, anchored, tied and braced together as to develop the strength and rigidity necessary for the purpose for which they are used. No member shall be stressed in excess of the strength of its details and connections.

Sec. 2502. All wood structural members shall be of sufficient size and strength to carry their imposed loads safely and without exceeding the allowable working stresses as specified in Section 2503. **Determination of Required Sizes**

In determining the safe load which a member will sustain or in determining the required size of a member the following provisions shall govern:

(a) **Rough Lumber.** Where rough lumber is designated on the plans and in the specifications, the full nominal size of the member may be used for determining cross sectional area.

(h) **Surfaced Lumber.** Where surfaced lumber is designated on the plans and in the specifications, the minimum surfaced dressed sizes corresponding to nominal dimensions as indicated in regional lumber manufacturers' association grading rules as listed in Table No. I of this Chapter shall be used unless actual dressed sizes are indicated on plans.

(c) **Unspecified Lumber.** Where nominal dimensions of lumber are indicated on plans and specifications, without reference to surfacing, the minimum surfaced sizes corresponding to such nominal dimensions shall be used for determining the cross sectional area.

Sec. 2503. (a) Classification of Lumber. For the purpose of assigning allowable unit stresses to lumber used where its strength is the controlling consideration, two general classes of lumber shall be recognized, namely, "Structural Lumber" and "Yard Lumber". **Allowable Unit Stresses**

Section 2503, sub-section (b), paragraph 1, change to read as follows:

(b) **Structural Lumber:** 1. Structural Lumber is that conforming to the requirements for the several grades in specifications or grading rules designated in Table No. I of this chapter which are based on the grading procedure of American Lumber Standards, as set forth in "Wood Handbook," U. S. Department of Agriculture, September, 1935. . . . The grade of structural lumber shall be determined by the building inspector upon evidence furnished him, or shall be identified by the grade mark of, or certificate of inspection issued by, a lumber grading or inspection bureau or agency recognized as being competent.

2. For long time loading conditions the maximum allowable stresses for lumber qualifying as "Structural Lumber" for the species listed in Table No. I of this chapter, shall not

**TABLE No. I—ALLOWABLE UNIT STRESSES—Continuously Dry Locations
Long Time Loading**

SPECIES	COMMERCIAL GRADE	Rules under which Graded	ALLOWABLE UNIT STRESSES, POUNDS PER SQ. INCH				
			Compression Parallel to Grain (Short Columns)	Compression Perpendicular to Grain	Extreme Fiber in Bending (and Tension Parallel to Grain)	Maximum Horizontal Shear	Modulus of Elasticity
			Symbol:	c or p	q	f	H
Western Red Cedar	Structural	West Coast Lumbermen's Assn. Seattle, Wash.; Standard Grading and Dressing Rules No. 10.; July 1, 1934.	800	200	1000	100	1,000,000
Tidewater Red Cypress	1400 # f Tidewater Red Cypress 1100 # f " " " 1200 # c " " " 1000 # c " " "	Southern Cypress Mfgs. Assn. Jacksonville, Fla., May 16, 1934.	 1200 1000	300 300	1400 1100	120 100	1,200,000
Douglas Fir (Coast Region)	Dense Select Structural— 210, 214, 218, 302 ^a Select Structural—210, 214, 218 ^a No. 1 Timbers—200 ^a No. 1 Dimension ^a —195 ^a , 305(c)	West Coast Lumbermen's Assn. Seattle, Wash.; Standard Grading and Dressing Rules No. 10.; July 1, 1934.	1300 1200 1100 880	380 345 325 325	1800 1600 1200	140(120) ^a 120(100) ^a 120(100) ^a	1,600,000
Douglas Fir (Inland Empire)	Select Structural Structural Common Structural	Western Pine Assn. Portland, Ore.; Standard Grading Rules; Effective Jan. 1, 1934.	1300 1200 1100	380 335 315	1800 1600 1200	120 80 80	1,600,000 1,500,000 1,500,000
Eastern Hemlock	Select Structural	Northern Hemlock & Hdwd. Mfgs. Assn. Oshkosh, Wis., Nov. 19, 1932.	700	300	1100	70	1,100,000

West Coast Hemlock	No. 1 Dimension	West Coast Lumbermen's Assn. Seattle, Wash.; Standard Grading and Dressing Rules No. 10; July 1, 1934.	720	300	1040 ¹	100	1,400,000
Larch	Select Structural Structural Common Structural	Western Pine Assn. Portland, Ore.; Standard Grading Rules, Effective Jan. 1, 1934.	1468 1200 1100	380 345 325	1800 1600 1200	133 100 90	1,300,000
Oak	Select Dimension Common Dimension	Nat'l Hardwood Lumber Assn. Chicago, Ill., Jan., 1936.	1100 1100	500 500	1400 1100	120 100	1,500,000
Longleaf So. Pine	Select Structural Prime Structural Merchantable Structural Structural Sq. Edge and Sound } No. 1 Structural	Southern Pine Assn. New Orleans, La., Sept. 1, 1932.	1400 1300 1200 1000	380	2000 1800 1600 1400	120	1,600,000
Shortleaf So. Pine	Dense Select Structural Dense Structural Dense Str. Sq. Edge and Sound Dense No. 1 Structural	Southern Pine Assn. New Orleans, La., Sept. 1, 1932.	1400 1300 1200 900	380	2000 1800 1600 1200	120 120 120 100	1,600,000
Redwood	Dense Select All-heart Structural Select All-heart Structural	California Redwood Assn. San Francisco, Calif., March, 1938.	1200 1200	267 ¹	1400 1200	80 70	1,200,000

NOTES:

- ¹ Length not more than 11 times least dimension. This grade not intended for members to be used in bending.
- ² With slope of grain not more than one inch (1") in ten inches (10").
- ³ Numbers refer to paragraph numbers, W.C.L.A. Standard Grading Rules No. 10.
- ⁴ Values in parentheses for Beams and Stringers, 5 inch and thicker; for side cut pieces, values 10% higher than these may be used. Other values for 4 inch and thinner.

Section 2503

Allowable Unit Stresses (Cont'd)

exceed the values therein given. For species and grades not given in Table No. I of this Chapter, the working stresses therefor shall be established by the Building Inspector in accordance with the principles in the "Guide to the Grading of Structural Timbers and the Determination of Working Stresses" (Miscellaneous Publication No. 185 of the U. S. Department of Agriculture.)

Section 2503, sub-section (c), change to read as follows:

(c) **Yard Lumber:** Yard Lumber, for the purpose of this code, shall consist of grades not specifically designated as Structural Lumber and shall comply with Section 2502. . . . The grade of yard lumber shall be determined in the same manner as is above provided for structural lumber. Yard lumber, when used for load-bearing purposes for which computations are required, shall be assigned unit stresses by the Building Inspector in accordance with the procedure set forth in the "Wood Handbook," September, 1935, U. S. Department of Agriculture. In no case shall an allowable unit stress assigned to yard lumber exceed 80 per cent of the corresponding allowable stress given in Table No. I of this Chapter for the lowest of the structural grades there recognized.

Studding, posts and similar load-bearing members stressed primarily in compression shall be not lower in grade than No. 2 Common Dimension. Joists, rafters, planks, beams, stringers and similar horizontal load-bearing members stressed primarily in flexure shall be not lower in grade than No. 1 Common Dimension.

(d) **Plywood.** The term "Plywood" as used in this code shall mean a built-up board or piece of wood made of three or more plies of veneer joined with glue and so laid that the grain of adjoining plies is at right angles. An odd number of plies shall be used. For the purpose of this code all plywood shall conform to the U. S. Commercial Standard CS 45-38.

(e) **Decrease of Unit Stresses for Various Conditions of Exposure.** The various allowable unit stresses named in this Section are assigned for lumber used in continuously dry locations. For the condition of occasionally wet and quickly dried, the allowable unit stresses of Table No. I of this Chapter shall be multiplied by the following reduction factors expressed in percentages:

Extreme fiber in bending.....	87.5 %
Compression perpendicular to grain.....	70 %
Compression parallel to grain.....	92 %
Horizontal Shear.....	100 %

For other conditions of exposure, allowable unit stresses of Table No. I of this Chapter shall be reduced as may be required by the Building Inspector.

(f) **Unit Stresses—Intermittent Live Load.** For the case of members designed for a live load that will be intermittent, or of infrequent occurrence and duration of less than 24 hours insofar

Sections 2503-2504

as maximum conditions are concerned, unit stresses may be increased 25 per cent. Such increase shall be applicable to roof rafters, roof joists and roof trusses. Such increase shall not be applicable where the dead load is greater than the live load, nor to the minimum required live loads on floors, nor shall it be applicable to columns. Allowable unit stresses may be used without allowance for impact up to impact of 100 per cent of live loads figured.

(g) **Supplementary Provisions.** For joists spiked to studding and supported on a ribbon board gained into the studding the allowable unit stress in compression perpendicular to the grain may be increased 50 per cent above that specified elsewhere in this section, provided that the vertical load shall be considered to be transferred directly to the ribbon. For other conditions of bearing such unit stresses may be increased in accordance with the following factors for bearings less than six inches (6") in length and located three inches (3") or more from the end of the timber.

Length of bearing (inches)	½	1	1½	2	3	4	6 or more
Factor	1.85	1.60	1.45	1.30	1.15	1.10	1.00

For stress under a washer or small plate the factor of increase may be taken as for a bearing the length of which equals the diameter of the washer.

(h) **Joint Details.** In designing joint details the maximum allowable unit horizontal shear stress values specified in Table No. I of this Section may be increased not to exceed 50 per cent.

Sec. 2504. The maximum allowable unit stress in horizontal shear in beams and other members in flexure shall be computed by use of the following formula:

$$H = \frac{3R}{2bh}$$

WHERE

H = maximum unit horizontal shear, pounds per square inch

b = breadth of beam, inches

h = height of beam, inches

R = Reaction, pounds, under the following conditions: (1) Distribution of load to adjacent beams through flooring or other members shall be considered. (2) All loads uniform or concentrated, within a distance of the height of the beam from the nearest support shall be neglected.

The maximum allowable intensity of horizontal shear due to beam action in any structural member may be increased to two and one-half times the values specified in Table No. I of this Chapter, provided that increased unit stress does not occur over a length greater than one and one-half times the depth of the member.

Horizontal shear for notched members shall be computed in accordance with stress values given in Section 2521.

Columns

Sec. 2505. Columns, including struts and other members in compression parallel to grain, shall be designed structurally as follows:

(a) **Short Columns.** The safe load, in pounds per square inch of net cross sectional area, for columns and other members stressed in compression parallel to the grain, with a ratio of unsupported length to least dimension l/d not exceeding 11 (short columns), shall not exceed the allowable unit compression stress parallel to grain for short columns, as shown in Table No. I of this chapter, i.e.:

$$\frac{P}{A} = c$$

(b) **Intermediate columns.** For columns with a ratio of unsupported length to least dimension greater than 11 (intermediate columns), the following formula shall be used until the reduction in allowable stress equals one-third the stress permitted for short columns:

$$\frac{P}{A} = c \left[1 - \frac{1}{3} \left(\frac{l}{Kd} \right)^2 \right]$$

(c) **Long Columns.** For columns with a ratio of unsupported length to least dimension greater than K , (long columns), the safe unit load shall be determined by the following formula:

$$\frac{P}{A} = \frac{\pi^2 E}{36 \left(\frac{l}{d} \right)^2} = \frac{0.274 E}{\left(\frac{l}{d} \right)^2}$$

WHERE

P = total load in pounds

A = area in square inches of net cross-section

P

$\frac{P}{A}$ = working stress or maximum load per square inch

A

c = allowable unit stress in compression parallel to grain for short columns (Table No. I of this Chapter).

l = unsupported length of column in inches

d = least dimension of column in inches

E = modulus of elasticity

K = the $\frac{l}{d}$ at the point of tangency of the parabolic and Euler curves, at which point

$$\frac{P}{A} = \frac{2c}{3}$$

$$K = \frac{\pi}{2} \sqrt{\frac{E}{6c}}$$

Columns shall be limited in maximum length between points of lateral support to $l \leq 50d$, except as provided in Section 2516.

(d) **Round Columns.** The safe load on a column of round cross-section shall not exceed that permitted for a square column of the same cross-sectional area.

Sec. 2506. Members subject to both axial and bending stresses **Combined Stresses**
shall be proportioned in accordance with the following formula:

$$\frac{P/A}{c_1} + \frac{M/S}{f_1} \text{ equals or is less than 1.}$$

WHERE

P=total axial load (in pounds).

A=area (in square inches) of net cross-section.

c_1 =allowable unit axial stress permitted for members acting solely as a column (see Table No. I of this Chapter and Section 2505).

M=total bending moment in inch pounds resulting from load causing flexure.

S=section modulus (in inches cubed) for net cross section.

f_1 =allowable unit fiber stress in bending permitted for member (see Table No. I of this Chapter).

Sec. 2507. The unit stress normal to a plane inclined to the fiber of a wood member shall not exceed that determined from the formula:

Compression on Inclined Surfaces

$$n = \frac{p q}{p \sin^2 \theta + q \cos^2 \theta}$$

WHERE

n=allowable unit stress on inclined surface, pounds per square inch.

p=allowable compressive unit stress parallel to grain (Table No. I of this Chapter).

q=allowable compressive unit stress perpendicular to grain (Table No. I of this Chapter).

θ =angle between the direction of the load and the direction of the grain in degrees.

Sec. 2508. (a) Design of Bolted Joints. Bolted joints wherein bolts are used to resist stresses in wood structures shall be designed in accordance with the principles set forth in the "Wood Handbook," U. S. Department of Agriculture, September, 1935, and in addition thereto shall comply with the requirements of this Section.

Bolted Joints

(b) **Safe Loads, Double Shear.** Safe loads, in pounds on bolts in seasoned lumber of the following species: cedar, eastern red; cypress, southern; Douglas fir (coast region); larch, western; pine, southern yellow; redwood and tamarack, in joints consisting of three members in which the side members are one-half the thickness of the main member, shall not exceed values stated in Tables II-(a) and II-(b) of this Chapter.

(c) **Loads at Angle to Grain.** When a force is applied by means of a bolt at an angle with the fiber of a wood member,

**Bolted
Joints
(Cont'd)**

the safe load shall be determined in accordance with the formula:

$$n = \frac{p q}{p \sin^2 \theta + q \cos^2 \theta}$$

WHERE

n = safe load in pounds on bolt.

p = safe load on bolt parallel to grain as determined from Table No. II-(a).

q = safe load on bolt perpendicular to grain from Table No. II-(b).

θ = angle between direction of load and direction of member, in degrees.

TABLE NO. II-(a)—HOLDING POWER OF BOLTS
Loads Parallel to Grain (p)

Length of Bolt in main mem- ber, in inches*	Diameter of Bolt in Inches						
	½	¾	¾	¾	1	1½	1¾
2	960	1280	1550	1820	2080		
3	1050	1620	2160	2660	3090		
4	1050	1640	2360	3110	3850		
5	1050	1640	2360	3210	4160	5150	
6		1640	2360	3210	4190	5330	
7		1640	2360	3210	4190	5330	
8		1640	2360	3210	4190	5330	6550
10				3210	4190	5330	6550
12					4190	5330	6550

* This assumes full size lumber, i.e., not dressed sizes.
Safe loads on dressed sizes may be obtained by interpolation.

TABLE NO. II-(b)—HOLDING POWER OF BOLTS
Loads Perpendicular to Grain (q)

Length of Bolt in main mem- ber, in inches*	Diameter of Bolt in Inches						
	½	¾	¾	¾	1	1½	1¾
2	460	520	570	640	700		
3	690	780	890	960	1050		
4	810	1040	1160	1280	1400		
5	780	1150	1440	1600	1750	1900	
6		1110	1540	1880	2100	2280	
7		1060	1500	1970	2390	2660	
8		980	1440	1940	2460	2940	3273
10				1800	2340	2970	3610
12					2180	2820	3460

* This assumes full size lumber, i.e., not dressed sizes.
Safe loads on dressed sizes may be obtained by interpolation.

Section 2508

(d) **Bolts in Other Species of Wood.** For species of wood other than those specified in the Table No. II, (a) and (b) of this section, bolt values shall be derived in accordance with the principles stated in "Wood Handbook," U. S. Department of Agriculture, September, 1935. **Bolted Joints (Cont'd.)**

(e) **Joints Other than Double Shear.** When a joint consists of two members (single shear) of equal thickness, one-half the tabulated load for a piece twice the thickness of one of the members shall be used. When members of a two-member joint are of unequal thickness, one-half the tabulated load for a piece twice the thickness of the thinner member shall be used.

For multiple-member joints other than two or three members, the load for each shear plane shall be computed in the same manner as for a two-member joint.

(f) **Metal Side Plates.** When metal plates are used each side of a wood member, tabulated bolt values may be increased one-quarter for values parallel to the grain.

(g) **Joints in Wet Locations.** When the joint is to be used in a location "occasionally wet but quickly dried," tabulated bolt values shall be reduced one-quarter.

In locations "usually wet," tabulated bolt values shall be reduced one-third.

(h) **Definition of Seasoned Lumber.** "Seasoned lumber" for the purpose of this section, is defined as lumber which has been air-dried for at least 60 days, or which has at the time of installation in the structure reached a moisture content approximately equal to that which it will eventually contain in service.

Where green or recently cut lumber is used, tabulated bolt values shall be reduced one-third.

(i) **Bolt Holes.** Bolt holes in wood members shall be made the same diameter as the bolt, unless otherwise specified on plans. Bolt holes may be specified to be not more than one-sixteenth of an inch larger than the bolt, in which case allowable loads shall be reduced 10 per cent.

(j) **Bolt Hole Spacing.** "Row of Bolts" is defined as a number of bolts placed in a line parallel to the direction of load.

Minimum center-to-center spacing of bolts in any one row for full design loads shall be four times the bolt diameter. In no case shall the bolt bearing capacity of any member be exceeded.

Spacing center-to-center between rows of bolts for loads perpendicular to grain shall be not less than two and one-half times the bolt diameter for an l/d ratio of two, and not less than five times the bolt diameter for l/d ratios of six or more. Intermediate values shall be directly interpolated.

Spacing center-to-center between rows of bolts for loads parallel to grain shall be such that the net tension area remaining at a critical section shall be not less than 80 per cent for softwoods, and 100 per cent for hardwoods, of the total area in bearing under all bolts in the particular timber.

End margin is defined as the distance from the end of a bolted member to the center of the bolt hole nearest the end. This distance, for a member in tension, shall be not less than

Sections 2508-2512

seven times the bolt diameter for softwoods and five times for hardwoods. End margin, for members in compression, shall be not less than four times the bolt diameter.

Edge margin is defined as the distance from the edge of the timber to the center of the nearest bolt hole. For members loaded perpendicular to grain, edge margin nearest the edge toward which the load is acting shall be at least four times the bolt diameter. For members loaded parallel to grain, edge margin shall be at least one and one-half times the bolt diameter.

Timber Connectors

Sec. 2509. Joints wherein timber connectors are used with bolts to transmit stresses between structural or load-bearing members shall be designed in accordance with the principles and recommended safe loads set forth in "Wood Handbook" published by U. S. Department of Agriculture, September, 1935.

Safe loads and design practice for types of connectors not mentioned or fully covered by the above publication may be determined from other published recommendations, provided such recommendations are first approved by the Building Inspector. Allowable load values for timber connectors shall be based on empirical test data. Connector safe load values shall be determined from the combined resistance of the connector and its bolt.

Cylindrical Pins

Sec. 2510. In connections involving the use of tightly fitting cylindrical pins of iron, steel, heavy steel pipe or hardwood, the allowable load on a pin shall be determined in the same manner as for bolts as set forth in the "Wood Handbook," published by the U. S. Department of Agriculture, September, 1935.

Lag Screws

Sec. 2511. (a) Penetration. Lag screws shall penetrate into the farther member not less than one and one-half times the thickness of the side member.

(b) Safe Lateral Strength. The safe lateral strength shall be equal to 75 per cent of the single shear value of a bolt of the same diameter in a main member of thickness equal to one and one-half times the thickness of the side member.

(c) Screws with Side Plates. Where lag screws are used with steel side plates the safe load shall be determined as for bolts in single shear with a wood side plate, considering the thickness of main member to be two-thirds of the penetration of lag screws into the timber member.

(d) Placing. All lag screws shall be screwed and not driven into place.

In placing lag screws in wood, a hole shall first be bored of the same diameter and depth as the shank, after which the hole shall be continued to a depth equal to the length of the lag screw with a diameter equal to the diameter of the screw at the root of the thread.

(e) Holes. Holes for lag screws in steel plates shall be drilled to a diameter one-thirty-second of an inch larger than the nominal diameter of the lag screw.

Wood Screws

Sec. 2512. (a) Shear Connections. A wood screw used to fasten a metal plate to a wooden member or a wooden member to a wooden member shall not be subjected to a greater

**TABLE No. III-(a)—SAFE LATERAL RESISTANCE
OF WOOD SCREWS
In Pounds Per Screw**

Kind of Wood	Gauge of Screw						
	12	14	16	18	20	22	24
Douglas fir	159	198	239	287	335	400	460
Redwood	124	155	190	230	272	320	372
Other Species	As determined by the building inspector.						

**TABLE NO. III-(b)—SAFE RESISTANCE OF WOOD
SCREWS TO WITHDRAWAL**

When Inserted Perpendicular to Grain of Wood in Pounds per
Linear Inch of Screw

Kind of Wood	Gauge of Screw				
	12	16	20	22	28
Douglas fir	125	140	150	170	185
Redwood	75	85	90	100	110
Other Species	As determined by the building inspector.				

load causing shear and bending than the safe lateral strength of the wood screw as determined from Table No. III-(a) of this Chapter. Screws shall have an embedment into the farther member of at least six-tenths of the length of the screw. The length of the screw shall be not less than seven times the diameter of the screw.

(b) **Tension Connections.** A wood screw inserted perpendicular to the grain of the wood shall not be subjected to a greater load tending to cause withdrawal than the safe resistance of the screw to withdrawal as determined from Table No. III-(b) of this Chapter.

A wood screw inserted parallel to the grain of the wood shall not be allowed for resisting computed tensile stresses.

Sec. 2513. (a) Safe Lateral Strength. A wire nail inserted perpendicular to the grain of the wood when used to fasten wooden members together, shall not be subjected to a greater load causing shear and bending than the safe lateral strength of the wire nail or spike as determined from Table IV-(a). **Nails**

A wire nail inserted parallel to the grain of the wood shall not be subjected to more than three-fourths of the lateral load allowable when inserted perpendicular to the grain.

(b) **Safe Resistance to Withdrawal.** A wire nail inserted perpendicular to the grain of the wood shall not be subjected to a greater load, tending to cause withdrawal, than the safe resistance of the nail to withdrawal, as determined from Table No. IV-(b).

Nails inserted parallel to the grain of the wood shall not be allowed for resisting computed tensile stresses.

Sections 2513-2515

**TABLE NO. IV-(a)—SAFE LATERAL STRENGTH OF
COMMON WIRE NAILS****Inserted Perpendicular to the Grain of the Wood,
In Pounds Per Nail**

Kind of Wood	Size of Nail									
	6d	8d	10d	12d	16d	20d	30d	40d	50d	60d
Length of Nail	2"	2½"	3"	3¼"	3½"	4"	4½"	5"	5½"	6"
Douglas fir or Southern Pine	70	100	120	130	160	190	230	270	310	360
Redwood	58	82	98	106	123	155	188	220	250	295
Other Species	As determined by the building inspector.									

**TABLE NO. IV-(b)—SAFE RESISTANCE TO WITHDRAWAL
OF COMMON WIRE NAILS****Inserted Perpendicular to the Grain of the Wood, in Pounds
Per Linear Inch of Penetration into the Main Member**

Kind of Wood	Size of Nail									
	6d	8d	10d	12d	16d	20d	30d	40d	50d	60d
Douglas Fir or Southern Pine or Redwood	27	29	35	35	39	48	52	56	61	67
Other Species	As determined by the building inspector.									

(c) **Spacing and Penetration.** Nails shall not be driven closer together than one-half their length unless driven in bored holes nor closer to the edge of the timber than one-quarter their length. Holes for nails when necessary to prevent splitting, shall be bored of diameter smaller than that of the nails. Nails shall be of such length that, when joining one timber to another, the penetration of the nail into the second or farther timber shall be not less than one-half the length of the nail.

Washers

Sec. 2514. All bolts in direct tension shall be provided with steel plate washers under heads and nuts. The area of these washers must be such that the unit bearing stress on the wood shall not exceed the allowable unit stress. The washer shall be not less in thickness than one-tenth the diameter or the length of the longer side of the washer.

Bolts taking shear only shall have Standard O. G. malleable iron washers, or equivalent, under head and nuts.

**Columns
or Posts**

Sec. 2515. For allowable unit stresses see Sections 2503, 2504 and 2505.

All wood columns and posts shall be framed to true end bearings; shall extend down to supports of such design as to

point shall be calculated by the following formula and shall not exceed values given in Table No. I of this Chapter:

$$H = \frac{3V}{2bd} \times \frac{h}{d}$$

WHERE

V=vertical shear at section under consideration.

b=width of beam.

d=actual depth of beam at the notch.

h=total depth of beam.

H=allowable unit horizontal shear stress.

Where notches or holes are made in other portions of the beam, the net remaining depth of beam shall be used in determining the bending strength.

Sec. 2522. Joists supporting plastered ceilings shall be so proportioned that their deflection under full live load and dead load exclusive of weight of plaster, shall not exceed one three-hundred-and-sixtieth of the span length.

Deflection

Sec. 2523. Every member of a solid or laminated floor, consisting of members set closely together on edge, shall be firmly nailed with two nails at each end and at intervals along its length not greater than eighteen inches (18"). The nails used shall be of a length equal to two and one-half times the thickness of a single lamination. Devices of equivalent strength may be used in lieu of nails.

**Laminated
Floors**

In the case of laminated floors in structures of more than one span, at least two-thirds of the members shall pass over the supports. In any three consecutive members, no two splices shall be nearer to each other than one-quarter of a span length. No member shall be spliced more than once in a distance equal to a span length.

In all single span laminated floors the members forming the floor shall be full length and free from joints.

When laminated floors bear on a masonry wall, suitable anchorage shall be provided capable of resisting the design forces. (See also Section 3104.)

Sec. 2524. (a) Placing. Studs in walls and partitions may be placed with the longest dimension parallel with the wall or partition, provided the studs are considered as columns and comply with the column formulas. Such walls shall have top and bottom plates except when framed as provided in Section 2517, first paragraph.

**Stud Walls
and
Partitions**

(b) Plates. In bearing partitions the top plate shall be doubled and lapped at each intersection with walls or partitions. Joints in the upper and lower members of the top plate shall be staggered not less than four feet (4').

(c) Bridging. All stud partitions or walls over ten feet (10') in height shall have herringbone bridging, not less than two inches (2") in thickness and of the same width as the stud, fitted snugly and spiked into the studs at mid-height of stud, or other

Section 2524

Stud Walls and Partitions (Cont'd.)

means for giving equal lateral support to the studs. Herring-bone bridging may serve as fire-stopping as required in Section 2526.

(d) **Size and Height.** Exterior stud walls and bearing partitions for buildings of two stories or less shall consist of not less than two-inch by four-inch (2"x4") studs; for buildings of three stories, the studding shall be not less than three-inch by four-inch (3"x4") or two-inch by six-inch (2"x6") to the bottom of the second floor joists and two-inch by four-inch (2"x4") for the two upper stories. Maximum allowable height of two-inch by four-inch (2"x4") and three-inch by four-inch (3"x4") stud framing shall be fourteen feet (14') and of two-inch by six-inch (2"x6") stud framing shall be twenty feet (20') unless the wall is supported laterally by adequate framing. No studding shall be spaced more than sixteen inches (16") center, except that in lieu of this requirement the studs and plates may be designed as a system of columns and beams, provided structural grade material is used..

(e) **Base Plates.** Stud walls resting on masonry shall have base plates or sills of foundation grade redwood, cedar, cypress or wood treated with approved preservative. Such sills shall be bolted to the masonry at corners and between corners with bolts not less than one-half inch ($\frac{1}{2}$ ") in diameter, embedded not less than seven inches (7") into the masonry and spaced not more than six feet (6') apart, center to center. These sills shall be not less than the width of the studs nor less than two inches (2") thick.

(f) **Corners and Bracing.** Angles at corners where stud walls or partitions meet shall be framed solid so that no lath can extend from one room to another. All exterior and main cross stud partitions shall be effectively and thoroughly braced.

(g) **Pipes in Walls.** Stud partitions containing plumbing, heating or other pipes shall be so framed and the joists underneath so spaced as to give proper clearance for the piping. Where a partition containing such piping runs parallel to the floor joists, the joists underneath such partitions shall be doubled and spaced to permit the passage of such pipes and shall be bridged with solid bridging. Where plumbing, heating or other pipes are placed in or partly in a partition, necessitating the cutting of the soles or plates, a metal tie not less than one-eighth inch ($\frac{1}{8}$ ") thick and one-and one-half inches ($1\frac{1}{2}$ ") wide shall be fastened to the plate across and to each side of the opening with not less than four 16d nails.

(h) **Chimney Space.** Wood lath, furring or framing shall be placed not less than two inches (2") from any chimney and not less than four inches (4") from the back of any fireplace.

(i) **Underpinning.** The underpinning of bearing stud walls shall be so constructed as to resist the design forces.

(j) **Headers.** All wall openings four feet (4') wide or less shall be provided with double headers not less than two inches (2") thick, placed on edge, securely fastened together, and such headers shall have two-inch (2") solid bearing to the floor or bottom plate. All openings more than four feet (4') wide shall

be trussed or provided with lintels which shall have not less than two-inch (2") solid bearing at each end to the floor or bottom plate.

Sec. 2525. The wooden framework of all buildings shall be connected together in a secure manner, and the connections between the various parts shall be such that all forces will be adequately resisted. The sheathing and the sub-flooring shall be fastened to the studs, rafters or joists with nails which shall be in length at least two and one-half times the nominal thickness of the sheathing or subflooring. The nailing shall have an average spacing not more than four inches (4") along each stud, rafter or joist.

Nailing and Fastening

Exception: For plywood sheathing or subflooring nails shall be not less than sixpenny and shall be spaced not more than six inches (6") along the edges of panels and twelve inches (12") along intermediate supports and shall be at least three-eighths inch ($\frac{3}{8}$ ") from the edge of panel.

Sec. 2526. Firestopping shall be provided to cut off all concealed draft openings (both vertical and horizontal), and form an effective fire barrier between stories, and between a top story and the roof space. It shall be used in specific locations, as follows:

Fire Stops

1. In exterior or interior stud walls, at ceilings and floor levels.
2. In all stud walls and partitions, including furred spaces, so placed that the maximum dimension of any concealed space is not over seven feet (7').
3. In furred masonry walls.
4. Between stair stringers at least once in the middle portion of each run, at top and bottom, and between studs, along and in line with run of stair adjoining such partition.
5. Around top, bottom, sides and ends of sliding door pockets.
6. Spaces between chimneys and wood framing; these shall be solidly filled with mortar, loose cinders or other incombustible material placed in incombustible supports.
7. Any other locations not specifically mentioned above, such as holes for pipes, shafting, etc., which could afford a passage for flames.

Fire stops shall be of two-inch (2") nominal material. If width of opening is such that more than one piece of lumber is necessary, there shall be two thicknesses of one-inch (1") material with joints broken.

Sections 2527-2529

Foundation Ventilation

Sec. 2527. The space between bottom of floor joists and the ground of any building (except such space as is occupied by a basement or cellar) shall be provided with a sufficient number of ventilating openings through foundation walls or exterior walls to insure ample ventilation, and such openings shall be covered with a corrosion-resistant wire mesh with openings in such mesh not greater than one-half inch ($\frac{1}{2}$ ") in any dimension. The minimum total area of ventilating openings shall be proportioned on the basis of two square feet (2 sq. ft.) for each twenty-five linear feet (25 lin. ft.) or major fraction thereof of exterior wall. Such openings need not be placed in the front of the building.

Minimum clearance between bottom of floor joists and the ground beneath shall be eighteen inches (18").

Wood Diaphragms

Sec. 2528. Wood diaphragms may be used to distribute horizontal forces to resisting elements such as walls or partitions, provided the maximum deflection in the plane of the diaphragm, as determined by tests or analogies drawn therefrom, does not exceed the permissible deflection of such wall or partition.

In determining the permissible deflection of walls or partitions, the actual elastic properties of the materials (modulus of elasticity, allowable extreme fiber stresses, etc.) may be determined by tests or other data acceptable to the Building Inspector, or the assigned values for such properties elsewhere herein provided shall be used.

In determining the maximum horizontal deflection of a proposed wood diaphragm under assumed design loads, data from actual tests of diaphragms corresponding to the type proposed may be used or an analogy may be drawn from data furnished in an article entitled "Tests Indicate Design Methods for Earthquake-Proof Timber Floors" appearing in the Engineering News-Record for June 20, 1935, or in "The Rigidity and Strength of Frame Walls" published by the U. S. Forest Products Laboratory.

Connections and anchorage of wood diaphragms to resisting elements shall be provided along all the margins of the diaphragm. Such connections shall be capable of resisting the design loads or forces elsewhere herein prescribed.

Termite Provisions

Sec. 2529. For termite and fungus control provisions, see Appendix.

CHAPTER 26—REINFORCED CONCRETE (Quality and Design)

Quality

Sec. 2601. The quality of the materials used in reinforced concrete and the quality of reinforced concrete shall conform to the physical and chemical properties as specified in Sections 2604, 2605 and 2606.

Design

Sec. 2602. The design of reinforced concrete shall conform to the rules and principles specified in this Chapter.

Definitions

Sec. 2603. The following definitions give the meaning of certain terms as used in this Chapter.

Aggregate—Inert material which is mixed with portland cement and water to produce concrete.

Column—An upright compression member the length of which exceeds three times its least lateral dimension.

Column Capital—An enlargement of the upper end of a reinforced concrete column designed and built to act as a unit with the column and flat slab.

Column Strip—A portion of a flat slab panel one-half panel in width occupying the two quarter-panel areas outside of the middle strip, and extending through the panel in the direction in which bending moments are being considered.

Combination Column—A column in which a structural steel section, designed to carry the principal part of the load, is wrapped with wire and encased in concrete of such quality that some additional load may be allowed.

Composite Column—A column in which a steel or cast-iron section is completely encased in concrete containing reinforcement of spiral reinforcement and longitudinal bars.

Concrete—A mixture of portland cement, fine aggregate, coarse aggregate and water.

Deformed Bar—Reinforcing bars with closely spaced shoulders, lugs or projections formed integrally with the bar during rolling so as to firmly engage the surrounding concrete. Wire mesh with welded intersections not farther apart than twelve inches (12") in the direction of the principal reinforcement and with cross wires not smaller than No. 10 W. & M. Gauge may be rated as a deformed bar.

Diagonal Band—A group of bars covering a width approximately 0.4 the average span, symmetrical with respect to the diagonal running from corner to corner of the panel of a flat slab.

Direct Band—A group of bars, covering a width approximately 0.4 l_n , symmetrical with respect to the center lines of the supporting columns of a flat slab.

Dropped Panel—The structural portion of a flat slab which is thickened throughout an area surrounding the column capital.

Effective Area of Concrete—The area of a section which lies between the centroid of the tensile reinforcement and the compression face of a slab or beam.

Effective Area of Reinforcement—The area obtained by multiplying the right cross-sectional area of the metal reinforcement by the cosine of the angle between its direction and that for which the effectiveness of the reinforcement is to be determined.

Flat Slab—A concrete slab reinforced in two or more directions, generally without beams or girders to transfer the loads to supporting columns.

Gunite—A mixture of portland cement and fine aggregate, mixed dry, passed through a cement gun, or other similar device, hydrated at the nozzle and deposited under pressure in its place of final repose. It shall be considered as concrete for particulars of design as specified in this Chapter.

Laitance—Extremely fine material of little or no hardness which may collect on the surface of freshly deposited concrete or mortar, resulting from the use of excess mixing water and usually recognized by its relatively light color.

Middle Strip—A portion of a flat slab panel one-half panel in width, symmetrical with respect to the panel center line and extending through the panel in the direction in which bending moments are being considered.

Mortar—A mixture of portland cement, fine aggregate and water.

Negative Reinforcement—Reinforcement so placed as to take tensile stress due to negative bending moment.

Paneled Ceiling—The ceiling of a flat slab in which approximately that portion of the area enclosed within the intersection of the two middle strips is reduced in thickness.

Panel Length—The distance along a panel side from center to center of columns of a flat slab.

Pedestal—An upright compression member whose height does not exceed three times its least lateral dimension.

Plain Concrete—Concrete without metal reinforcement, or reinforced only for shrinkage or temperature changes.

Portland Cement—The product obtained by finely pulverizing clinker produced by calcining to incipient fusion an intimate and properly proportioned mixture of argillaceous and calcareous materials, with no additions subsequent to calcination excepting water and calcined or uncalcined gypsum.

Positive Reinforcement—Reinforcement so placed as to take tensile stress due to positive bending moment.

Ratio of Reinforcement—The ratio of the effective area of the reinforcement cut by a section of a beam or slab to the effective area of the concrete at that section.

Reinforced Concrete—Concrete in which metal other than that provided for shrinkage or temperature changes is embedded in such a manner that the two materials act together in resisting forces.

Surface Water—The water carried by the aggregate except that held by absorption within the aggregate particles themselves.

Sections 2604-2605

Materials

Sec. 2604. (a) Portland Cement. Portland cement shall conform to the "Standard Specifications for Portland Cement," (A. S. T. M. Designation C9-38)¹ or the "Standard Specification and Tests for High Early Strength Portland Cement," (A. S. T. M. Designation C74-39)¹ of the American Society for Testing Materials.

(b) Concrete Aggregates. Concrete aggregates, except lightweight aggregates, shall conform to the "Standard" Specifications for Concrete Aggregates" (A. S. T. M. Designation C33-39) including the methods of sampling and testing.

Lightweight aggregates for concrete shall conform to the "Standard Specifications for Lightweight Aggregates for Concrete," (A.S.T.M. Designation C130-39) including the methods of sampling and testing.

Aggregates that do not meet the above specifications and that have been shown by test or actual service to produce concrete of the required strength, durability, watertightness and wearing qualities, may be used under the provisions of Section 2606, Method 2, where authorized by the Building Inspector.

The maximum size of the aggregate shall be not larger than one-fifth of the narrowest dimension between forms of the member for which the concrete is to be used nor larger than three-fourths of the minimum clear spacing between reinforcing bars.

(c) Water. Water used in mixing concrete shall be clean and free from injurious amounts of oil, acid, alkali, organic matter or other harmful substances.

(d) Metal Reinforcement. Metal reinforcement shall conform to the requirements of "Standard Specifications for Billet-Steel Reinforcement Bars" (A.S.T.M. Designation A15-39)¹ of the American Society of Testing Materials for structural, intermediate or hard grade, or "Standard Specifications for Rail-Steel Concrete Reinforcement Bars" (A. S. T. M. Designation A16-35)¹ of the American Society for Testing Materials; or "Standard Specifications for Cold-Drawn Steel Wire for Concrete Reinforcement" (A. S. T. M. Designation A82-34)¹; provided, that hard grade steel bars larger than three-fourths inch ($\frac{3}{4}$ ") in diameter shall not be used where bending would be required; and provided, further, that the requirements in the above mentioned specifications for machining of deformed bars shall be eliminated.

Deformed bars, to receive that rating which permits the use of bond stresses higher than those allowed for plain bars, shall show a bond strength 25 per cent greater than that shown by plain bars of equivalent cross-sectional area.

(e) Storage. Storage of cement and aggregates shall be in a manner to prevent deterioration or the intrusion of foreign matter. Any material which has been damaged shall be immediately and completely removed from the work.

Tests

Sec. 2605. On concrete or reinforced concrete work the Building Inspector shall have the right to require the owner or his agent to make tests of the concrete and other materials from time to time to determine whether the materials and methods

¹See "Specification Documents".

in use are such as to produce concrete or reinforced concrete of the quality specified and used in the design of the building or structure. The tests shall be made, when ordered by the Building Inspector, by the owner or his authorized representative and no responsibility for the expense of these tests shall attach to the Building Department. All such tests shall be made by competent persons approved by the Building Inspector and copies of the results shall be kept on file in the office of the Building Inspector for a period of not less than two years after the acceptance of the structure. Specimens for concrete cylinder tests shall be taken at the place where the concrete is being deposited and shall be taken, cured and tested in accordance with the "Standard Method of Making and Storing Specimens of Concrete in the Field," (A.S.T.M. Designation C31-39¹) of the American Society for Testing Materials.

The Building Inspector shall have the right to order the test under load of any portion of a completed structure, when the conditions have been such as to leave reasonable doubt as to the adequacy of the structure to serve the purpose for which it is intended.

Load Tests

When a load test is required, the member or portion of the structure under consideration shall be subject to a superimposed load equal to one and one-half times the live load plus one-half of the dead load. This load shall be left in position for a period of 24 hours before removal. If, during the test, or upon removal of the load, the member or portion of the structure shows evident failure, such changes or modifications as are necessary to make the structure adequate for the rated capacity shall be made; or, where lawful, a lower rating shall be established. The structure shall be considered to have passed the test if the maximum deflection at the end of the 24 hour period does not exceed the value of D as given by the following:

$$D = \frac{.001 L^3}{12t} \quad (1)$$

WHERE:

L is the span, t is the total depth of the slab or beam and D is the maximum deflection—all expressed in the same units.

If the deflection exceeds the value of D as given in formula (1), the construction shall be considered to have passed the test if within 24 hours after the removal of the load the slabs or beams show a recovery of at least 75 per cent of the observed deflection.

Sec. 2606. For the design of reinforced concrete structures, the value of f'_c used for determining the working stresses as stipulated in Section 2613 shall be based on the specified minimum ultimate 28-day compressive strength of the concrete, or on the specified minimum ultimate compressive strength at the earlier age at which the concrete may be expected to receive its full load. All plans, submitted for approval or used on the job shall clearly show the assumed strength of concrete at a specified age for which all parts of the structure were designed.

Quality of Concrete

¹See "Specification Documents".

**TABLE No. I.—ASSUMED STRENGTH OF
CONCRETE MIXTURES**

Water-Content U. S. Gallons Per 94-lb. Sack of Cement		Assumed Compressive Strength at 28 Days
U.S. Gallons	Cu. Ft.	p. s. i.
7½	1.00	2000
6¾	.90	2500
6	.80	3000
5	.67	3750

NOTE: In interpreting this table, surface water contained in the aggregate must be included as part of the mixing water in computing the water-content.

All concrete exposed to freezing and thawing weather shall have a minimum ultimate 28-day compressive strength of not less than 3000 pounds per square inch. All other concrete shall have a minimum compressive strength of 2000 pounds per square inch.

The determination of the proportions of cement, aggregate and water to attain the required strengths shall be made by one of the following methods:

Strength- Quality of Materials

Method 1—Concrete made from average materials—When no preliminary tests of the materials to be used are made, the water-content per sack of cement shall not exceed the values in Table No. I of this chapter. Method 2 shall be employed when artificial aggregates or admixtures are used.

Method 2—Controlled Concrete—Proportions of the materials and water-content, other than those shown in Table No. I may be used provided that the strength-quality of the materials proposed for use in the structure shall be established by tests which shall be made in advance of the beginning of operations, using the consistencies suitable for the work and in accordance with the "Standard Method of Making Compression Tests of Concrete" (A. S. T. M. Designation C39-39)¹. A curve representing the relation between the water-content and the average 28-day compressive strength or earlier strength at which the concrete is to receive its full working load, shall be established for a range of values including all the compressive strengths called for on the plans. The curve shall be established by at least four points, each point representing average values from at least four test specimens. The water-content used in the concrete for the structure as determined from the curve, shall correspond to a strength which is 20 per cent greater than that called for on the plans, for concrete of a compressive strength less than 2500 pounds per square inch and 15 per cent greater for concrete of a compressive strength of 2500 pounds per square inch or more. No substitutions shall be made in the materials used on the work without additional tests in accordance herewith to show that the quality of the concrete is satisfactory.

¹See "Specification Documents".

Sec. 2607. The proportions of aggregate to cement for any concrete shall be such as to produce a mixture which will work readily into the corners and angles of the forms and around reinforcement with the method of placing employed on the work, but without permitting the materials to segregate or excess free water to collect on the surface. The combined aggregates shall be of such composition of sizes that when separated on the No. 4 standard sieve, the weight passing the sieve (fine aggregate) shall be not less than 30 per cent nor greater than 50 per cent of the total unless otherwise required by the Building Inspector, except that these proportions do not necessarily apply to light-weight aggregates.

**Proportions
and
Consistency**

Measurement of materials for ready mixed concrete shall conform to the "Standard Specifications for Ready Mixed Concrete" (A. S. T. M. Designation C94-38).

Admixtures of lime or finely pulverized inert materials may be added but not in excess of six per cent by volume of the cement used.

Sec. 2608. The methods of measuring concrete materials shall be such that the proportions of all materials can be accurately controlled during the progress of the work and easily checked at any time by the Building Inspector or his authorized representative. A tolerance of one-fourth gallon of water per sack of cement in any batch of concrete will be allowed provided that the average for any 10 consecutive batches does not show a water content greater than that shown in Table No. I of this Chapter, and on plans as specified in Section 2606.

**Control of
Proportions**

The method of delivering the aggregates to the work and of storing and handling shall be such that the moisture content of the aggregates as they come to the mixer shall not be subject to frequent or unnecessary changes.

Sec. 2609. (a) **Mixing.** The concrete shall be mixed until there is a uniform distribution of the materials and the mass is uniform in color and homogeneous. In machine mixing, only batch mixers shall be used. Each batch shall be mixed not less than one minute after all the materials are in the mixer and must be discharged completely before the mixer is recharged. Machine mixers shall have a peripheral speed of approximately two hundred feet (200') per minute.

**Mixing and
Placing
Concrete**

Ready mixed concrete shall be mixed and delivered in accordance with the requirements set forth in the "Standard Specifications for Ready Mixed Concrete" (A. S. T. M. Designation (C94-38)).

(b) **Cleaning Forms and Equipment.** Before concrete is placed all equipment for mixing and transporting the concrete shall be cleaned, all debris shall be removed from the spaces to be occupied by the concrete, forms shall be thoroughly wetted (except in freezing weather) or oiled, and masonry that will be in contact with concrete shall be well drenched (except in freezing weather). Reinforcement shall be thoroughly cleaned

¹ See "Specifications Documents."

Section 2609

and secured in position. Concrete shall not be placed until the forms and reinforcement have been inspected and approved by the Building Inspector.

(c) **Removal of Water From Excavations.** Water shall be removed from excavations before concrete is deposited, unless otherwise directed by the Building Inspector. Any flow of water into an excavation shall be diverted through proper side drains to a sump, or be removed by other approved methods which will avoid washing the freshly deposited concrete. Water vent pipes and drains shall be filled by grouting or otherwise, after the concrete has hardened thoroughly.

(d) **Transporting Concrete.** Concrete shall be handled from the mixer to the place of final deposit as rapidly as practicable by methods which shall prevent the separation or loss of the ingredients. It shall be deposited as nearly as practicable in its final position to avoid rehandling or flowing. Under no circumstances shall concrete that has attained its initial set be used.

Equipment for chuting, pumping and pneumatically conveying concrete shall be of such size and design as to insure a practically continuous flow of concrete at the delivery end without separation of the materials.

(e) **Placing.** Concrete shall be thoroughly compacted with suitable tools. When necessary, openings shall be provided in the forms to permit the placing of concrete in such a manner as to avoid accumulations of hardened concrete on the forms or reinforcing bars. The concrete shall be thoroughly worked around the reinforcement.

(f) **Curing.** Exposed surfaces of concrete shall be kept moist for a period of at least seven days after being deposited for ordinary cement and three days for high early strength cement.

(g) **Depositing in Cold Weather.** Adequate equipment shall be provided for heating the concrete materials and protecting the concrete during freezing or near-freezing weather. No frozen materials or materials containing ice shall be used.

All concrete materials and all reinforcement, forms, fillers and ground with which the concrete is to come in contact, shall be free from frost. Whenever the temperature of the surrounding air is below 40 degrees Fahrenheit all concrete placed in the forms shall have a temperature of between 70 degrees Fahrenheit and 100 degrees Fahrenheit, and adequate means shall be provided for maintaining a temperature of 50 degrees Fahrenheit for not less than 72 hours after placing or for as much more time as is necessary to insure proper curing of the concrete. No dependence shall be placed on salt or other chemicals for the prevention of freezing. Manure, when used for protection shall not be applied directly to concrete.

(h) **Bonding Fresh and Hardened Concrete.** Before new concrete is deposited on or against concrete which has set, the forms shall be re-tightened, the surface of the set concrete shall be roughened, cleaned of foreign matter and laitance and thor-

oughly wetted but not saturated. The cleaned and wetted surfaces of the hardened concrete, including vertical and inclined surfaces, shall first be slushed with a coating of 1:2 cement mortar against which the new concrete shall be placed before the mortar has attained its initial set.

Sec. 2610. (a) Design of Forms. Forms shall conform to the shape, lines and dimensions of the member as called for on the plans and shall be substantial and sufficiently tight to prevent leakage of mortar. They shall be properly braced or tied together so as to maintain position and shape. If adequate foundation for shores cannot be secured, trussed supports shall be provided.

Forms and Details of Construction

Temporary openings shall be provided at the base of column and wall forms, and at other points where necessary, to facilitate cleaning and inspection.

(b) Removal of Forms. Forms shall not be disturbed until the concrete has hardened sufficiently to permit their removal with safety. Shoring shall not be removed until the member has acquired sufficient strength to support safely its own weight and the load upon it. Members subject to additional loads during construction shall be adequately shored to support both the member and construction loads in a manner that will protect the member from damage.

The Building Inspector may require forms to remain in place for a specified time.

(c) Cleaning and Bending Reinforcement. Metal reinforcement, at the time concrete is placed, shall be free from rust scale or other coatings that will destroy or reduce the bond. Bends for stirrups and ties shall be made around a pin having a diameter not less than two times the minimum thickness of the bar. Bends for other bars shall be made around a pin having a diameter not less than six times the minimum thickness of the bar, except that for bars larger than one inch, the pin shall be not less than eight times the minimum thickness of the bar. All bars shall be bent cold.

(d) Placing Reinforcement. Metal reinforcement shall be accurately placed and secured and shall be supported by chairs, spacers, or hangers. The minimum clear distance between parallel bars shall be one and one-half times the diameter for round bars or one and one-half times the diagonal for square bars. The minimum clear distance between bars and forms shall be the diameter of round bars and the diagonal of square bars. If the ends of bars are anchored as specified in Section 2618, the clear spacing may be made equal to the diameter of round bars or to the diagonal of square bars, but in no case shall the spacing between bars be less than one inch (1"), nor less than one and one-third times the maximum size of the coarse aggregate. Bars shall be embedded a distance from any face of any member not less than the minimum distance as specified in Sec. 4301.

When wire or other reinforcement, not exceeding one-fourth inch ($\frac{1}{4}$ ") in diameter is used as reinforcement for slabs not exceeding ten feet (10') in span, the reinforcement may be

Section 2610

curved from a point near the top of the slab over the support to a point near the bottom of the slab at mid-span; provided such reinforcement is either continuous over, or securely anchored to the support.

(e) **Splices and Offsets in Reinforcement.** In slabs, beams and girders, splices of reinforcement shall not be made at points of maximum stress without the approval of the Building Inspector. Splices, where permitted, shall provide sufficient lap to transfer the stress between bars by bond and shear. In such splices the bars shall be spaced at the minimum distance specified in paragraph (d) of this Section.

Where changes in the cross section of a column occur, the longitudinal bars shall be offset in a region where lateral support is afforded. Where offset, the slope of the inclined portion shall not be more than 1 in 6, and in the case of tied columns the ties shall be spaced not over three inches (3") on centers for a distance of one foot (1') below the actual point of offset.

(f) **Protective Covering of Concrete.** At the under side of footings metal reinforcement shall have a minimum covering of three inches (3") of concrete.

In fire-resistive construction, metal reinforcement shall be protected as specified in Section 4301.

Exposed reinforcement bars intended for bonding with future extensions shall be protected from corrosion.

(g) **Construction Joints.** Joints not indicated on the plans shall be so made and located as least to impair the strength of the completed structure. Where a joint is to be made, any excess water and laitance shall be removed from the surface after concrete is deposited. Before depositing of concrete is resumed the hardened surface shall be treated as specified in paragraph (h) of Section 2609.

At least two hours must elapse after concrete is deposited in the columns or walls before depositing in beams, girders, or slabs supported thereon. Haunches and column capitals shall be considered as part of, and to act continuous with, the floor.

Construction joints in floors shall be located near the middle spans of slabs, beams or girders, unless a beam intersects a girder at this point, in which case the joints in the girders shall be offset a distance equal to twice the width of the beam. Provision shall be made for shear by use of reinforcement, inclined in both directions across the joint.

Pipes which will contain liquid, gas or vapor at other than room temperature shall not be embedded in concrete necessary for structural stability or fire protection. Drain pipes and pipes whose contents will be under pressure greater than atmospheric pressure by more than one pound per square inch shall not be embedded in structural concrete except in passing through from one side to the other of a floor, wall or beam. Electric conduits and other pipes whose embedment is allowed shall not, with their fittings, displace that concrete of a column on which stress is calculated or which is required for fire protection, to greater extent than four per cent of the area of the cross section. Sleeves or other pipes passing through floors, walls or beams shall not be of such size or in such location as unduly to impair the strength of the construction; such sleeves or pipes

Sections 2610-2612

may be considered as replacing structurally the displaced concrete, provided they are not exposed to rusting or other deterioration, are of uncoated iron or steel not thinner than standard wrought-iron pipe, have a nominal inside diameter not over two inches, and are spaced not less than three diameters on centers. Embedded pipes or conduits other than those merely passing through shall not be larger in outside diameter than one-third the thickness of the slab, wall or beam in which they are embedded; shall not be spaced closer than three diameters on centers, nor so located as unduly to impair the strength of the construction. Circular uncoated or galvanized electric conduit of iron or steel may be considered as replacing the displaced concrete.

Sec. 2611. The design of reinforced concrete members shall be made with reference to working stresses and safe loads. The accepted theory of flexure as applied to reinforced concrete shall be applied to all members resisting bending. The following assumptions shall be made:

Assumptions
for Design

(1) The steel takes all the tensile stress.

(2) In determining the ratio n for design purposes, the modulus of elasticity for the concrete shall be taken as $1000f'_c$, and that for steel as 30,000,000 pounds per square inch.

Sec. 2612. The symbols and notations used in these regulations are defined as follows:

Symbols and
Notations

- a = Width of face of column or pedestal.
- α = Angle between inclined web bars and axis of beam.
- A = Total area of top of pedestal, pier, or footing at the column base; the span length between opposite supports in one direction (floors with supports on four sides).
- A' = Loaded area of pedestal, pier, or footing at the column base.
- A_c = Area of core of a spirally-reinforced column measured to the outside diameter of the spiral; net area of concrete section of a composite column.
- A_g = The overall or gross area of spirally-reinforced or tied columns; the total area of the concrete encasement of combination columns.
- A_s = Area of the steel or cast iron core of a composite column; the area of the steel core in a combination column.
- A_t = Effective cross-sectional area of reinforcement in tension in beams or in compression in columns; the effective cross-sectional area of reinforcement which crosses any of the principal design sections of a flat slab.
- A_w = Total area of web reinforcement in tension within a distance of s , or the total area of all bars bent up in any one plane.
- b = Width of rectangular beam or width of flange of T-beam.
- b' = Thickness of web in beams of I or T sections.
- b_1 = Dimension of the dropped panel of a flat slab in the direction parallel to l_1
- B = Span at right angles to span A (floors with supports on four sides).
- c = Diameter, in feet, of column capital of a flat slab at the underside of the slab, or dropped panel. No portion of

Section 2612

**Symbols
and
Notations
(Con't.)**

the column capital shall be considered for structural purposes which lies outside of the largest 90° cone that can be included within the outlines of the column capital; distance from gravity axis to extreme fiber in compression (in a column).

- d = Depth from compression face of beam or slab center to of longitudinal tensile reinforcement; the least lateral dimension of a concrete column; the diameter of a round bar or side of a square bar.
- D = Deflection of a floor member under test load.
- e = Eccentricity of the resultant load on a column, measured from the gravity axis.
- $e_A \}$ = Plate action factors for spans A and B respectively.
 $e_B \}$ (Floors with supports on four sides.)
- E_c = Modulus of elasticity of concrete in compression.
- E_s = Modulus of elasticity of steel in tension or compression (30,000,000 lbs. per sq. in.).
- f_c = Compressive unit stress in extreme fiber of concrete in flexure or axial compression in concrete columns.
- f'_c = Ultimate compressive strength of concrete *usually* at age of 28 days. (See Section 2606).
- f_r = Permissible unit stress in the metal core of a composite column.
- f'_r = Permissible unit stress on unencased steel columns and pipe columns.
- f_s = Tensile unit stress in longitudinal reinforcement; nominal working stress in vertical column reinforcement.
- f'_s = Useful limit stress of spiral reinforcement.
- f_w = Tensile unit stress in web reinforcement.
- F_A = Ratio of the distance between assumed inflection points of the span A to span B in an isolated strip extending the entire width of the structure when a uniformly distributed load is applied to span A only (floors with supports on four sides).
- F_B = Ratio as defined above, but applying to Span B (floors with supports on four sides).
- $F_{AA} \}$ = The distances, assumed for purposes of load distribution,
 $F_{BB} \}$ between inflection points in spans A and B respectively (floors with supports on four sides).
- h = Unsupported length of column.
- I = Moment of inertia of a section about the neutral axis for bending.
- j = Ratio of distance between centroid of compression and centroid of tension to the depth (d).
- K = Least radius of gyration of a metal pipe section (in pipe columns); the stiffness factor, that is, the moment of inertia divided by the span (floors with supports on four sides.)
- K_A = Stiffness factor $\left(\frac{I}{A}\right)$ for span A of panel AB (floors with supports on four sides).
- K_B = Stiffness factor $\left(\frac{I}{B}\right)$ for span B of panel AB (floors with supports on four sides).
- $K_{AR} \}$ = Stiffness factor for spans to right and left respectively
 $K_{AL} \}$ of span A (floors with supports on four sides).

19 (11)

Section 2612

- Symbols and Notations (Con't.)**
- K_{BR} = Stiffness factor for spans to right and left respectively of span B (floors with supports on four sides).
- K_{BL} = Span length of beam or slab; span length of flat slab (usually expressed in feet) center to center of columns in the direction in which moments are considered (see Section 2619).
- l_1 = Span length of flat slab panel center to center of columns, perpendicular to the rectangular direction in which moments are considered.
- l' = Clear span for positive moment and the average of the two adjacent clear spans for negative moment (see Section 2614 [a]).
- L = Span of member under load test (see Section 2605).
- M = Bending moment or moment of resistance in general.
- M_o = Sum of positive and negative bending moments at the principal design sections of a panel of a flat slab.
- n = Ratio of modulus of elasticity of steel to that of concrete
- $$= \frac{E_s}{E_c}$$
- N = The sum of the lengths of those edges of panel AB supporting continuous adjacent spans (floors with supports on four sides).
- Σo = Sum of perimeters of bars in one set.
- p = Ratio of effective area of tensile reinforcement to effective area of concrete in beams.
- p_t = Ratio of effective cross-sectional area of vertical reinforcement to the gross area A_g (see Section 2620).
- p' = Ratio of volume of spiral reinforcement to the volume of the concrete core (out to out of spirals) of a spirally reinforced concrete column.
- P = Total allowable axial load on a column whose length does not exceed 10 times its least cross-sectional dimension.
- P' = Total allowable axial load on a column.
- r_a = Permissible unit working stress in concrete over the loaded area of a pedestal, pier, or footing.
- r_A = Load distribution factors, that is, the proportion of total load ($w'AB$) carried in the directions A and B respectively (floors supported on four sides).
- r_B
- R = Least radius of gyration of a section; ratio of gross area to core area of a spirally-reinforced concrete column,
- $$\frac{A_g}{A_c}$$
- s = Spacing of stirrups or of bent bars in a direction parallel to that of the main reinforcement.
- t = Thickness of the flange of T-beams; the total thickness or depth of a member under load test.
- t_1 = Thickness of flat slab without dropped panels; or the thickness of flat slabs, including dropped panels where such are used.
- t_2 = Thickness of flat slabs with dropped panels at points outside the dropped panel.
- t_3 = Total thickness of slab (floors supported on four sides).
- u = Bond stress per unit of surface area of bar.

Sections 2612-2613

- v = Shearing unit stress.
 v_c = Unit shearing stress permitted on the concrete of the web.
 V = Total shear.
 V' = Excess of the total shear over that permitted on the concrete.
 w = Uniformly distributed load per unit of length of beam or slab.
 w' = Uniformly distributed dead and live load per unit of area of a floor or roof.
 W = Total dead and live load uniformly distributed over a single panel area.

Working Stresses

Sec. 2613. As specified in Section 2606, the structural drawings and plans shall show the ultimate strength of concrete for which the several parts of the structures were designed. The working stresses for the design of buildings or

**TABLE NO. II—ALLOWABLE UNIT STRESSES
IN CONCRETE**

Description		For Any Strength of Concrete as Fixed by Test in Accordance with Sec. 2606 $n = 30000$ f_c	Allowable Unit Stresses			
			When Strength of Concrete is Fixed by the Water-Content in Accordance with Sec. 2606			
			$f_c = 2000$ p. s. i. $n = 15$	$f_c = 2500$ p. s. i. $n = 12$	$f_c = 3000$ p. s. i. $n = 10$	$f_c = 3750$ p. s. i. $n = 8$
Flexure: f_c						
Extreme fiber stress in compression	f_c	$0.40f_c$	800	1000	1200	1500
Extreme fiber stress in compression adjacent to supports of continuous or fixed beams or of rigid frames	f_c	$0.45f_c$	900	1125	1350	1688
Shear: v						
Beams with no web reinforcement and without special anchorage of longitudinal steel	v_c	$0.02f_c$	40	50	60	75
Beams with no web reinforcement, but with special anchorage of longitudinal steel	v_c	$0.03f_c$	60	75	90	113
Beams with properly designed web reinforcement but without special anchorage of longitudinal steel	v	$0.06f_c$	120	150	180	225
Beams with properly designed web reinforcement and with special anchorage of longitudinal steel	v	$0.12f_c$	240	300	360	450
Flat slabs at distance d from edge of column capital or dropped panel	v_c	$0.03f_c$	60	75	90	113
Footings where longitudinal bars have no special anchorage	v_c	$0.02f_c$	40	50	60	75
Footings where longitudinal bars have special anchorage	v_c	$0.03f_c$	60	75	90	113
Bond: u						
In beams and slabs and one-way footings: Plain bars or structural shapes	u	$0.04f_c$	80	100	120	150
Deformed bars	u	$0.05f_c$	100	125	150	188
In two-way footings: Plain bars or structural shapes	u	$0.03f_c$	60	75	90	113
Deformed bars	u	$0.0375f_c$	75	94	112	141
(Where special anchorage is provided (see Sec. 2618c), one and one-half times these values in bond may be used.)						
Bearing: f_c						
On full area	f_c	$0.25f_c$	500	625	750	938
On one-third area*	f_c	$0.375f_c$	750	938	1125	1405
Footings (see Sec. 2621e)	v_c					

*The allowable bearing stress on an area greater than one-third but less than the full area shall be interpolated between the values given.

1940

Sections 2613-2614

structures shall be based on the ultimate strength indicated on the drawings as specified in Section 2606 and shall be in the ratios specified in this Chapter. The ultimate strength (f_u) shall be the average strength attained at 28 days, based on six-inch by twelve-inch (6"x12") or eight-inch by sixteen-inch (8"x16") cylinders made, cured and tested in accordance with the "Standard Methods of Making and Storing Specimens of Concrete in the Field" (A. S. T. M. Designation C31-39)' and "Standard Methods of Making Compression Tests of Concrete" (A. S. T. M. Designation C39-39)' of the American Society for Testing Materials. Guniting test cylinders shall be made in a manner that will permit the blast of air to compact firmly the materials and provide proper escapement of the air to eliminate possible back pressure, and such cylinders shall be cured and tested as specified above.

The unit stresses in pounds per square inch on concrete to be used in the design shall not exceed the values shown in Table No. II of this Chapter where f_c equals the minimum ultimate compressive strength at 28 days.

The following unit stresses in reinforcing steel shall not be exceeded:

Allowable Unit Stresses in Reinforce- ment

Tension:

Intermediate grade billet steel.....	(f_s) = 20,000 p. s. i.
Rail steel bars.....	(f_s) = 20,000 p. s. i.
Web reinforcement	(f_s) = 20,000 p. s. i.
Structural steel shape.....	(f_s) = 18,000 p. s. i.
Wire mesh or other steel reinforcement, not exceeding ¼ inch in diameter (used in one-way slabs), 50 per cent of the minimum yield point as established by the A. S. T. M. Standards for the particular grade of steel used; but not to exceed.....	(f_s) = 30,000 p. s. i.

Compression

Structural steel section in composite columns	16,000 p. s. i.
Cast-iron section in composite columns	10,000 p. s. i.

Note: If special conditions require the use of billet-steel concrete reinforcement bars of structural or hard grades, the allowable unit stress shall not exceed 18,000 p. s. i. for structural grade nor 20,000 p. s. i. for hard grade bars.

Sec. 2614. All members shall be designed to resist at all sections the maximum bending moments and shears produced by dead load, live load and other loads, as determined by the principle of continuity. In the case of approximately equal spans with loads uniformly distributed, where the intensity of live load does not exceed three times the intensity of dead load, this is satisfied essentially by the following moments:

Flexural Computations

¹See "Specification Documents".

Section 2614

Negative moment at face of first interior support:

For beams and girders and for slabs exceeding 10 feet:

$$\text{Two spans} \quad \frac{1}{8} w l'^2$$

$$\text{More than two spans} \quad \frac{1}{10} w l'^2$$

For slabs not exceeding 10 feet in span

$$\text{Two spans} \quad \frac{1}{10} w l'^2$$

$$\text{More than two spans} \quad \frac{1}{12} w l'^2$$

Negative moment at face of other interior supports

$$\frac{1}{12} w l'^2$$

Positive moment at center of span

$$\text{End spans} \quad \frac{1}{10} w l'^2$$

$$\text{Interior spans} \quad \frac{1}{12} w l'^2$$

$$\text{Shear in end members at first interior support} \quad 1.20 \frac{w l'}{2}$$

$$\text{Shear at other supports} \quad \frac{w l'}{2}$$

For the purpose of applying this method "approximately" shall be construed to mean that the longer of two adjacent spans shall not exceed the shorter by more than 20 per cent. In these expressions l' = the clear span for positive moments and the average of the two adjacent clear spans for negative moment.

(a) **Permissible Assumptions.** The span length of freely supported beams and slabs shall be the clear span plus the depth of beam or slab, but shall not exceed the distance between centers of the supports.

In the application of the principle of continuity, the following assumptions shall be permissible:

1. Consideration may be limited to combinations of dead load on all spans with full live load on two adjacent spans and with full live load on alternate spans.

2. Any reasonable and consistent assumption may be made as to the relative stiffness of the floor construction and columns. In computing the relative stiffness of floors to columns, the value I of the floor members may be based on the entire concrete section neglecting the reinforcement, and that of columns on the entire concrete section plus the transformed steel section. The moment of inertia assumed for the columns in computing bending moments must also be used in computing stresses.

Section 2614

Flexural
Computations
(Con't.)

3. The far ends of columns above and below the floor under consideration may be considered fixed.

4. When members are deepened near their ends by haunches they may be analyzed as members of constant section provided the minimum depth is used throughout in computing stresses due to bending; otherwise a complete analysis is required. Where members are widened near their supports the additional width may be neglected in computing moments but may be used in computing stresses.

Additional section at the end may in any case be utilized in resisting shear if properly reinforced.

5. Where slabs of uniform thickness are built integrally with their supports the span length may be taken equal to the clear span between faces of supports and the width of support otherwise neglected.

6. In the application of the principle of continuity, center to center distances may be used in the moment determination of all members.

Moments prevailing at the faces of support may be used to proportion the members at these sections.

7. In slabs other than ribbed floor construction or flat slabs, the principal reinforcement shall not be spaced farther apart than three times the slab thickness.

8. All beams except cantilevers shall have positive reinforcement of not less than .005 $b'd$.

9. Not less than .005 $b'd$ of negative reinforcement shall be provided at the outer end of members built integrally with their supports.

10. Where analysis indicates negative reinforcement along the full length of a span, the reinforcement need not be extended beyond the point where the required amount is .0025 $b'd$ or less.

11. In slabs of uniform thickness the minimum amount of reinforcement in the direction of principal stress shall be

For structural, intermediate and hard grades and rail
steel..... .0025 bd

For steel having a minimum yield point of 56,000 lb.
per sq. in..... .002 bd

(b) **Distance between Lateral Supports.** The clear distance between lateral supports of a beam shall not exceed 32 times the least width of compression flange.

(c) **Depth of Beam or Slab.** The depth of the beam or slab shall be taken as the distance from the centroid of the tensile reinforcement to the compression face of the structural members. Any floor finish not placed monolithically with the floor slab shall not be included as a part of the structural member. When the finish is placed monolithically with the structural slab in buildings of the warehouse or industrial class, the over-all depth shall be at least one-half inch ($\frac{1}{2}$ ") over that required by the design of the member.

Section 2614

T-Beams

(d) **Requirements for T-Beams.** 1. In T-beam construction the slab and beam shall be built integrally or otherwise effectively bonded together. The effective flange width to be used in the design of symmetrical T-beams shall not exceed one-fourth of the span length of the beam, and its overhanging width on either side of the web shall not exceed eight times the thickness of the slab nor one-half the clear distance to the next beam.

2. For beams having a flange on one side only, the effective overhanging flange width shall not exceed one-twelfth of the span length of the beam, nor six times the thickness of the slab, nor one-half the clear distance to the nearest beam.

3. Where the principal reinforcement in a slab which is considered as the flange of a T-beam (not a rib in ribbed floors) is parallel to the beam, transverse reinforcement shall be provided in the top of the slab. This reinforcement shall be designed to carry the load on the portion of the slab assumed as the flange of the T-beam. The spacing of the bars shall not exceed five times the thickness of the flange, nor in any case eighteen inches (18").

4. Provisions shall be made for the compressive stress at the support in continuous T-beam construction, care being taken that the provisions of Section 2610 relating to the spacing of bars, and Section 2609(e), relating to the placing of concrete shall be fully met.

5. The overhanging portion of the flange of the beam shall not be considered as effective in computing the shear and diagonal tension resistance of T-beams.

6. Isolated beams in which the T-form is used only for the purpose of providing additional compression area, shall have a flange thickness not less than one-half the width of the web and a total flange width not more than four times the web thickness.

Ribbed Floors

(e) **One-way Ribbed Floor Construction.** 1. Ribbed floor construction consists of concrete ribs and slabs placed monolithically with or without burned clay or concrete tile fillers. The ribs shall not be farther apart than thirty inches (30") face to face. The ribs shall be straight, not less than four inches (4") wide, nor of a depth more than three times the width.

2. When burned clay or concrete tile fillers, of material having a unit compressive strength at least equal to that of the designed strength of the concrete in the ribs, are used, and the fillers are so placed that the joints in alternate rows are staggered, the shells of the fillers in contact with the ribs may be included in the calculations involving shear or negative bending moment. No other portion of the fillers may be included in the design calculations.

3. The concrete slab over the fillers shall be not less than one and one-half inches ($1\frac{1}{2}$ ") in thickness, nor less in thickness than one twelfth of the clear distance between ribs. Shrinkage reinforcement in the slab shall be provided as required in Section 2615.

4. Where removable forms or fillers not complying with (2) are used, the thickness of the concrete slab shall not be less than one-twelfth of the clear distance between ribs and in no case less than two inches (2"). Such slab shall be reinforced at right angles to the ribs with a minimum of .049 square inches of reinforcing steel per foot of width, and in slabs on which the prescribed live load does not exceed 50 pounds per square foot, no additional reinforcement will be required.

5. When the finish used as a wearing surface is placed monolithically with the structural slab in buildings of the warehouse or industrial class, the thickness of the concrete over the fillers shall be one-half inch ($\frac{1}{2}$ ") greater than the thickness used for design purposes.

6. Where the slab contains conduits or pipes, the thickness shall be not less than one inch (1") plus the total over-all depth of such conduits or pipes at any point. Such conduits or pipes shall be so located as not to impair the strength of the construction.

(f) **Compression Steel in Flexural Members.** Where it is necessary to introduce steel in compression in girders, beams, or slabs, such steel shall be thoroughly anchored by ties or stirrups not less than one-fourth inch ($\frac{1}{4}$ ") in size which shall be spaced not more than eight inches (8") apart over the distance where the compression steel is required.

Sec. 2615. Reinforcement for shrinkage and temperature stresses normal to the principal reinforcement shall be provided in floor and roof slabs where the principal reinforcement extends in one direction only. Such reinforcement shall provide for the following minimum ratios of reinforcement area to concrete area (bd), but in no case shall such reinforcing bars be placed farther apart than five times the slab thickness nor more than eighteen inches (18").

Shrinkage and Temperature Reinforcement

Floor slabs where plain bars are used.....	0.0025
Floor slabs where deformed bars are used.....	0.002
Floor slabs where wire fabric is used, having welded intersections not farther apart in the direction of stress than 12 inches.....	0.0018
Roof slabs where plain bars are used.....	0.003
Roof slabs where deformed bars are used.....	0.0025
Roof slabs where wire fabric is used, having welded intersections not farther apart in the direction of stress than 12 inches.....	0.0022

Sec. 2616. (a) General Provisions. This construction, consisting of floors reinforced in two directions and supported on four sides, includes solid reinforced concrete slabs; concrete ribs with burned clay or concrete tile fillers, with or without concrete top slabs; and concrete ribs with top slabs placed monolithically with the ribs. The supports for the floor slabs may be walls, reinforced concrete beams, or steel beams fully encased in concrete.

Two-Way Slabs

When burned clay or concrete tile fillers, of material having a unit compressive strength at least equal to that of the designed strength of the concrete in the ribs, are used, the shells in contact with the concrete ribs may be included in calculations

Section 2616

Two-Way Slabs (Cont'd.)

involving resistance to shear and bending moment, and the top and bottom shells may be included in calculations involving resistance to bending moment.

When a concrete top slab, placed monolithically with the ribs is used, it shall be not less in thickness than one and one-half inches ($1\frac{1}{2}$ ") nor less than one-twelfth of the clear distance between ribs. It shall be reinforced for shrinkage as required in Section 2615.

Where removable forms or fillers not complying with this Subsection are used, the thickness of the concrete slab shall be not less than one-twelfth of the clear distance between ribs and in no case less than two inches (2"). Such slab shall be reinforced to provide sufficient strength to carry the imposed loads.

(b) **Factors.** The values of the factors to be used in computations are as follows:

1. For simple spans

$$F_A = F_B = 1$$

2. For end spans, continuous at one end only

$$F_A = 1 - \left[\frac{.25}{1 + \frac{7 K_A}{8 K_{AR}}} \right] \dots\dots\dots (2)$$

$$F_B = 1 - \left[\frac{.25}{1 + \frac{7 K_B}{8 K_{BR}}} \right] \dots\dots\dots (3)$$

3. For interior continuous spans

$$F_A = \frac{1}{2} \sqrt{1 - U_{AR}} + \frac{1}{2} \sqrt{1 - U_{AL}} \dots\dots\dots (4)$$

$$F_B = \frac{1}{2} \sqrt{1 - U_{BR}} + \frac{1}{2} \sqrt{1 - U_{BL}} \dots\dots\dots (5)$$

in which

$$U_{AR} = \frac{1}{1.5 + \frac{7 K_A}{8 K_{AR}}}$$

and

$$U_{AL} = \frac{1}{1.5 + \frac{7 K_A}{8 K_{AL}}}$$

4. For strips rigidly anchored to the supports

$$e_A = \frac{2}{4 - D_B} \text{ (for span A)} \dots\dots\dots (6)$$

$$e_B = \frac{2}{4 - D_A} \text{ (for span B)} \dots\dots\dots (6a)$$

Section 2616

Two-Way
Slabs

in which

$$D_A = \frac{F_{AA}}{F_{BB}}$$

$$D_B = \frac{F_{BB}}{F_{AA}}$$

5. For strips not rigidly anchored at one or both ends, and for ribbed construction without filler blocks

$$e_A = 1.0 \text{ (for span } A\text{)}$$

$$e_B = 1.0 \text{ (for span } B\text{)}$$

6. Load distribution factor

$$r_A = \frac{1}{1 + D_A^3} \text{ (for span } A\text{)} \dots \dots \dots (7)$$

$$r_B = 1 - r_A \text{ (for span } B\text{)} \dots \dots \dots (7a)$$

(c) **Slab Thickness.** The minimum thickness of the slab which shall not be less than 4 inches shall be computed by formula (8).

$$t_s = \frac{A + B - 0.10 N}{72} \sqrt[3]{\frac{2000}{f'_c}} \dots \dots \dots (8)$$

(d) **Bending Moments.** The bending moments at any section of any strip one foot wide, extending the full length of the continuous slab, shall be determined on the basis of the recognized principles of mechanics relating to continuous beams for those conditions of loading which cause maximum moment at any section, using an equivalent uniform load of $e_A r_A w$ in the A direction, and $e_B r_B w$ in the B direction.

(e) **Supporting Beams.** (1) For span A, the maximum bending moments in the supporting beams may be determined from an equivalent uniformly distributed load per linear foot equal to

$$w \frac{B}{2} (1 - e_A r_A) \dots \dots \dots (9)$$

(2) For span A, the maximum shear in the supporting beams may be determined by formula (10).

$$w \frac{BA}{4} (1 - r_A) \dots \dots \dots (10)$$

(3) For the purpose of computing shear and bending moments at intermediate points for the supporting beams of span A, the total load from a two-way panel AB, carried on the beam of span A shall at least be equal to

$$\text{Total Load} = w \frac{BA}{2} (1 - r_A), \text{ considered uniformly varying in intensity}$$

$$\text{from } w \frac{B}{2} (1 + 2r_A - 3e_A r_A) \text{ at the center} \dots \dots \dots (11)$$

$$\text{to } w \frac{B}{2} (1 - 4r_A + 3e_A r_A) \text{ at the supports} \dots \dots \dots (11a)$$

(4) For span B , in the foregoing formulas, replace A with B , B with A , r_A with r_B , and e_A with e_B .

(f) **Panels of Approximately Uniform Stiffness.** When the ratio of the stiffness factor of the span under consideration to that of each adjacent span is at least $\frac{1}{3}$ and at most $\frac{3}{2}$, F_A or F_B , may be taken as 0.76 for interior spans, 0.87 for end spans and 1.0 for simple spans.

(g) **Shear in Slab.** 1. For purposes of determining shear in the strip one foot wide carrying the maximum load, the total load for the length of span A shall be

$$\begin{aligned} \text{Total Load} &= r_{Aw}A, \text{ considered uniformly varying in intensity} \\ &\quad \text{from } r_{Aw}(3e_A - 2) \text{ at the center of the span} \dots\dots\dots (12) \\ &\quad \text{to } r_{Aw}(4 - 3e_A) \text{ at the supports} \dots\dots\dots (12a) \end{aligned}$$

2. Similarly, the total load carried on a strip one foot (1') wide for the length of span B shall be

$$\begin{aligned} \text{Total Load} &= r_{Bw}B, \text{ considered uniformly varying in intensity} \\ &\quad \text{from } r_{Bw}(3e_B - 2) \text{ at the center of the span} \dots\dots\dots (13) \\ &\quad \text{to } r_{Bw}(4 - 3e_B) \text{ at the supports} \dots\dots\dots (13a) \end{aligned}$$

(h) **Arrangement of Reinforcement.** 1. In any panel, the reinforcement per unit width in the long direction shall be at least one-third of that provided in the short direction.

2. The positive moment reinforcement adjacent to a continuous edge only and for a width not exceeding one-fourth of the shorter dimension of the panel may be reduced 25 per cent.

3. At a non-continuous edge negative moment reinforcement per unit width in amount at least as great as one-half that required for maximum positive moment for the center half of the panel shall be provided across the entire width of the exterior support.

4. The spacing of the reinforcement shall be not more than three times the slab thickness and the ratio of reinforcement shall be at least 0.0025.

5. The amount of reinforcement in any one foot wide strip shall be at least 0.003 times the product of the width of strip by the effective depth.

Shear and Diagonal Tension

Sec. 2617. (a) **Shearing Unit Stress.** The shearing unit stress (v) in reinforced concrete beams shall be computed by formula (14):

$$v = \frac{V}{b'jd} \dots\dots\dots (14)$$

For beams of I or T section b' shall be substituted for b in formula (14).

In ribbed construction, where burned clay or concrete tile are used, b' may be taken as a width equal to the thickness of the concrete web plus the thickness of the vertical shells of the concrete or burned clay tile in contact with the joist as specified in Sections 2614 and 2616.

Where the value of the shearing unit stress computed by formula (14) exceeds the shearing unit stress (v_s) permitted

Section 2617

on the concrete of an unreinforced web (see Section 2613), web reinforcement shall be provided to carry the excess.

(b) **Types of Web Reinforcement.** Web reinforcement may consist of:

1. Stirrups or web reinforcement bars perpendicular to the longitudinal steel.

2. Stirrups or web reinforcement bars welded or otherwise rigidly attached to the longitudinal steel and making an angle of 30 degrees or more thereto.

3. Longitudinal bars bent so that the axis of the inclined portion of the bar makes an angle of 15 degrees or more with the axis of the longitudinal portion of the bar.

4. Special arrangements of bars with adequate provisions to prevent slip of bars or splitting of the concrete by the reinforcement [See Subsection (d) last paragraph].

Stirrups or other bars to be considered effective as web reinforcement shall be anchored at both ends, according to the provisions of Section 2618.

(c) **Stirrups.** The area of steel required in stirrups placed perpendicular to the longitudinal reinforcement shall be computed by formula (15).

$$A_s = \frac{V's}{f_v jd} \dots \dots \dots (15)$$

Inclined stirrups shall be proportioned by formula (17).

Stirrups placed perpendicular to the longitudinal reinforcement shall not be used alone as web reinforcement when the shearing unit stress (v) exceeds $0.08f'_c$.

(d) **Bent Bars.** When the web reinforcement consists of a single bent bar or of a single group of bent bars the required area of such bars shall be computed by formula (16).

$$A_s = \frac{V'}{f_v \sin \alpha} \dots \dots \dots (16)$$

In formula (16) V' shall not exceed $0.040f'_c bjd$.

Only the center three-fourths of the inclined portion of such bar, or group of bars, shall be considered effective as web reinforcement.

Where there is a series of parallel bent bars, the required area shall be determined by formula (17).

$$A_s = \frac{V's}{f_v jd (\sin \alpha + \cos \alpha)} \dots \dots \dots (17)$$

When bent bars having a radius of bend of not more than two times the diameter of the bar are used alone as web reinforcement, the allowable shearing unit stress shall not exceed $0.060f'_c$. This shearing unit stress may be increased at the rate of $0.01f'_c$ for each increase of four bar diameters in the radius of bend until the maximum allowable shearing unit stress is reached. (See Section 2613).

The shearing unit stress permitted when special arrangements of bars are employed shall be that determined by making

Sections 2617-2618

comparative tests, to destruction, of specimens of the proposed system and of similar specimens reinforced in conformity with the provisions of this Code, the same factor of safety being applied in both cases.

(e) **Combined Web Reinforcement.** Where more than one type of reinforcement is used to reinforce the same portion of the web, the total shearing resistance of this portion of the web shall be assumed as the sum of the shearing resistances computed for the various types separately. In such computations the shearing resistance of the concrete shall be included only once, and no one type of reinforcement shall be assumed to resist more than $\frac{2V}{3}$.

(f) **Spacing of Web Reinforcement.** Where web reinforcement is required it shall be so spaced that every 45 degree line (representing a potential crack) extending from the mid-depth of the beam to the longitudinal tension bars shall be crossed by at least one line of web reinforcement. If a unit shearing stress in excess of $0.06f'_c$ is used, every such line shall be crossed by at least two such lines of web reinforcement.

(g) **Shearing Stress in Flat Slabs.** In flat slabs, the shearing unit stress on a vertical section which lies at a distance $t_1 - 1\frac{1}{2}$ inches beyond the edge of the column capital and parallel with it, shall not exceed the following values when computed by formula (14) (in which d shall be taken as $t_1 - 1\frac{1}{2}$ inches):

1. $0.03 f'_c$, when at least 50 per cent of the total negative reinforcement in the column strip passes directly over the column capital.

2. $0.025 f'_c$, when 25 per cent of the total negative reinforcement in the column strip passes directly over the column capital.

3. For intermediate percentages, intermediate values of the shearing unit stress shall be used.

In flat slabs, the shearing unit stress on a vertical section which lies at a distance of $t_1 - 1\frac{1}{2}$ inches beyond the edge of the dropped panel and parallel with it shall not exceed $0.03 f'_c$, when computed by formula (14) in which d shall be taken as $t_1 - 1\frac{1}{2}$ inches. At least 50 per cent of the cross-sectional area of the negative reinforcement in the column strip must be within the width of strip directly above the dropped panel.

(h) **Shear and Diagonal Tension in Footings.** The shearing unit stress computed by formula (14) on the critical section [see Section 2621 (d)], shall not exceed $0.02 f'_c$ for footings with straight bars, nor $0.03 f'_c$ for footings in which the bars are anchored at both ends by adequate hooks or as otherwise specified in Section 2618.

Sec. 2618 (a) Computation of Bond Stress in Beams. In flexural members in which the tensile reinforcement is parallel to the compression face, the bond stress at any cross section shall be computed by formula (18).

$$u = \frac{V}{\sum_o j d} \quad (18)$$

In which V is the shear at that section.

Bond and Anchorage

Adequate end anchorage shall be provided for the tensile reinforcement in all flexural members to which formula (18) does not apply, such as footings, brackets and other tapered or stepped beams in which the tensile reinforcement is not parallel to the compression face.

(b) **Ordinary Anchorage Requirements.** Tensile negative reinforcement in any span of a continuous, restrained, or cantilever beam, or in any member of a rigid frame shall be adequately anchored by bond, hooks or mechanical anchors in or through the supporting member. Within any such span every reinforcing bar shall be extended at least 12 diameters beyond the point at which it is no longer needed to resist stress. In cases where the length from the point of maximum tensile stress in the bar to the end of the bar is not sufficient to develop this maximum stress by bond, the bar shall extend into a region of compression and be anchored by means of a standard hook or it shall be bent across the web at an angle of not less than 15 degrees with the longitudinal portion of the bar and either made continuous with the positive reinforcement or anchored in a region of compression.

Of the positive reinforcement in continuous beams not less than one-fourth the area shall extend along the same face of the beam into the support a distance of 10 or more bar diameters, or shall be extended as far as possible into the support and terminated in standard hooks.

In simple beams, or at the outer ends of freely supported end spans of continuous beams, at least one-half the positive reinforcement shall extend along the same face of the beam into the support a distance of 10 or more bar diameters, or shall be extended as far as possible into the support and terminated in standard hooks.

(c) **Special Anchorage Requirements.** Where increased shearing or bond stresses are permitted because of the use of special anchorage (see Section 2613), every bar shall be terminated in a standard hook in a region of compression, or it shall be bent across the web at an angle of not less than 15 degrees with the longitudinal portion of the bar and made continuous with the negative or positive reinforcement.

(d) **Anchorage of Web Reinforcement.** Single separate bars used as web reinforcement shall be anchored at each end by one of the following methods:

1. Welding to longitudinal reinforcement.
2. Hooking tightly around the longitudinal reinforcement through 180 degrees.
3. Embedment in the compression area of the beam a distance sufficient to develop the allowable tensile stress specified in Section 2613 at a bond stress not exceeding $0.04f'_c$ on plain bars nor $0.05f'_c$ on deformed bars.
4. Standard hook plus embedment in the compression area of the beam, which embedment exclusive of the hook shall be sufficient to develop by bond a stress of not less than 10,000 pounds per square inch at a bond stress of not more than $0.04f'_c$ on plain bars nor $0.05f'_c$ on deformed bars.

Section 2618

Bond and Anchorage (Con't)

The extreme ends of bars forming simple *U* or multiple stirrups shall be anchored by one of the methods of Subsection (d) or shall be bent through an angle of at least 90 degrees tightly around a longitudinal reinforcing bar not less in diameter than the stirrup bar, and shall project beyond the bend at least 12 diameters of the stirrup bar.

The loops or closed ends of such stirrups shall be anchored by bending around the longitudinal reinforcement through an angle of at least 90 degrees, or by being welded or otherwise rigidly attached thereto.

Hooking or bending stirrups or separate web reinforcement bars around the longitudinal reinforcement shall be considered effective only when these bars are perpendicular to the longitudinal reinforcement.

Longitudinal bars bent to act as web reinforcement shall, in a region of tension, be continuous with the longitudinal reinforcement. The tensile stress in each bar shall be fully developed in both the upper and the lower half of the beam by one of the following methods:

I. As specified in Subsection (d-3).

II. As specified in Subsection (d-4).

III. By bond, at unit bond stress not exceeding $0.04f'_c$ on plain bars nor $0.05f'_c$ on deformed bars, plus a bend of radius not less than two times the diameter of the bar, parallel to the upper or lower surface of the beam, plus an extension of the bar of not less than 12 diameters of the bar terminating in a standard hook. This short radius bend extension and hook shall together not be counted upon to develop a tensile unit stress in the bar of more than 10,000 pounds per square inch.

IV. By bond, at a unit bond stress not exceeding $0.04f'_c$ on plain bars nor $0.05f'_c$ on deformed bars, plus a bend of radius not less than two times the diameter of the bar, parallel to the upper or lower surface of the beam and continuous with the longitudinal reinforcement. The short radius bend and continuity shall together not be counted upon to develop a tensile unit stress in the bar of more than 10,000 pounds per square inch.

V. The tensile unit stress at the beginning of a bend may be increased from 10,000 pounds per square inch when the radius of bend is two bar diameters, at the rate of 1,000 pounds per square inch tension for each increase of one and one-half bar diameters in the radius of bend, provided that the length of the bar in the bend and extension is sufficient to develop this increased tensile stress by bond at the unit stresses given in Subsection (d-III).

In all cases web reinforcement shall be carried as close to the compression surface of the beam as fireproofing regulations and the proximity of other steel will permit.

(e) **Anchorage of Bars in Footing Slabs.** All bars in footing slabs, except the longitudinal reinforcement between loads in continuous slab footings, shall be anchored by means of

Sections 2618-2619

standard hooks. The outer faces of these hooks shall be not less than three inches (3") nor more than six inches (6") from the face of the footing.

(f) **Hooks.** The terms "hook" or "standard hook" as used herein shall mean a complete semicircular turn with a radius of bend on the axis of the bar of not less than three and not more than six bar diameters, plus an extension of at least four bar diameters at the free end of the bar. Hooks having a radius of bend of more than six bar diameters shall be considered merely as extensions to the bars, and shall be treated as in Sub-section (d)-V.

In general, hooks shall not be permitted in the tension portion of any beam except at the ends of simple or cantilever beams or at the freely supported ends of continuous or restrained beams.

No hook shall be assumed to carry a load which would produce a tensile stress in the bar greater than 10,000 pounds per square inch.

Any mechanical device capable of developing the strength of the bar without damage to the concrete may be used in lieu of a hook. Tests must be presented to show the adequacy of such devices.

Sec. 2619. (a) Limitations. The term flat slabs as used in these regulations refers to concrete slabs, without beams or girders to carry the load to supporting members, reinforced with bars extending in two or four directions. Slabs with dropped panels or paneled ceilings shall be considered as flat slabs provided that they meet the requirements herein given for such construction. **Flat Slabs**

The moment coefficients, moment distribution, and slab thicknesses specified herein are for a series of rectangular slabs of approximately uniform size arranged in three or more rows of panels in each direction, and in which the ratio of length to width of panel does not exceed 1.33.

For structures having a width of less than three rows of panels, or in which irregular panels are used, an analysis shall be made of the moments developed in both slabs and columns.* When so required, computations shall be submitted to the Building Inspector.

(b) **Panel Strips and Principal Design Sections.** A flat slab panel shall be considered as consisting of strips in each direction as follows:

A middle strip one-half panel in width, symmetrical about panel center line and extending through the panel in the direction in which moments are considered.

A column strip one-half panel in width occupying the two quarter-panel areas outside of the middle strip.

The critical sections for moment calculations are referred to as principal design sections and are located as follows:

*It is not the intention to prohibit flat slab construction for panels longer than 1.33 times the width, or for buildings less than three bays wide, provided the moment factors are properly adjusted.

Section 2619

Flat
Slabs
(Con't.)

1. **Sections for Negative Moment.** These shall be taken along the edges of the panel, on lines joining the column centers, except that they follow the perimeter of the column capital instead of passing through it.

2. **Sections for Positive Moment.** These shall be taken on the center lines of the panel.

In the two-way system it shall be assumed that the various moments in the strips are resisted by the bands located within the strips, each band being $.5l_n$ in width.

In the four-way system, it shall be assumed that the column strip positive moment is resisted by the direct band; that the column strip negative moment is resisted by the direct band plus the two diagonal bands multiplied by the cosine of the angle between the direct band and the diagonal bands; that the middle strip positive moment is resisted by the two diagonal bands multiplied by the cosine of the angle between the axis of the middle strip and the diagonal bands; and that the middle strip negative moment is resisted by an independent top band across the middle of the direct band. The width of direct and middle strip negative bands shall be approximately $.4l_n$, the width of the diagonal bands shall be approximately $.4$ of the average span length or

$$(l + l)$$

5

The width of the column head section for compression shall be taken as the width of the dropped panel (b_1), or half the width of the panel ($.5l_n$) where no dropped panel is used.

(c) **Slab Thickness and Dropped Panel Sizes.** In Table No. III of this Chapter are given the thicknesses, dimensions and moments governing flat slab design when f'_c equals 2,000 pounds per square inch. The general formulas are given under the heading "General Case"; the formulas for the case where the diameter of the column capital (c) = $0.225 l$ are given under the heading "Special Case" for (c) = $0.225 l$.

Where f'_c is greater than 2,000 pounds per square inch, the required and minimum slab thicknesses given in Table III of this Chapter may be reduced by multiplying by the factor

$$\sqrt[3]{\frac{2000}{f'_c}}$$

in which f'_c is the ultimate 28-day compressive strength of the concrete to be used.

(d) **Column Capital Sizes.** The average (c) for the columns at the four corners of a panel shall be used in obtaining the slab thickness, the numerical sum of the total positive and negative moments (M_o) in either direction and the middle strip positive and negative moments in either direction.

The average (c) for two adjacent columns shall be used in obtaining the positive and negative moments in the column strip between these adjacent columns.

(e) **Panels with Marginal Beams or Reinforced Bearing Walls.** Moments to be used in the design of panels with mar-

**TABLE NO. III—LIMITATIONS FOR SLAB THICKNESSES—
DROPPED PANELS AND MOMENTS**

	Symbol	Unit	General Case	Special Case For $c = .225l$
Minimum Floor Slab Thickness	t_1 or t_2	Inches	0.375 (long l)	0.375 (long l)
Minimum Roof Slab Thickness	t_1 or t_2	Inches	0.300 (long l)	0.300 (long l)
Slab Thickness without Dropped Panel	t_1	Inches	$0.038 \left(1 - 1.44 \frac{c}{l}\right) l \sqrt{w'} + 1\frac{1}{2}$ (10) $0.025l \sqrt{w'} + 1\frac{1}{2}$ (19a)	
Slab Thickness beyond Dropped Panel	t_2	Inches	$0.02l \sqrt{w'} + 1$ (20)	$0.02l \sqrt{w'} + 1$ (20a)
Slab Thickness through Dropped Panel	t_1	Inches	(Minimum = $1.25 t_2$) (Maximum = $1.50 t_2$)	(Minimum = $1.25 t_2$) (Maximum = $1.50 t_2$)
Minimum side or diameter of Dropped Panel	b_1	Feet	$0.35l$	$0.35l$
Numerical sum of positive and negative moments in direction of either side of interior rectangular panel	M_o	ft. lb.	$0.09Wl \left(1 - \frac{2c}{3l}\right)^2$ (21)	$0.065Wl$ (21a)

Maximum l shall be used in thickness formulas.

In these tables (l), (t_1), (b_1) and (c) are always expressed in feet while the units in which the formulas develop are shown in the column headed "units."

**TABLE NO. IV—MOMENTS TO BE USED IN DESIGN OF
AN INTERIOR PANEL OF FLAT SLAB**

	Symbol	Units	General Case	Special Case $c = .225l$
TWO-WAY SYSTEM WITH DROPPED PANEL				
Column Strip, Negative Moment	$-M_o$	ft. lb.	$0.50M_o$	$0.0325Wl$
Column Strip, Positive Moment	$+M_o$	ft. lb.	$0.20M_o$	$0.0130Wl$
Middle Strip, Negative Moment	$-M_m$	ft. lb.	$0.15M_o$	$0.00975Wl$
Middle Strip, Positive Moment	$+M_m$	ft. lb.	$0.15M_o$	$0.00975Wl$
TWO-WAY SYSTEM WITHOUT DROPPED PANEL				
Column Strip, Negative Moment	$-M_o$	ft. lb.	$0.46M_o$	$0.030Wl$
Column Strip, Positive Moment	$+M_o$	ft. lb.	$0.22M_o$	$0.0142Wl$
Middle Strip, Negative Moment	$-M_m$	ft. lb.	$0.15M_o$	$0.0104Wl$
Middle Strip, Positive Moment	$+M_m$	ft. lb.	$0.10M_o$	$0.0104Wl$
FOUR-WAY SYSTEM WITH DROPPED PANELS (MOMENTS BY STRIPS)				
Column Strip, Negative Moment	$-M_o$	ft. lb.	$0.51M_o$	$0.0351Wl$
Column Strip, Positive Moment	$+M_o$	ft. lb.	$0.19M_o$	$0.0124Wl$
Middle Strip, Negative Moment	$-M_m$	ft. lb.	$0.09M_o$	$0.0052Wl$
Middle Strip, Positive Moment	$+M_m$	ft. lb.	$0.19M_o$	$0.0124Wl$
(MOMENTS BY BANDS)				
Direct Band, Negative Moment	$-M$	ft. lb.	$0.307M_o$	$0.0200Wl$
Direct Band, Positive Moment	$+M$	ft. lb.	$0.15M_o$	$0.0124Wl$
Diagonal Band, Negative Moment	$-M$	ft. lb.	$0.168M_o$	$0.0100Wl$
Diagonal Band, Positive Moment	$+M$	ft. lb.	$0.134M_o$	$0.0087Wl$
Cross Band, Negative Moment	$-M$	ft. lb.	$0.03M_o$	$0.0052Wl$
FOUR-WAY SYSTEM WITHOUT DROPPED PANELS (MOMENTS BY STRIPS)				
Column Strip, Negative Moment	$-M$	ft. lb.	$0.59M_o$	$0.0325Wl$
Column Strip, Positive Moment	$+M$	ft. lb.	$0.20M_o$	$0.0130Wl$
Middle Strip, Negative Moment	$-M$	ft. lb.	$0.10M_o$	$0.0065Wl$
Middle Strip, Positive Moment	$+M$	ft. lb.	$0.20M_o$	$0.0130Wl$
(MOMENTS BY BANDS)				
Direct Band, Negative Moment	$-M$	ft. lb.	$0.30M_o$	$0.0195Wl$
Direct Band, Positive Moment	$+M$	ft. lb.	$0.20M_o$	$0.0130Wl$
Diagonal Band, Negative Moment	$-M$	ft. lb.	$0.131M_o$	$0.0082Wl$
Diagonal Band, Positive Moment	$+M$	ft. lb.	$0.141M_o$	$0.0092Wl$
Cross Band, Negative Moment	$-M$	ft. lb.	$0.10M_o$	$0.0065Wl$

Section 2619

Flat
Slabs
(Con't.)TABLE NO. V—MOMENTS TO BE USED IN DESIGN OF
AN EXTERIOR PANEL OF FLAT SLAB

Moments in the strips perpendicular to the discontinuous edge where they differ from an interior panel, are given in the following table. Negative moments in the column strip and middle strip on the line of the first interior columns are the same as for an interior panel.

Moments in the strips parallel to the discontinuous edge are the same as for an interior panel.

	Symbol	Units	General Case	Special Case $c = .225l$
TWO-WAY SYSTEM WITH DROPPED PANEL				
Column Strip Negative Moment at discontinuous edge	$-M_c$	ft. lb.	$0.45M_u$	$0.029W_l$
Column Strip Positive Moment	$+M_c$	ft. lb.	$0.25M_u$	$0.016W_l$
Middle Strip Negative Moment at discontinuous edge	$-M_m$	ft. lb.	$0.10M_u$	$0.0065W_l$
Middle Strip Positive Moment	$+M_m$	ft. lb.	$0.19M_u$	$0.012W_l$
TWO-WAY SYSTEM WITHOUT DROPPED PANEL				
Column Strip Negative Moment at discontinuous edge	$-M_c$	ft. lb.	$0.41M_u$	$0.027W_l$
Column Strip Positive Moment	$+M_c$	ft. lb.	$0.23M_u$	$0.018W_l$
Middle Strip Negative Moment at discontinuous edge	$-M_m$	ft. lb.	$0.10M_u$	$0.007W_l$
Middle Strip Positive Moment	$+M_m$	ft. lb.	$0.20M_u$	$0.013W_l$
FOUR-WAY SYSTEM WITH DROPPED PANELS (MOMENTS BY STRIPS)				
Column Strip Negative Moment at discontinuous edge	$-M$	ft. lb.	$0.485M_u$	$0.0315W_l$
Column Strip Positive Moment	$+M$	ft. lb.	$0.24M_u$	$0.0156W_l$
Middle Strip Negative Moment at discontinuous edge	$-M$	ft. lb.	$0.053M_u$	$0.0032W_l$
Middle Strip Positive Moment	$+M$	ft. lb.	$0.24M_u$	$0.0156W_l$
(MOMENTS BY BANDS) (FOR SQUARE PANEL)				
Direct Band at Column Head at discontinuous edge	$-M$	ft. lb.	$0.28M_u$	$0.018W_l$
Direct Band at Center	$+M$	ft. lb.	$0.24M_u$	$0.0156W_l$
Diagonal Bands at Column Head at discontinuous edge	$-M$	ft. lb.	$0.15M_u$	$0.010W_l$
Diagonal Bands at Center	$+M$	ft. lb.	$0.17M_u$	$0.011W_l$
Top Band (across Middle of Direct) at discontinuous edge	$-M$	ft. lb.	$0.053M_u$	$0.003W_l$
FOUR-WAY SYSTEM WITHOUT DROPPED PANELS (MOMENTS BY STRIPS)				
Column Strip Negative Moment at discontinuous edge	$-M$	ft. lb.	$0.45M_u$	$0.029W_l$
Column Strip Positive Moment	$+M$	ft. lb.	$0.25M_u$	$0.0163W_l$
Middle Strip Negative Moment at discontinuous edge	$-M$	ft. lb.	$0.062M_u$	$0.004W_l$
Middle Strip Positive Moment	$+M$	ft. lb.	$0.25M_u$	$0.016W_l$
(MOMENTS BY BANDS) (FOR SQUARE PANEL)				
Direct Band at Column Head at discontinuous edge	$-M$	ft. lb.	$0.27M_u$	$0.017W_l$
Direct Band at Center	$+M$	ft. lb.	$0.25M_u$	$0.016W_l$
Diagonal Bands at Column Head at discontinuous edge	$-M$	ft. lb.	$0.13M_u$	$0.0084W_l$
Diagonal Bands at Center	$+M$	ft. lb.	$0.13M_u$	$0.0117W_l$
Top Band (across Middle of Direct) at discontinuous edge	$-M$	ft. lb.	$0.06M_u$	$0.004W_l$

ginal beams or reinforced concrete bearing walls shall be as given in Table No. VI.

(f) Limitations (Applicable to Tables IV, V and VI of this Chapter). Any of the above moments may be varied by not more than six per cent, provided that the total numerical sum of the positive and negative moments on the principal design sections is not reduced.

**TABLE NO. VI—MOMENTS TO BE USED IN DESIGN OF
PANELS WITH MARGINAL BEAMS OR
REINFORCED BEARING WALLS**

	Marginal Beams with Depth greater than $1\frac{1}{2}$ times the Slab Thickness; or reinforced Bearing Wall				Marginal Beam with depth $1\frac{1}{2}$ times the Slab Thickness or less.			
(a) Load to be carried by Marginal Beam or Wall.	Loads directly superimposed upon it plus a uniform load equal to one-quarter of the total live and dead panel load.				Loads directly superimposed upon it exclusive of any panel load.			
(b) Moment to be used in the design of Half Column Strip adjacent and parallel to Marginal Beam or Wall.	Two-Way System		Four-Way System		Two-Way System		Four-Way System	
		With Drop	Without Drop	With Drop	Without Drop	With Drop	Without Drop	With Drop
	Neg.	.125M _o	.115M _o	.135M _o	.125M _o	Neg.	.25M _o	.23M _o
	Pos.	.05 M _o	.055M _o	.0475M _o	.05M _o	Pos.	.10M _o	.11M _o
(c) Negative Moment to be used in Design of Middle Strip continuous over Beam or Wall.	Neg.	.195M _o	.208M _o	.104M _o	.13M _o	Neg.	.15M _o	.16M _o

The ratio of reinforcement considered in any strip shall not exceed the value of (p) calculated for balanced reinforcement by Section 2613. The ratio of reinforcement in any strip shall be not less than .0025. Bars shall not be spaced farther apart than one and one-half times the slab thickness for the full width of the bands.

Moments for the four-way system are shown in Table No. V of this Chapter by strips, and for convenience, also by bands.

Slabs supported by marginal beams on opposite edges shall be designed as solid one- or two-way slabs to carry the entire panel load.

(g) **Length of Bars and Points of Bend.** The positive moment reinforcement perpendicular to the discontinuous edge shall extend to this edge and have an embedment of at least six inches (6") in spandrel beams or columns. All negative moment reinforcement shall be bent or hooked at spandrel beams or columns to provide adequate bond resistance. Length of bars and points of bend shall be as given in Table No. VII of this Chapter.

(h) **Arrangement of Reinforcement.** The slab reinforcement shall be accurately placed so as to resist not only the moments at the critical sections, but also the moments at intermediate sections, and shall be secured and supported by concrete or metal chairs and spacers.

(i) **Brackets.** Brackets extending the full width of the column may be substituted for column capitals at exterior columns, provided the sloping face of the bracket makes an angle not more than forty-five degrees with the face of the column, projected upward.

TABLE VII—LENGTH OF BARS AND POINTS OF BEND

	With Drop		Without Drop	
	General Case	$c = .225l$	General Case	$c = .225l$
TWO-WAY FLAT SLAB (COLUMN STRIP) Length of straight bars (not less than .4 of total band steel) Length of bent bars (not less than .4 total band steel) Length of additional straight bars over column head (if required) Point of top bend in bent bars (from column center)	$l - b_c + (2' \text{ or } 40d)$ $1.5l + .6c$ $.5l + .6c$.25l	$.65l + (2' \text{ or } 40d)$ $1.635l$.635l .25l	.75l $1.44l + .66c$ $.44l + .66c$.25l	.75l $1.50l$.50l .25l
MIDDLE STRIP Length of straight bars (not more than .5 total band steel) Length of bent bars (not less than .5 total band steel) Point of top bend in bent bars (from column center)	.65l $1.5l$.175l	.65l $1.5l$.175l	.7l $1.5l$.15l	.7l $1.5l$.15l
FOUR-WAY FLAT SLAB (COLUMN STRIP) Length of straight bars (not less than .4 total band steel) Length of bent bars (not less than .4 total band steel) Length of additional straight bars over column head (if required) Point of bend for bent bars (from column centers)	$l - b_c + (2' \text{ or } 40d)$ $1.5l + .6c$ $.5l + .6c$.2l	$.65l + (2' \text{ or } 40d)$ $1.635l$.635l .2l	.75l $1.44l + .66c$ $.44l + .66c$.2l	.75l $1.50l$.50l .2l
DIAGONAL BAND Length of straight bars (not more than .6 total band steel area) Length of bent bars (not less than .4 total band steel area) Point of bend for bent bars (from column centers) Length of additional straight bars over column head (if required) Top band across middle of direct band (length of straight bars)	$l - b_c + (2' \text{ or } 40d)$ $2.21l$.33l .8l .5l	$.65l + (2' \text{ or } 40d)$ $2.21l$.33l .8l .5l	.75l $2.21l$.33l .5l .5l	.75l $2.21l$.33l .8l .5l

†Note: To these lengths proper allowance to be added for bends.

The value of (c) where brackets are used is twice the distance from the center of the column to a point where the bracket is one and one-half inches ($1\frac{1}{2}$ ") thick.

(j) **Columns Without Capitals or Brackets.** Brackets and column capitals may be omitted altogether, provided the slab thickness is sufficient to resist fully the moments and shears at the column head section.

The value of (c) where brackets and column capitals are omitted is the width of the column in the direction in which moments are considered, except that, when a beam of greater depth than the thickness of the slab or dropped panel extends into the column in the direction in which moments are considered, the value of (c) may be taken as the width of the column plus twice the projection of the beam below the slab or dropped panel.

(k) **Openings in Flat Slabs.** Openings of any size may be cut through the floor in the area common to two intersecting middle strips, provided the total positive and negative resisting moments be maintained as required in Subsection (d) and that these total positive and total negative moments be redistributed

Sections 2619-2620

between the remaining principal design sections to meet the new conditions.

In any area common to two column strips, not more than one opening shall be allowed and the greatest dimension of such an opening shall not exceed .05 *l*.

In any area common to one column strip and one middle strip, openings shall not interrupt more than one-quarter of the bars in either strip and the equivalent of the bars so interrupted shall be provided by extra steel on both sides of the opening.

Any opening larger than described above shall be completely framed on all sides with beams to carry the loads to the columns.

(1) **Shearing Stresses in Flat Slabs.** See Section 2617.

Sec. 2620. (a) Limiting Dimensions. The following sections on reinforced concrete and composite columns except Subsection (g) apply to a short column, for which the unsupported length is not greater than 10 times the least lateral dimension. When the unsupported length exceeds this value, the design shall be modified as shown in Subsection (g). Principal columns in buildings shall have a minimum diameter or thickness of ten inches (10") and a minimum gross area of one hundred and twenty square inches (120 sq. in.). Posts that are not continuous from story to story shall have a minimum diameter or thickness of six inches (6").

**Reinforced
Concrete
Columns**

(b) Unsupported Length of Columns. For purposes of determining the limiting dimensions of columns, the unsupported length of reinforced concrete columns shall be taken as the clear distance between floor slabs.

Exceptions: 1. In flat slab construction, it shall be the clear distance between the floor and the lower extremity of the capital.

2. In beam and slab construction, it shall be the clear distance between the floor and the under side of the deeper beam framing into the column in each direction at the next higher floor level.

3. In columns restrained laterally by struts, it shall be the clear distance between consecutive struts in each vertical plane; provided that to be an adequate support, two such struts shall meet the column at approximately the same level, and the angle between vertical planes through the struts shall not vary more than 15 degrees from a right angle. Such struts shall be of adequate dimensions and anchorage to restrain the column against lateral deflection.

4. In columns restrained laterally by struts or beams, with brackets used at the junction, it shall be the clear distance between the floor and the lower edge of the bracket, provided that the bracket width equals that of the beam or strut and is at least half that of the column.

For rectangular columns, that length shall be considered which produces the greatest ratio of length to depth of section.

Section 2620

Spirally
Reinforced
Columns

(c) **Spirally Reinforced Columns.** 1. Permissible Load—The maximum permissible axial load, P , on columns with closely spaced spirals enclosing a circular concrete core reinforced with longitudinal bars shall be that given by Formula (22).

$$P = A_g (0.225f'_c + f_s p_s) \dots\dots\dots (22)$$

WHERE

- A_g = the gross area of the column.
 f'_c = compressive strength of the concrete.
 f_s = nominal working stress in vertical column reinforcement, to be taken at 40 per cent of the minimum specification value of the yield point; viz., 16,000 pounds per square inch for intermediate grade steel and 20,000 pounds per square inch for rail or hard grade steel.*
 p_s = ratio of the effective cross-sectional area of vertical reinforcement to the gross area, A_g .

2. **Vertical Reinforcement**—The ratio (p_s) shall not be less than 0.01 nor more than 0.08. The minimum number of bars shall be six, and the minimum diameter shall be five-eighths inch ($\frac{5}{8}$ "). The center to center spacing of bars within the periphery of the column core shall be not less than $2\frac{1}{2}$ times the diameter for round bars or 3 times the side dimension for square bars. The clear spacing between bars shall be not less than one and one-half inches ($1\frac{1}{2}$ "), or one and one-half times the maximum size of the coarse aggregate used. These spacing rules apply to adjacent pairs of bars at a lapped splice.

3. **Splices in Vertical Reinforcement**—Where lapped splices in the column verticals are used, the minimum amount of lap shall be as follows:

- I For deformed bars—with concrete having a strength of 3000 pounds per square inch or above, 24 diameters of bar of intermediate grade steel and 30 diameters of bar of rail steel. For bars of higher yield point, the amount of lap shall be increased in proportion to the nominal working stress. When the concrete strengths are less than 3000 pounds per square inch, the amount of lap shall be one-third greater than the values given above.
- II For plain bars—the minimum amount of lap shall be 25 per cent greater than that specified for deformed bars.
- III Welded splices or other positive connections may be used instead of lapped splices. Welded splices shall preferably be used in cases where the bar diameter exceeds one and one-fourth inch ($1\frac{1}{4}$ "). An approved welded splice shall be defined as one in which the bars are butted and welded and that will develop in tension at least the yield point stress of the reinforcing steel used.
- IV Where changes in the cross section of a column occur, the longitudinal bars shall be offset in a region where

*Nominal working stresses for reinforcement of higher yield point may be established at 40 per cent of the yield point stress, but not more than 30,000 pounds per square inch, when the properties of such reinforcing steels have been definitely specified by standards of A. S. T. M. designation. If this is done, the lengths of splice required by Section 2620, Sub-section (c) paragraph (3) shall be increased accordingly.

lateral support is afforded by a concrete capital, floor slab or by metal ties or reinforcing spirals. Where bars are offset, the slope of the inclined portion from the axis of the column shall not exceed one in six and the bars above and below the offset shall be parallel to the axis of the column.

4. **Spiral Reinforcement**—The ratio of spiral reinforcement, (p') shall be not less than the value given by Formula (23), nor shall it be less in any case than 0.0112 for hot rolled spirals of intermediate grade or 0.0075 for cold drawn wire spirals.

$$p' = 0.45 (R - 1) \frac{f'_c}{f'_s} \dots\dots\dots (23)$$

WHERE

p' = ratio of volume of spiral reinforcement to the volume of the concrete core (out to out of spirals).

R = ratio of gross area to core area of column, A_g/A_c .

f'_s = useful limit stress of spiral reinforcement, to be taken as 40,000 pounds per square inch for hot rolled rods of intermediate grade (A. S. T. M. Designation A15-39)¹ and 60,000 pounds per square inch for cold drawn wire (A. S. T. M. Designation A82-34).¹

The spiral reinforcement shall consist of evenly spaced continuous spirals held firmly in place and true to line by at least three vertical spacer bars. Anchorage of spiral reinforcement shall be provided by one and one-half extra turns of spiral rod or wire at each end of the spiral unit. Splices, when necessary, shall be made in spiral rod or wire by welding or by a lap of one and one-half turns. The center to center spacing of the spirals shall not exceed one-sixth of the core diameter. The clear spacing between spirals shall not exceed three inches (3") nor be less than one and three-eighths inches (1 $\frac{3}{8}$ ") or one and one-half times the maximum size of coarse aggregate used. The reinforcing spiral shall extend from the floor level in any story, or from the top of the footing in the basement, to the level of the lowest horizontal reinforcement in the slab, dropped panel or beam above. In a column with a capital, it shall extend to the plane at which the diameter or width of the capital is twice that of the column.

5. **Protection of Reinforcement** — The column reinforcement shall be protected everywhere by a covering of concrete cast monolithically with the core, for which the thickness shall not be less than one and one-half inches (1 $\frac{1}{2}$ ") nor less than one and one-half times the maximum size of the coarse aggregate, nor shall it be less than required by the fire protection and weathering provisions of Section 2610 (f).

6. **Limits of Column Section** — For columns built monolithically with concrete walls or piers, the outer boundary of the column section shall be taken either as a circle one and one-half inches (1 $\frac{1}{2}$ ") outside the column spiral or as a square or rectangle of which the sides are one and one-half inches

¹See "Specification Documents".

(1½") outside the spiral. The value of A_g thus defined shall be used in both Formulas (22) and (23). In any case it shall be permissible to design a circular column and to build it as a square column of the same least lateral dimension. In such case the permissible load, the gross area considered, and the required percentage of reinforcement must be taken as those of the circular column.

Tied Columns

(d) **Tied Columns.** 1. **Permissible Load** — The maximum permissible axial load on columns reinforced with longitudinal bars and separate lateral ties shall be 80 per cent of that given by Formula (22). The ratio, (p_p) , to be considered in tied columns shall be not less than 0.01 nor more than 0.04. The longitudinal reinforcement shall consist of at least four bars, of minimum diameter of five-eighths of an inch (5/8"). Splices in reinforcing bars shall be made as described in Subsection (c), paragraph (3).

2. **Lateral Ties**—Lateral ties shall be at least one-fourth inch (¼") in diameter and shall be spaced apart not over 16 bar diameters, 48 tie diameters or the least dimension of the column. When there are more than four vertical bars, additional ties shall be provided so that every longitudinal bar is held firmly in its designed position and has lateral support equivalent to that provided by a 90-degree corner of a tie.

3. **Limits of Column Section** — In a tied column which for architectural reasons has a larger cross section than required by consideration of loading, a reduced effective area (A_e) not less than one-half of the total area may be used in applying the provisions of Subsection (d), paragraph (1).

Composite Columns

(e) **Composite Columns.** 1. **Permissible Load** — The permissible load on a composite column consisting of a structural steel or cast-iron column thoroughly encased in concrete reinforced with both longitudinal and spiral reinforcement, shall not exceed that given by Formula (24).

$$P = 0.225A_g f'_c + f_s A_s + f_r A_r \dots \dots \dots (24)$$

WHERE

A_g = net area of concrete

= $A_g - A_s - A_r$.

A_s = cross-sectional area of longitudinal bar reinforcement.

A_r = cross-sectional area of the steel or cast-iron core.

f_r = permissible unit stress in metal core, not to exceed 16,000 pounds per square inch for a steel core; or 10,000 pounds per square inch for a cast-iron core.

The remaining notation is that of Subsection (c).

2. **Details of Metal Core and Reinforcement**—The cross-sectional area of the metal core shall not exceed 20 per cent of the gross area of the column. If a hollow metal core is used it shall be filled with concrete. The amounts of longitudinal and spiral reinforcement and the requirements as to spacing of bars, details of splices and thickness of protective shell outside the spiral shall conform to the limiting values specified in Subsection (c), paragraphs (2), (3) and (4). A clearance of at least three inches (3") shall be maintained be-

tween the spiral and the metal core at all points except that when the core consists of a structural steel H-column, the minimum clearance may be reduced to two inches (2").

3. **Splices and Connections of Metal Cores**—Metal cores in composite columns shall be accurately milled at splices and positive provision shall be made for alignment of one core above another. At the column base, provision shall be made to transfer the load to the footing at safe unit stresses in accordance with Section 2613 and Table No. II. The base of the metal section shall be designed to transfer the load from the entire composite column to the footing, or it may be designed to transfer the load from the metal section only, provided it is so placed in the pier or pedestal as to leave ample section of concrete above the base for the transfer of load from reinforced concrete section of the column by means of bond on the vertical reinforcement and by direct compression on the concrete. Transfer of loads to the metal core shall be provided for by the use of bearing members such as billets, brackets or other positive connections; these shall be provided at the top of the metal core and at intermediate floor levels where required. The column as a whole shall satisfy the requirements of Formula (24) at any point; in addition to this, the reinforced concrete portion shall be designed to carry, in accordance with Formula (22), all floor loads brought onto the column at levels between the metal brackets or connections. In applying Formula (22), the value of A_p shall be interpreted as the area of the concrete section outside the metal core, and the permissible load on the reinforced concrete section shall be further limited to $0.35 f'_c A_p$. Ample section of concrete and continuity of reinforcement shall be provided at the junction with beams or girders.

4. **Permissible Load on Metal Core Only** — The metal cores of composite columns shall be designed to carry safely any construction or other loads to be placed upon them prior to their encasement in concrete.

(f) **Combination Columns.** 1. **Steel Columns Encased in Concrete.** The permissible load on a structural steel column which is encased in concrete at least two and one-half inches (2½") thick over all metal (except rivet heads) reinforced as hereinafter specified, shall be computed by Formula (25).

$$P = A_s f'_s \left(1 + \frac{A_s}{100 A_p} \right) \dots \dots \dots (25)$$

WHERE

A_s = cross-sectional area of steel column.

f'_s = permissible stress for uncased steel column.

A_p = total area of concrete section.

The concrete used shall develop a compressive strength, (f'_c) of at least 2000 pounds per square inch at 28 days. The concrete shall be reinforced by (the equivalent of) welded wire mesh having wires of No. 10 W. & M. gage, the wires encircling the column being spaced not more than four inches (4") apart and those parallel to the column axis not more than eight inches (8") apart. This mesh shall extend entirely around the column at a distance of one inch (1") inside the outer concrete surface and shall be lap-spliced at least 40 wire diameters and wired at the splice. Special brackets shall be used to receive the en-

**Combination
Columns**

Section 2620

tire floor load at each floor level. The steel column shall be designed to carry safely any construction or other loads to be placed upon it prior to its encasement in concrete.

2. Pipe Columns. — The permissible load on columns consisting of steel pipe filled with concrete shall be determined by Formula (26).

$$P = 0.225f'_c A_c + f'_r A_r \dots\dots\dots (26)$$

The value of f'_r shall be that given by Formula (27).

$$f'_r = \left(18,000 - 70 \frac{h}{K} \right) F \dots\dots\dots (27)$$

WHERE

f'_r = average unit stress in metal core.

h = unsupported length of column.

K = least radius of gyration of metal core section.

(yield point of pipe)

$$F = \frac{\quad}{45,000}$$

If the yield point of the pipe is not known, the factor F shall be taken as 0.5.

Long Columns

(g) Long Columns. The maximum permissible load P' on axially loaded reinforced concrete or composite columns having a length, (h), greater than 10 times the least lateral dimension, (d), shall be given by Formula (28).

$$P' = P \left(1.3 - .03 \frac{h}{d} \right) \dots\dots\dots (28)$$

where P is the permissible axial load on a short column as given by Formulas (22) and (24).

The maximum permissible load P' on eccentrically loaded columns in which $\frac{h}{d}$ exceeds 10 shall also be given by Formula (28), in which P is the permissible eccentrically applied load on a short column as determined by the provisions of Subsections (i) and (j). In long columns subjected to definite bending stresses, as determined in Subsection (h), the ratio h/d shall not exceed 20.

(h) Bending Moments in Columns. The bending moments in the columns of all reinforced concrete structures shall be determined on the basis of loading conditions and restraint and shall be provided for in the design. When the stiffness and strength of the columns are utilized to reduce moments in beams, girders, or slabs, as in the case of rigid frames, or in other forms of continuous construction wherein column moments are unavoidable, they shall be provided for in the design. In building frames, particular attention shall be given to cases of unbalanced floor loads on both exterior and interior columns and of eccentric loading due to other causes. Wall columns shall be designed to resist moments produced by:

Section 2620

1. Loads on all floors of the building
2. Loads on a single exterior bay at two adjacent floor levels, or
3. Loads on a single exterior bay at one floor level.

Resistance to bending moments at any floor level shall be provided by distributing the moments between the columns immediately above and below the given floor in proportion to their relative stiffness and conditions of restraint.

(i) **Combined Axial and Bending Stress.** In reinforced concrete columns subjected to bending moments, the recognized methods of analysis shall be followed in calculating the stresses due to combined axial load and bending. The maximum fiber stress in compression and (in case of large eccentricities of loading) the tensile stress in the vertical bars will govern the design. The gross area of both spiral and tied columns shall be used in the computations. **Combined Stresses**

Note: For preliminary designs it will usually give satisfactory results to compute the combined fiber stress in compression on the basis of an uncracked section of the column, using Formula (29).

$$f_s = \frac{P}{A_g} \left(\frac{1 + \frac{ec}{R^2}}{1 + (n-1) p_g} \right) \dots \dots \dots (29)$$

WHERE

e = eccentricity of resultant load, measured from the gravity axis.

c = distance from gravity axis to extreme fiber in compression.

R = radius of gyration of equivalent concrete section.
30,000

$n = \frac{f'_c}{f_s}$

This will result in a fairly accurate design if the eccentricity is less than one-half the over-all column depth and the value of $p_g n$ is 0.3 or more.

cc

$6e$

The term $\frac{cc}{6e}$ may be replaced by the value $\frac{R^2}{8e}$ for rectangular

R^2

$8e$

columns and $\frac{R^2}{8e}$ for round columns without appreciable error

(t = over-all depth of section). This design shall then be analyzed by more accurate methods to insure that permissible stresses are not exceeded.

(j) **Permissible Combined Compressive and Tensile Stress.** For spiral and tied columns, eccentrically loaded or otherwise subjected to combined axial compression and flexural stress, the

Sections 2620-2621

maximum permissible compressive fiber stress, f_c , is given by formula (30).

$$f_c = f_a \frac{1 + \frac{ec}{R^2}}{1 + C \frac{ec}{R^2}} \quad (30)$$

wherein f_a is the average permissible stress on an equivalent axially loaded concrete column, and C is the ratio of f_a to the permissible fiber stress for members in flexure. Thus

$$f_a = \frac{0.225f'_c + f_s p_s}{1 + (n-1) p_s} \quad (31)$$

for spiral columns, and 0.8 of this value for tied columns. In general $C = f_a / 0.4f'_c$.

The permissible tensile stress in the longitudinal reinforcement may equal that specified for flexural members, provided however that splices in the tensile steel at or near the section of maximum column moment are capable of developing fully the yield point strength of the reinforcement.

Footings

Sec. 2621 (a) Loads. Footings resting directly on soil or on piles shall be proportioned as to soil bearing area or number of piles on the basis of the total column load plus the weight of the footing itself. For computations of moments and shears, an upward reaction per unit area or per pile shall be based on the total column load (not including the weight of the footing itself) divided by the area or by the number of piles.

(b) Sloped or Stepped Footings. Footings in which the thickness has been determined by the requirements for shear as specified in Section 2617, Subsection (h), may be sloped or stepped, provided that the shear on no section outside the critical section exceeds the value specified, and provided further that the thickness of the footing above the reinforcement at the edge shall not be less than six inches (6") for footings on soil, nor less than twelve inches (12") for footings on piles. Sloped or stepped footings shall be cast as a unit.

(c) Bending Moment in Footings. The critical section for bending moment in a concrete footing which supports a concrete column, pedestal or wall, shall be considered to be at the face of the column, pedestal or wall. For footings under masonry walls, the critical section shall be assumed as halfway between the middle and edge of the wall. For footings under metallic bases, the critical section shall be assumed as halfway between the face of the column or pedestal and the edge of the metallic base.

The bending moment at the critical section in a square footing, or in a rectangular footing having its side not greater than one and one-half times its width, shall be computed from the load on trapezoids bounded by the line of the critical section for moment, the corresponding outside edge of the footing, and the portions of the two diagonals. The load on the two corner triangles of the trapezoid shall be considered as applied at a distance equal to six-tenths of the projection of the footing from

Section 2621

the line of critical section for moment. The load on the rectangular portion of the trapezoid shall be considered as applied at its center of gravity.

For a round or octagonal concrete column or pedestal, the face of the column shall be taken as the side of a square of an area equal to the area enclosed within the perimeter of the column or pedestal.

(d) **Shearing and Bond Stresses.** The critical section for diagonal tension in footings on soil shall be assumed as a vertical section at a distance (d) from the face of the column or pedestal supported by the footing.

In footings on piles the critical section shall be assumed at a distance $\frac{d}{2}$ from the face of the column or pedestal, and any piles whose centers are at or within the section shall be excluded in computing shear.

For shearing stresses see Section 2617, Subsection (h).

The critical sections for bond shall be assumed at the face of the column or pedestal; at vertical planes where changes occur, and near the end of the bending moment reinforcement.

For bond stresses see Section 2618, Subsections (a) to (e) inclusive.

(e) **Transfer of Stress at Base of Column.** The compressive stress in longitudinal reinforcement at the base of a column shall be transferred to the pedestal or footing by dowels. There shall be at least one dowel for each column bar, and the total sectional area of the dowels shall not be less than the sectional area of the longitudinal reinforcement in the columns. The dowels shall extend up into the column and down into the pedestal or footing the distance required for lap of longitudinal column bars [see Section 2620, subsection (c)].

The permissible compressive unit stress on top of the pedestal or footing directly under the column shall not be greater than that determined by formula (32).

$$r_a = 0.25 f'_c \sqrt[3]{\frac{A}{A'}} \quad (32)$$

In sloped or stepped footings, A may be taken as the area of the top horizontal surface of the footing, or as the area of the lower base of the largest frustum of a pyramid or cone contained wholly within the footing and having for its upper base the loaded area A' , and having side slopes of one vertical to two horizontal.

(f) **Pedestals and Footings (Plain Concrete).** The allowable compressive unit stress on the gross area of a concentrically loaded pedestal shall not exceed $0.25 f'_c$. Where this stress is exceeded, reinforcement shall be provided and the member designed as a reinforced concrete column.

The depth and width of a pedestal or footing of plain concrete shall be such that the tension in the concrete shall not exceed $0.03 f'_c$, and the average shearing stress shall not exceed $0.02 f'_c$ taken on critical sections as determined for reinforced concrete footings.

Sections 2622-2623

Precast Concrete Joists

Sec. 2622. The depth of precast concrete joists shall be not more than four times the width of the top or bottom flanges nor less than one twenty-fourth of the span length.

The thickness of the top slab shall be not less than one-twelfth of the clear span between joists nor less than two and one-half inches ($2\frac{1}{2}$ ") for floors nor less than two inches (2") for roofs and not less than one and one-half inches ($1\frac{1}{2}$ ") over the joists. The slab shall have not less than 0.2 per cent reinforcement at right angles to the span of joists. The reinforcement shall be spaced not farther apart than five times the slab thickness.

Composite Beams

When the top slab is adequately reinforced and bonded to the joist, the construction may be considered as a T-beam.

Precast joists shall be bridged as provided in Section 3102.

Sec. 2623. The term "Composite Beam" shall apply to any rolled or fabricated steel floor beam entirely encased in poured concrete at least four inches (4") wider, at its narrowest point, than the flange of the beam, supporting a concrete slab on each side without openings adjacent to the beam; provided that the top of the beam is at least one and one-half inches ($1\frac{1}{2}$ ") below the top of the slab and at least two inches (2") above the bottom of the slab; provided that a good grade of stone or gravel concrete with portland cement, is used; and provided that the concrete has adequate mesh, or other reinforcing steel, throughout its whole depth and across the soffit.

Composite beams may be figured on the assumption that:

1. The steel beam carries unassisted all dead loads prior to the hardening of the concrete, with due regard for any temporary support provided.

2. The steel and concrete carry by joint action all loads, dead and live, applied after the hardening of the concrete.

The total tensile unit stress in the extreme fiber of the steel beam thus computed shall not exceed 20,000 pounds per square inch. (Sec. 2702).

The maximum stresses in concrete, and the ratio of Young's moduli for steel and concrete, shall be as prescribed by the specifications governing the design of reinforced concrete for the structure.

The web and end connections of the steel beam shall be adequate to carry the total dead and live load without exceeding the unit stresses prescribed in this Code, except as this may be reduced by the provision for other proper support.

1940

Sections 2701-2702

CHAPTER 27—STEEL AND IRON**(Quality and Design)**

Section 2701. The quality and design of all structural steel and iron used in buildings or structures shall conform to the requirements specified in this Chapter. **Quality and Design**

Structural steel shall be of such quality as to conform to "Standard Specifications for Structural Steel for Bridges and Buildings" (A.S.T.M. Designation A7-39) of the American Society for Testing Materials.

Steel pipe for steel pipe columns shall be of such quality as to conform to "Standard Specifications for Welded and Seamless Steel Pipe," (A.S.T.M. Designation A53-36) of the American Society for Testing Materials and shall be a medium carbon steel manufactured by the open hearth or electric furnace process.

Cast steel used in buildings or structures shall be of such quality as to conform to the "Standard Specifications for Carbon Steel Castings" (A.S.T.M. Designation A27-39) of the American Society for Testing Materials.

Cast iron used in buildings or structures shall be of such quality as to conform to the "Standard Specifications for Gray Iron Castings" (A.S.T.M. Designation A48-36) of the American Society for Testing Materials.

All structural steel, cast steel and cast iron shall be tested in accordance with the above specifications when deemed necessary by the Building Inspector and copies of such tests shall be filed in the office of the Building Inspector. No structural steel, cast steel and cast iron shall be used in any building or structure which does not comply with the above requirements or for which no test results have been filed with the Building Inspector. All such tests shall be made by competent testing laboratories at the expense of the owner.

The computation and design shall be properly made so that the unit working stresses specified in this chapter are not exceeded. The structure and its details shall possess the requisite strength and rigidity for proper stability and the design of structural members shall be such as to admit of a rational analysis according to well established principles of mechanics and sound engineering practice.

All structural steel sections shall be straight and true and any section so damaged as to affect its proper carrying capacity shall not be used in the construction of any building or structure.

Sec. 2702. All parts of the structure shall be so proportioned that the sum of the maximum static stresses in pounds per square inch shall not exceed those specified in this Section. **Allowable Unit Stresses**

(a) Tension

Structural Steel, net section.....	20,000
Cast Steel on net section.....	15,000
Cast Iron on net section.....	(not allowed)
Rivets, on area based on nominal diameter.....	15,000
Bolts, at root of thread.....	15,000

'See "Specification Documents".

Section 2702

**Allowable
Unit
Stresses
(Con't.)**

(b) Compression

Columns, gross section

For columns with values of l/r not

$$\text{greater than } 120 \dots\dots\dots 17,000 - 0.485 \frac{l^2}{r^2}$$

For columns with values of l/r

$$\text{greater than } 120 \dots\dots\dots \left. \begin{array}{c} 18,000 \\ 1 + \frac{P}{18,000P} \end{array} \right\} \left\{ 1.6 - \frac{l}{200r} \right\}$$

Plate Girder Stiffeners, gross section..... 20,000

Webs of Rolled Sections at toe of fillet..... 24,000

For main compression members, the ratio of l/r shall not exceed 180 and for bracing, struts and similar members 200.

On cast iron columns, with square or fixed ends;

$$P = 9,000 - 40 l/r$$

with a minimum gross diameter of six inches (6") and with the ratio l/r never in excess of 70.

In the foregoing formulas "P" equals the maximum unit working stress in pounds per square inch; l equals the unsupported length of the column or compression member in inches; and r equals the least radius of gyration of the column or compression member.

(c) Bending

Tension in extreme fibers of rolled sections, plate girders, and built-up members..... 20,000

Compression on extreme fibers of rolled sections, plate girders, and built-up members, for values of l/b not greater than

22,500

$$40 \dots\dots\dots 1 + \frac{l^2}{1800 b^2}$$

with a maximum of 20,000 in which l is the unsupported length of the member, and b is the width of the compression flange, both in inches.

Girders, beams, lintels and similar members may be laterally braced by joists, tie rods or similar members anchored thereto so as to laterally stay such members in both directions. Two or more cast iron or steel separators rigidly joining such members together shall be considered as lateral support if the length of flanges between separators does not exceed 40b.

On extreme fibers of pins, when the forces are assumed as acting at the center of gravity of the pieces..... 30,000

(d) Shearing

Rivets, pins, and turned bolts in reamed or

drilled holes..... 15,000

Unfinished bolts..... 10,000

Webs of beams and plate girders, gross section 13,000

1940

(e) Bearing

	Double Shear	Single Shear
Rivets, and turned bolts in reamed or drilled holes.....	40,000	32,000
Unfinished bolts.....	25,000	20,000
Pins.....	32,000	
Contact Area		
Milled Stiffeners and other Milled Surfaces.....	30,000	
Fitted Stiffeners.....	27,000	

(f) Combined Stresses. For combined stresses due to wind and other loads, the permissible working stress may be increased 33-1/3 per cent, provided the section thus found is not less than that required by the dead and live loads alone.

Members subject to both direct and bending stresses shall be so proportioned that the greatest combined stresses shall not exceed the allowed limits.

All members and their connections which are subject to stresses of both tension and compression due to the action of live loads shall be designed to sustain the stress giving the largest section, with 50 per cent of the smaller stress added to it. If the reversal of stress is due to the action of wind, the member shall be designed for the stress giving the largest section and the connections proportioned for the largest stress.

(g) Members Carrying Wind Load Only. For members carrying wind stresses only, the permissible working stresses may be increased 33-1/3 per cent.

(h) Roller Loads. The load in pounds per lineal inch on expansion rollers shall not exceed 600 times the diameter of the roller in inches.

(i) Allowable Unit Stresses for Used Steel. The allowable unit stresses assigned by the Building Inspector to any steel not complying with the requirements of Section 2701 shall in no case be more than 80 per cent of the stresses given in 2702. In designs where used steel is provided for, proper allowances shall be made for holes, reduction in section by rust or other defects.

(j) Allowable Unit Stresses in Light Steel. The allowable unit stresses in steel used in structural members of light steel construction and having an ultimate tensile strength of less than 60,000 pounds per square inch, shall be reduced in proportion to the ultimate tensile strength of such member.

Sec. 2703. Every member and combination of members shall be designed to provide for any stress due to an **Eccentric Load** load or force, whenever the increase in stress due to eccentric load or force exceeds 10 per cent of the stress due to a direct load or force on the member or members; but a member

Sections 2703-2704

framed directly to a central web of another member shall not be considered an eccentric load or force in case the resultant of the load or force acts parallel with the said central web.

Members subject to both axial and bending stresses shall be so proportioned that the quantity $\frac{f_a}{F_a} + \frac{f_b}{F_b}$ shall not exceed unity

F_a = Axial unit stress that would be permitted by this Code if axial stresses only existed.

F_b = Bending unit stress that would be permitted by this Code if bending stresses only existed.

f_a = Unit axial stress (actual) that is, the total axial stress divided by the area of the member.

f_b = Unit bending stress (actual) that is, the bending moment divided by the section modulus of the member.

Beams and Girders

Sec. 2704. (a) Riveted Plate Girders. Riveted plate girders, cover-plated beams, and rolled beams shall in general be proportioned by the moment of inertia of the gross section. No deduction shall be made for standard shop or field rivet holes in either flange; (except that in special cases where the reduction of the area of either flange by such rivet holes, calculated in accordance with the provisions of Section 2707, exceeds 15 per cent of the gross flange area, the excess shall be deducted.) If such members contain other holes, as for bolts, pins, or counter-sunk rivets, the full deduction for such holes shall be made. The deductions thus applicable to either flange shall be made also for the opposite flange if the corresponding holes are there present. When two or more rolled beams or channels are used to form a girder, they shall be so connected to each other as to properly distribute the loads to be carried.

(b) Plate Girder Webs. Plate girder webs shall have a thickness of not less than 1/170 of the unsupported distance between flanges.

(c) Web Splices in Plate Girders. Web splices in plate girders shall be proportioned to transmit the full shearing and bending stresses in the web at the point of splice.

(d) Stiffeners. Stiffeners shall be placed on the webs of plate girders at the ends and at points of concentrated loads. They shall have a close bearing against the flanges, shall extend as closely as possible to the edges of the flange angles; and shall not be crimped. They shall be connected to the web by enough rivets to transmit the stress. Only that portion of the outstanding legs outside the fillets of the flange angles shall be considered effective in bearing. The bearing value of such portion of the angles may be taken at not to exceed 24,000 pounds per square inch.

Section 2704

Intermediate stiffeners shall be required at all points where

$$\frac{h}{t} > \frac{8000}{\sqrt{s}}$$

WHERE

h = clear depth between flanges, in inches.

t = thickness of the web, in inches.

s = greatest unit shear in panel, in pounds per square inch, under any condition of complete or partial loading.

The clear distance between stiffeners, when stiffeners are required by the foregoing, shall not exceed eighty-four inches (84") or that given by the formula

$$d = \frac{270,000 t}{s} \times \sqrt{\frac{st}{h}}$$

in which d equals the clear distance between stiffeners, in inches.

Plate girder stiffeners shall be in pairs, one on each side of the web, and shall be connected to the web by rivets spaced not more than eight times their nominal diameter apart.

Intermediate stiffeners may be crimped over the flange angles.

(e) **Crane Runway Girders.** Crane runway girders shall be proportioned to resist any lateral forces produced by loads carried by them. These lateral forces shall in no case be less than 20 per cent of the maximum wheel loads.

(f) **Rivets Connecting Flanges to Web.** Rivets connecting the flanges to the web shall be proportioned to resist the horizontal shear due to bending as well as any loads applied directly to the flange.

(g) **Unstiffened Cover Plates.** Cover plates of all girders shall extend not more than six inches (6") nor more than 12 times the thickness of the thinnest plate beyond the outer row of rivets connecting them to the angles.

(h) **Cover Plates.** Cover plates, when required, shall be of equal thickness or shall diminish in thickness from the flange angles outward. No plate shall be thicker than the flange angles.

(i) **Flange Sections.** The gross section of the compression flange of a plate girder shall be not less than the gross section of the tension flange.

(j) **Rolled Beams.** Rolled beams shall be so proportioned that the unit compression stresses at the web toe of the fillets resulting from concentrated loads shall not exceed 24,000 pounds. Such stresses shall be determined by the formulas:

Sections 2704-2707

For interior loads $\frac{R}{t(A + 2N)}$, but not to exceed 24,000

For end bearing $\frac{R}{t(A + N)}$, but not to exceed 24,000

WHERE

R = concentrated interior load or end reaction, in pounds.

t = thickness of web, in inches.

A = Length of bearing, in inches.

N = distance from outer face of flange to web toe of fillet, in inches.

(k) **Effective Span Length.** Beams, girders and trusses shall ordinarily be designed on the basis of simple spans whose effective length is equal to the distance between centers of gravity of the members to which they deliver their end reactions.

If, on the assumption of end restraint, full or partial, based on continuous or cantilever action, beams, girders, and trusses are designed for a shorter effective span length than that specified in the paragraph above, their sections, as well as the sections of the members to which they connect, shall be designed to carry the shears and moments so introduced, in addition to all other forces without exceeding at any point the unit stresses specified in Section 2702.

**Thickness
of
Materials**

Sec. 2705. The minimum thickness of metal in structural steel shapes shall be: for sections exposed to the weather five-sixteenths inch (5/16"); for interior construction one-quarter inch (1/4"); and shall be not less than one-half inch (1/2") at every point for any cast iron or cast steel member, except as follows:

Exceptions: 1. The webs of channels and I-beams, the edges of rolled steel sections, steel joists, signs, skylight bars, non-bearing walls and partitions, suspended ceilings, cornice brackets, steel studs, and similar steel shapes shall not be limited to the above thickness requirements except as provided in Section 2715. (See also Section 3316 for outside stairways.)

2. In steel trusses carrying roof loads only on buildings not exceeding two stories in height, the minimum thickness of metal shall be 3/16", provided that no projecting part of any compression member shall be less in thickness than 1/8" of the unsupported width of the outstanding leg or projecting part.

**Compression
Splices**

Sec. 2706. Compression members when faced for bearings shall be spliced sufficiently to hold the connected members accurately in place. Other joints in riveted work, whether in tension or compression, shall be spliced so as to transfer the stress to which the member is subject.

**Gross and
Net
Sections**

Sec. 2707. (a) **Riveted Holes.** In computing net area the diameter of a rivet hole shall be taken as one-eighth inch (1/8") greater than the nominal diameter of the rivet.

(b) **Pin Holes.** In pin connected tension members, the net section across the pin hole, transverse to the axis of the mem-

ber, shall be not less than 140 per cent and the net section beyond the pin hole, parallel with the axis of the member, not less than 100 per cent, of the net section of the body of the member.

In all pin connected riveted members the net width across the pin hole, transverse to the axis of the member, shall preferably not exceed 12 times the thickness of the member at the pin.

(c) **Chain of Holes.** In the case of a chain of holes extending across a part in any diagonal or zigzag line, the net width of the part shall be obtained by deducting from the gross width the sum of the diameters of all the holes in the chain, and adding to the section so obtained for each gauge space in the

chain, the quantity $\frac{s^2}{4g}$

WHERE

s = longitudinal pitch of any two successive holes

g = transverse gauge of the same two holes.

The critical net section of the part is obtained from the chain which gives the least net width.

(d) **Gross Width of Angles.** For angles, the gross width shall be the sum of the widths of the legs less their thickness. The gauge for the holes in opposite legs shall be the sum of the gauges from back of angle less the thickness.

(e) **Splice Members.** For splice members, the thickness shall be only that part of the thickness of the member which has been developed by rivets beyond the section considered.

(f) **Designed Sections.** Unless otherwise specified, tension members shall be designed on the basis of net section. Columns shall be designed on the basis of gross section. Beams and girders shall be designed in accordance with Section 2704.

Sec. 2708. (a) Minimum Number of Rivets. Connections carrying calculated stresses, except for lacing, sag bars and girts, shall have not fewer than two rivets. Connections

(b) **Eccentricity in Members.** Members meeting at a joint shall have their gravity axis meet at a point if practicable; if not, provision shall be made for their eccentricity.

(c) **Eccentricity in Rivets.** The rivets at the ends of a member transmitting stresses into that member should have their centers of gravity on the line of the center of gravity of the member; if not, provision shall be made for the effect of the resulting eccentricity. Pins may be so placed as to counteract the effect of bending due to dead load.

(d) **Eccentricity in Angles.** Where angles in tension are connected through but one leg and the eccentricity is not taken into account, only 80 per cent of the net section of the angle shall be considered as effective.

(e) **Eccentricity in Members in Flexure.** When beams, girders or trusses are designed on the basis of simple spans, their

Section 2708

end connections may ordinarily be designed for the reaction shears only. If, however, the eccentricity of the connection is excessive, provision shall be made for the resulting moment.

(f) **Combined Shear and Moment.** When beams, girders or trusses are subject both to reaction shear and end moment, due to full or partial end restraint, based on continuous or cantilever action, their connections shall be especially designed to carry both shear and moment without exceeding at any point the unit stresses prescribed in Section 2702. Ordinary end connections comprising only a pair of web angles, with not more than nominal seat and top angle, shall not be assumed to provide for this kind of end moment.

(g) **Filler Plates.** When rivets carrying computed stress pass through fillers, the fillers shall be extended beyond the connected member and the extension secured by sufficient rivets to develop the strength of the filler.

(h) **Fillers Under Stiffeners.** Fillers under plate girder stiffeners at end bearing or points of concentrated loads shall be secured by sufficient rivets to prevent excessive bending and bearing stresses.

(i) **Riveted Joints.** All joints in riveted work, whether in tension or compression, shall be so spliced as properly to transmit all stresses, except as provided in Section 2706.

The minimum distance from the center of any rivet or bolt

TABLE No. I—MINIMUM EDGE DISTANCES

Rivet Diameter (Inches)	Minimum Edge Distance (Inches) for Punched Holes in		
	Sheared Edge	Rolled Edge of Plates & Sections with Parallel Flanges	Rolled Edge of Sections with Sloping Flanges
$\frac{1}{2}$	1	$\frac{7}{8}$	$\frac{3}{4}$ *
$\frac{5}{8}$	$1\frac{1}{8}$	1	$\frac{7}{8}$ *
$\frac{3}{4}$	$1\frac{1}{4}$	$1\frac{1}{8}$	1*
$\frac{7}{8}$	$1\frac{1}{2}$	$1\frac{1}{4}$	$1\frac{1}{8}$ *
1	$1\frac{3}{4}$	$1\frac{1}{2}$	$1\frac{1}{4}$ *
$1\frac{1}{8}$	2	$1\frac{3}{4}$	$1\frac{1}{2}$ *
$1\frac{1}{4}$	$2\frac{1}{4}$	2	$1\frac{3}{4}$ *

*May be decreased $\frac{1}{8}$ inch when holes are near end of beam.

TABLE No. II—SPACING OF RIVET HOLES

Rivet Diameter (in Inches)	Center to Center Spacing (in Inches)
$1\frac{1}{4}$	$4\frac{1}{2}$
$1\frac{1}{8}$	4
1	$3\frac{1}{2}$
$\frac{7}{8}$	3
$\frac{3}{4}$	$2\frac{1}{2}$
$\frac{5}{8}$	2
$\frac{1}{2}$	$1\frac{1}{4}$

hole to any edge shall be that given in Table No. I of this chapter.

The minimum distance between centers of rivet holes shall be three diameters of the rivet; but the distance shall be not less than shown in Table No. II of this Chapter.

The maximum pitch in the line of stress of compression members composed of plates and shapes shall not exceed 16 times the thinnest outside plate or shape, or 20 times the thinnest enclosed plate or shape with a maximum of twelve inches (12"); and at right angles to the direction of stress the distance between lines of rivets shall not exceed 30 times the thinnest plate or shape. For angles in built sections with two gauge lines, with rivets staggered, the maximum pitch in the line of stress in each gauge line shall not exceed 24 times the thinnest plate with a maximum of eighteen inches (18").

In tension members composed of two angles, a pitch of three feet six inches (3'-6") will be allowed, and in compression members two feet (2'-0") but the ratio l/r for each angle between rivets shall be not more than three-fourths of that of the whole member.

The pitch of rivets at the ends of built-up compression members shall not exceed four diameters of the rivets for a length equal to one and one-half times the maximum width of the member.

The minimum distance between the center of any rivet under computed stress, and the end or other boundary of the connected member toward which the pressure of the rivet is directed, shall be not less than the shearing area of the rivet shank (single or double shear respectively) divided by the plate thickness. This end distance may however be decreased in such proportion as the stress per rivet is less than that permitted under Section 2702; and the requirement may be disregarded in case the rivet in question is one of three or more in a line parallel to the direction of the stress.

Sec. 2709. In proportioning rivets, the nominal diameter of the rivet shall be used.

Rivets carrying calculated stresses, whose grip exceeds five diameters, shall have their number increased one per cent for each additional one-sixteenth inch ($\frac{1}{16}$ ") in the rivet grip. Special care shall be used in heating and driving such rivets.

Rivets shall be used for the connections of main members carrying live loads which produce impact, and for connections subject to reversal of stresses.

Unfinished bolts may be used in shop or field work for connections in small structures used for shelters, and for secondary members of all structures such as purlins, girts, door and window framing, alignment bracing and secondary beams in floor.

The effective bearing area of pins, bolts, and rivets shall be the diameter multiplied by the length in bearing; except that for countersunk rivets, half the depth of the countersink shall be deducted.

Rivets shall be used in the following cases:

In all connections in structures over one hundred feet (100') in height when the height is more than two and one-half times the minimum horizontal dimension at the ground line.

**Rivets
and
Bolts**

Sections 2709-2711

In all connections in structures one hundred feet (100') or less in height where the height is more than four times the least horizontal dimension at the ground line.

In all connections of beams and girders to columns and of beams and girders bracing columns in buildings over one hundred feet (100') in height, and in column splices of buildings more than two hundred feet (200') in height.

In all connections for supports of machinery or other moving loads.

Unfinished bolts may be used for connections not mentioned in the preceding paragraphs.

Turned bolts in reamed holes may be used, in place of rivets, in either shop or field work where it is impracticable to obtain satisfactory power driven rivets, provided holes are as specified in Section 2717. The finished shank shall be long enough to provide a full grip for the nut, and washers shall be used under all nuts.

The end reaction stresses of trusses, girders, or beams, and the axial stresses of tension or compression members which are carried on rivets, shall have such stresses developed by the shearing and bearing values of the rivets or bolts.

Welded Connections

Sec. 2710. Fusion welding may be used (in place of riveting or bolting) for connecting structural steel or wrought iron parts or members to one another, but in no case shall the stresses in such joints exceed the allowable unit working stresses given in the following table:

Allowable Unit Working Stresses for Static Loads

Tension in weld metal (butt welds).....	13,000 lbs. per sq. in.
Shear in weld metal (fillet welds).....	11,300 lbs. per sq. in.
Compression in weld metal.....	18,000 lbs. per sq. in.

Maximum fiber stresses due to bending shall not exceed the values prescribed above for tension and compression, respectively. In designing welded joints adequate provision shall be made for bending stresses due to eccentricity, if any, in the disposition or section of base metal parts.

The same proportional increase in the above working stresses shall be allowed for the various given conditions as specified in Section 2702, Subsections (f) and (g).

Sections one to eight inclusive of the Code for Fusion Welding and Gas Cutting in Building Construction, Code I, Part A; also Appendices I, II, III, and IV, Edition of 1937,¹ formulated by the American Welding Society, shall be followed in the design and execution of structural welding.

Construction Details

Sec. 2711. Trusses shall be riveted structures and only when there is sufficient reason to justify, as where riveted field connections become unwieldy, may they be designed as pin-connected structures.

All joints in riveted work, whether in tension or compression, shall be spliced properly to transmit the stresses.

Bracing shall be sufficient to withstand safely wind and other forces when the building is in the process of erection as well as after completion.

¹See Specification Documents.

When two or more plates are in contact they shall be stitch riveted with rivets not more than twelve inches (12") apart in either direction.

The ends of beams, channels, girders and trusses that bear on masonry or reinforced concrete shall be so framed that the allowable stresses for masonry or reinforced concrete shall not be exceeded, and anchors of ample size and strength shall be provided thoroughly embedded in the masonry or reinforced concrete construction.

The ends of all beams, channels, girders, girts, purlins and similar members, that meet on a beam, girder, truss, column or pier shall be connected to each other by a strap or through the carrying members with not less than two bolts or rivets each not less than five-eighths inch ($\frac{5}{8}$ ") in diameter in the end of each connecting member.

Tie rods shall be proportioned to resist their respective stresses, and holes for them shall be placed as near the spring of the arches as practicable.

Sec. 2712. (a) Compression Members. The open sides of compression members shall be provided with lacing having tie plates at each end and at intermediate points if the lacing is interrupted. Tie plates shall be as near the ends as practicable. In main members carrying calculated stresses the end tie plates shall have a length of not less than the distance between the lines of rivets connecting them to the flanges, and intermediate ones of not less than one-half of this distance. The thickness of tie plates shall be not less than one-fiftieth of the distance between the lines of rivets connecting them to the segments of the members, and the rivet pitch shall be not more than four diameters. Lattice

(b) **Tension Members.** Tie plates shall be used to secure the parts of tension members composed of shapes. They shall have a length not less than two-thirds of the length specified for tie plates in compression members. The thickness shall be not less than one-fiftieth of the distance between the lines of rivets connecting them to the segments of the member and they shall be connected to each segment by at least three rivets.

(c) **Spacing of Lacing Bars.** Lacing bars of compression members shall be so spaced that the ratio l/r of the flange included between their connections shall be not over three-fourths of that of the member as a whole.

(d) **Proportioning of Lacing Bars.** Lacing bars shall be proportioned to resist a shearing stress normal to the axis of the member equal to two per cent of the total compressive stress of the member. In determining the section required the compression formula shall be used, l being taken as the length of the bar between the outside rivets connecting it to the segment for single lacing and 70 per cent of that distance for double lacing. The ratio l/r shall not exceed 140 for single lacing and 200 for double lacing.

(e) **Thickness of Lacing Bars.** The thickness of lacing bars shall be not less than one-fortieth for single lacing and

¹See "Specification Documents".

Sections 2712-2715

one-sixtieth for double lacing of the distance between end rivets; their minimum width shall be three times the diameter of the rivets connecting them to the segments.

(f) **Inclination of Lacing Bars.** The inclination of lacing bars to the axis of the members shall preferably be not less than 45 degrees for double lacing and 60 degrees for single lacing. When the distance between rivet lines in the flanges is more than fifteen inches (15") the lacing shall be double and riveted at the intersection if bars are used, or else shall be made of angles.

Pins and Pin Holes

Sec. 2713. Pins shall be long enough to insure a full bearing of all parts connected upon the turned-down body of the pin.

Members packed on pins shall be held against lateral movement.

Pin holes shall be reinforced by plates wherever necessary to give proper bearing. At least one plate shall be as wide as the projecting flanges will allow. Where angles are used this plate shall contain sufficient rivets to distribute their portion of the pin pressure to the full cross section of the member.

Bearing Plates and Anchorage

Sec. 2714. Provision shall be made to transfer the column loads to the footings and foundations.

Column bases shall be set level and to correct elevation with full bearing on the masonry.

Column bases shall be finished to accord with the following requirements:

1. Rolled steel bearing plates two inches (2") or less in thickness may be used without planing or straightening; rolled steel bearing plates over two inches (2") but less than four inches (4") in thickness may be straightened by pressing, or planed on all bearing surfaces if presses are not available; rolled steel bearing plates four inches (4") or over in thickness shall be planed on all bearing surfaces (except as noted under paragraph 3 of this section).

2. Column bases other than rolled steel bearing plates shall be planed on all bearing surfaces (except as noted in paragraph 3).

3. The bottom surfaces of column bases which rest on masonry foundations and are grouted to insure full bearing contact need not be planed.

4. Anchor bolts shall be of sufficient size and number to develop the computed stresses.

Light Steel Construction

Section 2715. (a) General. Steel studs and other supports used in the structural frame of light steel construction and steel joists shall be light weight rolled steel sections or sections formed from light gauge flat rolled steel sheets, or a combination of both used alone or in combination with other materials of construction, all of which shall be of a standard or commonly accepted type or shape; or such steel joists and studs may be of a determinate truss design built up of rolled structural steel sections effectively arc or resistance welded together. Joists other

than those consisting of a single rolled structural steel section with solid web shall not be used in the floor construction of buildings over eight stories in height. For such steel studs the ratio l/r shall not exceed 180.

The effective width of flanges on joists or bearing studs having a channel section shall not exceed 20 times the thickness of the flange. The effective width of flanges on such joists and studs having an I-section shall not exceed 20 times the thickness of the flange on each side of the neutral axis. The effective width of steel sheets or plates constructed to act integrally with steel joists, studs, or other steel supporting members shall not extend more than 20 times the thickness of such sheet or plate on each side of the point or points of fixation to such joists, studs or supporting member.

Open web or trussed members shall be so constructed that the lines of force of all connected members shall intersect at a point or proper allowance shall be made in the design for any resulting stress. The web elements shall be of sufficient strength to resist effectively the shearing stresses.

The following are the minimum thicknesses of metal permitted for various members of the structural frame of light steel construction:

Bearing studs, joists and roof framing members—16 gauge
Cellular steel walls—18 gauge

All connections shall be riveted, bolted or welded. All steel work, including welds and connections, except where entirely encased in concrete, shall be thoroughly cleaned and given one coat of acceptable metal protection well worked into the joints and open spaces.

(b) **Stresses.** Stresses in structural members of light steel construction shall not exceed those specified in Section 2702. No steel joist under its calculated load shall deflect more than $1/360$ of the span, when plaster is supported. The actual spacing of floor joists, studs or other light steel wall supports shall be determined by their capacity to sustain the loads which they carry, but in no case shall such spacing exceed four feet (4').

(c) **Construction Details.** Steel studs or other steel supporting members used in the structural frame of light steel construction and steel joists shall be connected to the supporting beams, girders, foundations or other steel supporting members by arc or resistance welding, riveting, bolting or other approved methods. All such welds in light steel construction shall be made on two sides or two edges of each bearing in such a manner as to resist effectively the stresses developed. Resistance welding shall develop the full strength of the member welded.

Steel joists supported on masonry and reinforced concrete shall have end bearings at least four inches (4") in length and the ends of such joists resting on masonry or reinforced concrete shall be provided with approved joist anchors thoroughly embedded therein.

Bearing plates, when required by design, shall be securely welded, bolted or riveted to such joists, studs or other supporting members.

Bearing studs or other vertical bearing members shall rest on a sole or plate having an effective width equal to the depth

Sections 2715-2717

of such member and having a thickness of not less than 14 gauge but in no case less than that of the vertical member resting thereon unless each such vertical bearing member is thoroughly embedded in the concrete foundation. Such soles or plates shall be effectively anchored to the foundation and all splices and intersections shall develop the full strength of the members connected.

When bearing studs or other vertical bearing members are spliced, the full strength of such members shall be developed in the splice.

Where studs do not continue full length from one story through the next story above, a cap plate or steel member shall be provided on top of the lower story studs or a sill plate on the upper story. Such cap plate and/or sill plate shall be of sufficient strength to distribute adequately the loads from the upper story studs to the lower story studs.

All horizontal or diagonal ties and/or bracing in exterior walls and bearing partitions shall be effectively arc welded, bolted or riveted to the structural frame or effectively anchored to supporting masonry.

Where plumbing, heating or other pipes or conduits are placed in or partly in an exterior wall or bearing partition necessitating the cutting of soles or plates, bracing or structural member in said wall, such members shall be reinforced so as to provide sufficient strength to resist the stresses imposed thereon or proper provisions shall be made to transfer such stresses to the points of support.

In buildings over eight stories in height in which steel joisted floor construction is used, all connections between steel joists and primary members of the structure shall be approved standard connection angles and power driven rivets, or unfinished bolts as provided for light steel beams in the handbook, "Steel Construction" of the American Institute of Steel Construction, Inc., dated October, 1937.

Expansion

Sec. 2716. Proper provision shall be made for expansion and contraction.

Workmanship

Sec. 2717. All workmanship shall be equal to the best practice in modern structural shops.

Drifting to enlarge unfair holes shall not be permitted. Holes that must be enlarged to admit the rivets shall be reamed. Poor matching of holes shall be cause for rejection.

All material shall be clean and straight. If straightening or flattening is necessary, it shall be done by a process that will not injure the material. Sharp kinks or bends shall be cause for rejection.

Rolled sections, except for minor details, shall preferably not be heated, or, if heated shall be annealed.

All steel castings shall be properly annealed.

Material may be punched one-sixteenth inch ($\frac{1}{16}$ ") larger than the nominal diameter of the rivets, whenever the thickness of the metal is equal to or less than the diameter of the rivets, plus one-eighth inch ($\frac{1}{8}$ "). When the metal is thicker than the diameter of the rivet, plus one-eighth inch ($\frac{1}{8}$ "), the holes shall be drilled, or sub-punched and reamed.

Holes for shop turned bolts shall be sub-punched and reamed

Section 2717

or drilled from the solid. Holes for field turned bolts shall be sub-punched in the shop and reamed in the field.

When sub-punching and reaming is required the die used for punching shall be one-sixteenth inch ($\frac{1}{16}$ ") smaller than the nominal diameter of the rivet. Rivet holes, after assembling, shall be reamed to a diameter one-sixteenth inch ($\frac{1}{16}$ ") greater than the nominal diameter of the rivet. Turned bolt holes, after assembling, shall be reamed (for field bolts in the field) to a diameter one-fiftieth inch ($1/50$ ") larger than the diameter of the turned bolt.

Rivets are to be driven hot, and wherever practicable, by power. Rivet heads shall be of hemispherical shape and uniform in size throughout the work for the same size rivet, full, neatly finished, and concentric with the holes. Rivets, after driving, shall be tight, completely filling the holes, and with heads in full contact with the surface.

Rivets shall be heated uniformly to a temperature not exceeding 1950° F. They shall not be driven after their temperature is below 1000° F. Loose, burned and otherwise defective rivets shall be replaced.

Compression joints depending upon contact bearing shall have the bearing surfaces truly faced after the members are riveted. All other joints shall be cut or dressed true and straight.

Finished members shall be true to line and free from twists, bends and open joints.

Compression members may have a lateral variation not greater than 1/1000 of the axial length between points which are to be laterally supported.

An allowable variation of one thirty-second inch ($\frac{1}{32}$ ") is permissible in the overall length of members with both ends milled.

Members without milled ends which are framed to other steel parts of the structure may have a variation from the detailed length not greater than one-sixteenth inch ($\frac{1}{16}$ ") for members thirty feet (30') or less in length, and not greater than one-eighth inch ($\frac{1}{8}$ ") for members over thirty feet (30') in length.

Planing or finishing of sheared plates or shapes will not be required unless specifically called for on the drawings.

All parts of riveted members shall be well pinned or bolted and rigidly held together while riveting. Drifting done during assembling shall not distort the metal or enlarge the holes.

Gas cutting may be done under the following conditions:

1. The contractor shall be required to satisfy the Building Inspector as to his ability to produce satisfactory gas cuts.
2. Gas cut edges shall be regular in contour.
3. Gas cutting may be used in the preparation of base metal parts for welding, provided the edges so cut are thoroughly cleaned after cutting so as to expose clean metal.
4. Gas cutting shall not be permitted to replace the milling of surfaces specified elsewhere in this Code.
5. Gas cutting shall not be permitted on any member while it is carrying stress. To determine the net area of members so cut, one-eighth inch ($\frac{1}{8}$ ") shall be deducted from the gas cut

Sections 2717-2719

edges. The radius of re-entrant gas cut fillets shall be as large as possible, but never less than one inch (1"). This restriction shall not apply to detail cutting for the correction of minor fabricating errors, where the removal of metal resulting from such gas cutting would not reduce the required strength of the member that is to be cut.

6. Gas cutting of holes in any member which has not been designed therefor shall not be permitted.

Painting

Sec. 2718. Parts not in contact, but inaccessible after assembling, shall be properly protected by paint.

All steel work, except where entirely encased in concrete, shall be thoroughly cleaned and given one coat of approved metal protection well worked into the joints and open spaces.

Machine finished surfaces shall be protected against corrosion.

Cast iron columns shall not be painted until after acceptance by the Building Inspector.

Erection

Sec. 2719. The frame of all steel skeleton buildings shall be carried up true and plumb, and temporary bracing shall be introduced wherever necessary to take care of all loads to which the structure may be subjected, including erection equipment, and the operation of same. Such bracing shall be left in place as long as required for safety or deemed necessary by the Building Inspector.

As erection progresses the work shall be securely bolted up to take care of all dead load, wind and erection stresses.

Wherever piles of material, erection equipment, or other loads are carried during erection, proper provision shall be made to take care of the resulting stresses.

No riveting or welding shall be done until the structure has been properly aligned.

Rivets driven in the field shall be heated and driven with the same care as those driven in the shop.

In the setting or erecting of steel work the individual pieces shall be considered plumb or level when the error does not exceed 1 to 500. For exterior columns and columns adjacent to elevator shafts of multiple story buildings the error shall not exceed 1 to 1000 of the total height of the column.

Field painting shall be considered a phase of maintenance, not covered herein, and shall include spot painting of field rivet heads and all abrasions of the shop coat, and so forth.

PART VII

DETAILED REGULATIONS

CHAPTER 28—EXCAVATIONS, FOOTINGS AND FOUNDATIONS

Sec. 2801. All excavations for buildings and excavations accessory thereto shall be protected and guarded against danger to life and property. All permanent excavations shall have retaining walls of masonry or reinforced concrete of sufficient strength to retain the embankment together with any surcharged loads. No excavation for any purpose shall extend within one foot (1') of the angle of repose or natural slope of the soil under any footing or foundation, unless such footing or foundation is first properly underpinned or protected against settlement. **Excavations**

Any person making or causing an excavation to be made to a depth of twelve feet (12'), or less, below the grade, shall protect the excavation so that the soil of adjoining property will not cave in or settle, but shall not be liable for the expense of underpinning or extending the foundation of buildings on adjoining properties where his excavation is not in excess of twelve feet (12') in depth. Before commencing the excavation the person making or causing the excavation to be made shall notify in writing the owners of adjoining buildings not less than 10 days before such excavation is to be made that the excavation is to be made and that the adjoining buildings should be protected. The owners of the adjoining properties shall be given access to the excavation for the purpose of protecting such adjoining buildings.

Any person making or causing an excavation to be made exceeding twelve feet (12') in depth below the grade, shall protect the excavation so that the adjoining soil will not cave in or settle, and shall extend the foundation of any adjoining buildings below the depth of twelve feet (12') below grade at his own expense. The owner of the adjoining buildings shall extend the foundations of his buildings to a depth of twelve feet (12') below grade at his own expense as provided in the preceding paragraph.

Sec. 2802. Footings and foundations, unless specifically provided, shall be constructed of masonry or reinforced concrete and shall in all cases extend below the frost line. Masonry units used in foundation walls and footings shall be laid up in portland cement mortar. The base areas of all footings and foundations shall be proportioned as specified in Section 2311. **Footings and Foundations**

Footings shall be so designed that the allowable bearing capacity of the soil in tons per square foot as given below shall not be exceeded unless the particular soil on which the building is to be placed shows a greater bearing capacity than that specified in this Section.

Rock.....	Not more than 20 per cent of the ultimate crushing strength of such rock.
Gravel or coarse sand, well cemented.....	6 tons
Dry, hard clay or coarse firm sand (hardpan).....	4 tons
Moderately dry clay or moderately dry sand and clay..	3 tons
Ordinary clay and sand.....	2 tons
Soft clay, sandy loam or silt.....	1 ton
Adobe.....	½ ton

Where the bearing capacity of the soil is not definitely known or is in question, the Building Inspector may require load tests or other adequate proof as to the permissible safe bearing capacity at that particular location. To determine the safe bearing capacity of soil it shall be tested by loading an area not less than two square feet (2 sq. ft.) to not less than twice the maximum bearing capacity desired for use. Such double load shall be sustained by the soil until no additional settlement takes place for a period of not less than 48 hours in order that such desired bearing capacity may be used. Examination of sub-soil conditions may be required when deemed necessary.

Foundations shall be built upon natural solid ground where possible. Loam or soil containing organic matter shall not be used to support buildings exceeding one story in height. Where solid natural ground does not occur at the foundation depth, such foundations shall be extended down to natural solid ground or piles shall be used, unless there is a practically level fill of good ground which has been in place a sufficient length of time to settle properly, when such fill may be used.

Piles

Sec. 2803. (a) **General Requirements.** All piles used to support any building or part thereof shall be driven to a reasonably solid bearing in such a manner as not to impair their strength. No pile or group of piles shall be loaded eccentrically.

(b) **Wood Piles.** Wood piles shall be of oak, Douglas fir, Southern pine, cedar, or other approved wood containing no evidences of decay. The piles shall be free from short kinks or reverse bends and shall have a uniform taper from butt to tip. A straight line drawn from the center of the butt to the tip shall lie wholly within the body of the pile. The diameter of wood piles at the point shall be not less than six inches (6") and at the butt shall be not less than ten inches (10") for piles twenty-five feet (25') or less in length, and not less than twelve inches (12") at the butt for piles more than twenty-five feet (25') in length. No piles with spiral grain which exceeds one complete turn in forty feet (40'), shall be used. All wood piles and capping shall be cut off and/or placed below mean low water level or below lowest ground water level, with the exception of creosoted piles as covered in this Section.

Creosoted piles of Douglas fir or Southern pine when treated with Grade 1 creosote under pressure with the full-cell creosote treatment complying with Specification No. 41-a or No. 39-a of the American Wood Preservers Association in such a manner as to provide a final retention of not less than 12 pounds per cubic foot in Douglas fir piling and not less than 15 pounds per cubic foot in Southern pine piling may be used as follows:

Section 2803

1. Where the upper portion of the creosoted piling is to be exposed and available for inspection the cut-off may be above ground level or above water level. **Piles (Con't.)**

2. Where the upper part of the creosoted piling will not be readily available for inspection the cut-off shall be below ground level but may be above ground water level provided the tops of the cut-off piles are treated with three coats of hot creosote and capped with concrete so that no part of the pile will be exposed to the air.

No creosoted piling shall be used which has been so injured in handling or driving as to penetrate the creosoted shell, except in the case of bolt holes and unavoidable framing including the top cut-off, all of which shall be treated with three coats of hot creosote.

The allowable load on wood piles shall be in conformity with the requirements of Section 2803 (e).

(c) **Concrete Piles.** Concrete piles shall be of material complying with the requirements for portland cement, fine aggregate, coarse aggregate and reinforcement as specified in Chapter 26 and steel as specified in Chapter 27. The maximum allowable working stress on any concrete pile shall not exceed 20 per cent of the ultimate compressive strength of the concrete used in the piles, determined by tests as specified in Chapter 26. The maximum allowable load on any pile shall not exceed such working stress multiplied by the average cross sectional area of the pile.

Exception: When such pile is cast in a tight steel tube not less than five-sixteenths inch ($\frac{5}{16}$ ") thick, the allowable working stress shall be not more than 25 per cent of the ultimate compressive strength of the concrete plus an allowable stress of not to exceed 7500 pounds per square inch for the steel tube, not including in such latter computation the outer one-sixteenth inch ($\frac{1}{16}$ ") of the steel shell.

Concrete piles cast in place shall be made in such a manner as to insure the exclusion of any foreign matter and to secure a full sized shaft. The length of such piles shall be limited to not more than 30 times the average diameter, except that when cast in steel tubes with a thickness of not less than five-sixteenths inch ($\frac{5}{16}$ ") the length of such piles shall be not greater than 40 times the average diameter. The diameter of concrete-filled steel tubes shall be not less than ten inches (10"), and such piles shall be driven to a full bearing on rock. The diameter of other piles cast in place shall be not less than eight inches (8") at the point and shall have an average diameter of not less than eleven inches (11").

Precast concrete piles shall be sufficiently cured to attain the ultimate strength upon which their use is based, before driving. Such piles shall be reinforced and so handled as not to be fractured in any manner which will affect their durability or strength. Precast concrete piles shall have a diameter at the point of not less than six inches (6"), and an average diameter of not less than ten inches (10"). The length of such piles when driven to rock shall be limited to 20 times the

Section 2803

Piles (Con't.)

average diameter and shall not exceed 40 times the average diameter in any other case.

The allowable load on concrete piles shall be in conformity with the requirements of Section 2803 (e).

(d) **Steel Piles.** Rolled structural steel piles shall comply with the requirements for structural steel as specified in Chapter 27. The minimum thickness of metal shall be three-eighths inch ($\frac{3}{8}$ "). The allowable load on structural steel piles shall be in conformity with the requirements of Section 2803 (e).

(e) **Safe Load.** The assumed safe load on a pile shall not exceed the value given by the following formula, unless such safe load is determined by test loading as provided in this section:

Safe load = $R/5$ for steel piles,

Safe load = $R/4$ for all other piles,

WHERE:

$$R \text{ (for steel piles)} = \frac{12 W h \frac{W + 0.25P}{W + P}}{S + \frac{RL 24,000}{AE}}$$

$$R \text{ (for other piles)} = \frac{12 W h \frac{W + 0.1P}{W + P}}{S + \frac{RL 24,000}{AE}}$$

WHERE—

R = ultimate driving resistance, in tons

W = weight of hammer, in tons

P = weight of pile in tons

S = permanent settlement of pile under the average of the last 10 blows, in inches

h = height of fall of hammer, in feet

L = length of pile, in feet

A = average right cross-sectional area of pile, in square inches

E = modulus of elasticity of pile, in pounds per square inch

No wooden pile shall be loaded in excess of 500 pounds per square inch of the right section of the pile at mid-length.

The safe bearing value of a pile may be determined by a load test, upon due notice to the Building Inspector. The assumed safe load shall not exceed one-half of the load which shows no settlement for 24 hours, and a total settlement not to exceed 0.01 inch per ton of test load.

The supporting value of piles depending solely upon friction when driven in clusters or groups, shall be determined by multi-

Sections 2803-2804

plying the bearing value of a single pile by an efficiency factor as determined by the following formula:

$$\text{Efficiency} = 1 - \theta \left(\frac{(n-1)m + (m-1)n}{90 mn} \right)$$

n = number of piles in a row

m = number of rows

d = diameter of pile

s = center to center spacing of piles

$\tan \theta = d/s$, in which

θ is numerically equal to the angle expressed in degrees

Piles standing free in water or very soft soil shall conform with the applicable column formula as stated in this Code. Piles driven into firm ground may be considered fixed at five feet (5') below the ground surface and in soft material at ten feet (10') below the ground surface.

When precast concrete piles frame into a concrete deck structure, the unsupported length may be taken as two-thirds the distance from the top of the pile to the point of fixity as stated in the foregoing paragraph.

Sec. 2804. (a) Caissons. The footings of any structure **Caissons** may be carried down to a firm foundation by isolated piers of reinforced concrete or by open or pneumatic caissons either with or without enlarged base or bell at the bottom. The safe carrying capacity of such shafts or caissons shall not exceed the allowable unit bearing capacity of the soil multiplied by the area of the base or bell at bottom.

(b) Caissons With Belled Footings. In the case of piers or caissons with belled footings, the slope of the sides of the bell shall not exceed one foot horizontally for each two feet vertically unless properly reinforced in accordance with Section 2621.

CHAPTER 29—WALLS AND PARTITIONS

(Solid Masonry Walls)

General Provisions: Solid Masonry Walls

Sec. 2901. Solid masonry walls shall be supported at right angles to the wall face at intervals not exceeding 18 times the wall thickness in the top story of buildings more than one story in height, or 20 times the wall thickness elsewhere, except as specifically provided in Section 2903. Such lateral support may be obtained by masonry cross walls, piers or buttresses when the limiting distance is measured horizontally or by floors or roof when the limiting distance is measured vertically. Bonding and anchoring of horizontal and vertical framing members to the wall shall be provided sufficient to resist the assumed wind force acting in an outward direction. Floors and roofs shall be so constructed and anchored to such walls as to form a continuous and sufficient anchorage across the building from wall to wall. Anchoring of wood framing to masonry walls shall be as specified in Chapter 25. Piers or buttresses relied upon for lateral support shall have sufficient strength and stability to transfer the wind force acting in either direction to the ground. When walls are dependent upon floors for their lateral support provision shall be made in the building to transfer the lateral forces resisted by all floors to the ground.

Corbels may be built into masonry walls to furnish bearing for joists or other structural parts, but such corbels shall not exceed one-fourth the total thickness of the wall and the projection for each course in such corbel shall not exceed one-half inch ($\frac{1}{2}$ "). Corbeling of walls eight inches (8") or less in thickness shall not be allowed.

Working Stresses

Sec. 2902. The maximum allowable compressive stresses in solid masonry due to combined live, dead and other loads shall not exceed those specified in Sections 2411 and 2412.

Thickness of Exterior Walls Other Than Skeleton Construction

Sec. 2903. (a) **Solid Masonry Bearing Walls.** The thickness of solid masonry walls shall be sufficient at all points to keep the combined stresses due to live, dead and other loads for which the building is designed within the limits specified in Sections 2411 and 2412.

TABLE No. I—MINIMUM THICKNESS, SOLID MASONRY BEARING WALLS

Stories		Nominal Thickness In Inches							
8th	12								
7th	12	12							
6th	12	12	12						
5th	16	12	12	12					
4th	16	16	12	12	12				
3rd	16	16	16	12	12	12			
2nd	20	16	16	16	12	12	12		
1st	20	20	20	16	16	16	12	12	
Basement ..	20	20	20	20	16	16	16	16	12
Stories	8	7	6	5	4	3	2	1	

Section 29

The minimum thickness of solid masonry exterior, bearing or party walls shall be not less in thickness than specified in Table No. I of this Chapter; provided, that in no case shall the uppermost thirty-five feet (35') of such walls be less than twelve inches (12") in thickness, and each successive thirty-five feet (35') or fraction thereof measured downward from the top shall be increased not less than four inches (4") in thickness.

Exceptions: 1. The top story exterior or bearing walls of a building not exceeding four stories or fifty-five feet (55') in height, or the wall of a one-story building of Group E, F or G may be eight inches (8"), provided, that such eight inch (8") wall does not exceed twelve feet (12') unsupported height and that the roof beams or trusses are so placed or constructed as not to develop any direct thrust against the wall.

2. Exterior walls for Group I occupancies shall be as specified in part (c) of this Section.

3. Solid masonry exterior bearing or party walls constructed as specified in part (d) of this Section may be of lesser thickness.

(b) **Non-Bearing Walls.** Non-bearing walls of solid masonry shall be not less in thickness than specified in Table No. II of this Chapter; provided, that in no case shall the uppermost fifteen feet (15') of such wall be less than eight inches (8") thick and that each successive fifty feet (50') or fraction thereof measured downward from the top shall be increased not less than four inches (4") in thickness.

Exceptions: 1. Solid masonry non-bearing walls for Group I occupancies not over three stories high shall be as specified in part (c) of this Section.

(c) **Walls for Group I Occupancies.** Solid masonry walls, either bearing or non-bearing, for Group I occupancies not over three stories in height shall not be less in thickness than specified in Table No. III of this Chapter.

(d) **Stiffened Walls.** Where solid masonry bearing or non-bearing walls are strengthened laterally by masonry buttresses

TABLE No. II—MINIMUM THICKNESS, SOLID MASONRY NON-BEARING WALLS

Stories		Nominal Thickness In Inches							
8th	8								
7th	12	8							
6th	12	12	8						
5th	12	12	12	8					
4th	12	12	12	12	8				
3rd	16	12	12	12	12	8			
2nd	16	16	12	12	12	12	8		
1st	16	16	16	16	12	12	8	8	
Basement ..	20	16	16	16	16	12	12	12	8
Stories	8	7	6	5	4	3	2	1	

**TABLE No. III—MINIMUM THICKNESS, WALLS OF
GROUP I OCCUPANCIES**

Stories	Nominal Thickness in Inches		
3rd	8		
2nd	8	8	
1st	12	8	8
Basement	12	12	8
Stories	3	2	1

or cross walls the wall thicknesses specified in parts (a), (b) and (c) of this Section may be reduced between buttresses by one-half the thickness added at the buttress, except that no part of such buttressed wall shall be less than eight inches (8") thick. Buttresses shall be not less in width than one-eighth the clear distance between them and their clear distance apart shall not exceed 24 times the reduced wall thickness. Principal girders and trusses shall rest on the buttresses.

In one-story buildings having walls not over sixteen feet (16') high to the under side of girders or trusses and pilastered as above provided for an eight inch (8") wall between pilasters, such walls may be considered as bearing walls for roof loads and parapet walls only. All materials used in solid masonry walls shall conform in all respects to the requirements for such materials in Chapters 24 and 26.

Bond

Sec. 2904. In all solid unit masonry walls at least every sixth course on both sides of the wall shall be a header course or there shall be at least one full header in every seventy-two square inches (72 sq. in.) of each wall surface. In walls more than twelve inches (12") thick the inner joints of header courses shall be covered with another header course which shall break joints with the course below.

Where running bond is used, every sixth course on each face shall be bonded into the backing by using a full header course at right angles to the face behind split brick.

Piers

Sec. 2905. The unsupported height of isolated piers shall not exceed 10 times their least dimension. Piers of solid unit masonry shall be laid up in cement mortar.

Walls in which the openings are of such an extent as to leave relatively narrow sections exceeding ten feet (10') in height shall have such narrow sections computed and constructed as for isolated piers.

**Chases
and
Recesses**

Sec. 2906. There shall be no chases in eight inch (8") walls or within the required area of any pier, and no chase in any wall or pier shall be deeper than one-third the wall thickness. No horizontal chase shall exceed four feet (4') in length nor shall the horizontal projection of any diagonal chase exceed four feet (4'). No vertical chase shall be closer than two feet (2') to any plaster, cross wall, end wall or other stiffener.

Sections 2906-2907

Recesses for stairways or elevators may be made in walls, but in no case shall the walls at such points be less than the required thickness of walls of the fourth story above the ground floor unless reinforced by additional piers, by steel or reinforced concrete girders or steel or reinforced concrete columns and girders, securely anchored to the walls on each side of such recesses. Recesses for alcoves and similar purposes shall have not less than eight inches (8") of material at the back. Such recesses shall be not more than eight feet (8') in width and shall be arched over or spanned with lintels.

The aggregate area of recesses and chases in the wall of any one story shall not exceed one-fourth the whole area of the face of the wall in that story.

No chases or recesses shall be permitted in any wall which will reduce the fire-resistance of such wall below the minimum specified in this Code.

Openings for doors and windows shall have well buttressed arches or lintels of masonry, or of metal with bearing at each end of not less than four inches (4") on the wall.

The maximum percentage of openings in the horizontal cross section of any wall shall not exceed 50 per cent unless the wall is increased four inches (4") in thickness or such portions of the wall between openings shall be as required for piers in Section 2905.

Walls of Hollow Tile, Concrete Block or Tile, Hollow Walls of Brick and Hollow Monolithic Plain Concrete Walls

Sec. 2907. Walls of hollow clay tile, of concrete block or tile, hollow walls of solid masonry units and hollow monolithic plain concrete walls shall be supported at right angles to the face at intervals not exceeding 16 times the wall thickness in top stories of buildings more than one story in height, or 18 times the wall thickness elsewhere.

General Provisions: Hollow Walls

The general provisions relating to solid masonry walls shall apply to hollow walls as included in this Section; provided, that corbeling from hollow walls shall not be permitted except when such corbels are constructed of solid masonry or reinforced concrete.

Where air spaces are built into the wall the area of such air spaces combined with the area of the cellular space in the tile used in the construction of the wall shall not exceed 45 per cent of the gross cross-sectional area of the wall.

Masonry walls composed of a combination of solid and hollow units shall be not less in thickness than the minimum thickness required for hollow walls as provided in Section 2909.

All materials used in walls of hollow clay tile or concrete block or tile, hollow walls of solid masonry units and hollow monolithic concrete walls shall conform in all respects to the requirements in Chapters 24 and 26 for such materials.

TABLE No. IV—MINIMUM THICKNESSES—HOLLOW WALLS

Stories		Nominal Thickness In Inches							
8th	12								
7th	12	12							
6th	16	12	12						
5th	16	16	12	12					
4th	20	16	16	12	12				
3rd	20	20	16	16	12	12			
2nd	24	20	20	16	16	12	12		
1st	24	24	20	20	16	16	12	12	
Basement ..	28	24	24	20	20	16	16	12	
Stories	8	7	6	5	4	3	2	1	

**Working
Stresses**

Sec. 2908. The maximum allowable compressive stresses in walls of hollow tile, concrete block or tile, hollow walls of brick or hollow monolithic plain concrete walls due to combined live, dead and other loads shall not exceed those specified in Chapters 24 and 26.

**Thickness
and
Height of
Walls
Other Than
Skeleton
Construction**

Sec. 2909. Walls of hollow clay tile and concrete block or tile, hollow walls of solid masonry units and hollow monolithic concrete walls shall be not less in thickness than as specified in Table No. IV of this Chapter; provided, that in no case shall the uppermost twenty-five feet (25') of such walls be less than twelve inches (12") in thickness, and each successive twenty-five feet (25') or fraction thereof measured downward from the top shall be increased not less than four inches (4") in thickness.

Exceptions: Walls constructed with either hollow clay tile, as specified in Section 2405 for exterior and bearing walls or hollow concrete block or tile as specified in Section 2406 may be of the same thickness as solid masonry walls when not exceeding two stories in height, and such walls shall be laid in cement mortar proportioned as specified in Sec. 2410. One-story private garages and one-story residences may have bearing and non-bearing walls of hollow tile, concrete block or tile, hollow brick or hollow monolithic plain concrete walls six inches (6") thick.

Bond

Sec. 2910. All hollow masonry units in a wall shall have all contact surfaces solidly embedded in mortar and laid with a full bond.

Where two or more hollow units are used to make up the thickness of a wall the inner and outer courses shall be bonded at vertical intervals not exceeding three courses by lapping at least one cell completely over a cell of the unit below.

**Beam
Supports**

Sec. 2911. Suitable provision shall be made in hollow walls or walls of hollow units at each line of floor joists or beams to shut off the spaces above from those below with incombustible material.

Sections 2911-2915

Except where hollow units having at least three cells in each eight inches (8") of thickness are laid with cells horizontal, joists, beams or other structural members shall not be seated directly on hollow walls or walls of hollow units, but shall be supported on at least three courses of brick or equivalent concrete or metal plate of sufficient thickness and size to distribute the load to the webs and shells in such a manner as not to exceed the allowable unit stress.

Sec. 2912. Hollow clay tile or concrete block or tile, except hollow clay tile as specified in Section 2405 for exterior and bearings walls, and special hollow concrete block or tile, as specified in Section 2406, shall not be used for isolated piers. Wall sections greater in height than 10 times their least dimension and two feet (2') or less in width shall be considered as isolated piers. Isolated piers shall be laid up in cement mortar.

Piers

Sec. 2913. Chases and recesses in walls of hollow tile, hollow concrete block or tile, or in hollow walls of brick shall not exceed in extent those permitted for solid masonry walls under the same conditions. Chases and recesses shall not be cut in walls of the above types, but may be built in. No chases or recesses shall be permitted in any wall which will reduce the fire-resistance of such wall below the minimum specified in this Code.

Chases and Recesses

Reinforced tile lintels over openings made by filling the cells of the hollow units with cement mortar or concrete and inserting reinforcing bars may be used. Such lintels shall be computed as reinforced concrete beams on the basis of the enclosed concrete or mortar.

Reinforced Concrete Walls

Sec. 2914. The general provisions of Chapter 26 of this Code shall apply to the design and construction of reinforced concrete walls provided that where any conflict may occur the provisions of Sections 2914 to 2918 inclusive, shall govern.

General Provisions

Walls shall be designed for any lateral or other loads to which they are subjected. Proper provision shall be made for eccentric loads and wind stresses.

The maximum allowable compressive stress in reinforced concrete bearing walls with minimum reinforcement as required by Section 2916 shall not exceed $0.2f'_c$ when the unsupported height does not exceed 10 times the thickness nor $0.11f'_c$ when the unsupported height is 25 times the thickness with allowable stresses proportional between these limits. When the reinforcement in bearing walls is designed, placed and anchored in position as for columns, the working stresses shall be on the basis of formulas in Chapter 26 for columns. In the case of concentrated loads, the length of the wall to be considered as effective for each shall not exceed the center to center distance between loads, nor shall it exceed the width of the bearing plus four times the wall thickness. Ratio of p , as defined in Chapter 26 shall not exceed 0.04.

Sec. 2915. Reinforced concrete bearing walls shall have a thickness of at least one twenty-fifth of the unsupported height or width, whichever is the shorter; provided however, that approved buttresses, built-in columns, or piers designed to

Minimum Thickness

carry all the vertical loads, may be used in lieu of increased thickness.

Bearing walls of reinforced concrete shall be not less than six inches (6") in thickness for the uppermost fifteen feet (15') of their height; and for each successive twenty-five feet (25') or fraction thereof downward, the minimum thickness shall be increased one inch (1").

Pancl and enclosure walls of reinforced concrete shall have a thickness of not less than five inches (5") and not less than one-thirtieth the distance between the supporting or enclosing members.

Exterior basement walls, foundation walls, and party walls shall be not less than eight inches (8") thick.

Anchorage and Reinforce- ment

Sec. 2916. Reinforced concrete walls shall be anchored to concrete floors, columns, pilasters, buttresses and intersecting walls with reinforcement at least equivalent to three-eighths inch ($\frac{3}{8}$ ") round bars eighteen inches (18") on centers, for each layer of wall reinforcement.

Reinforced concrete walls shall be reinforced with an area of steel in each direction, both vertical and horizontal, at least equal to 0.0025 times the cross-sectional area of the wall, if of bars, and 0.0018 times the area, if of electrically welded wire fabric. The wire of the welded fabric shall be of not less than No. 10 W. & M. gauge. Walls more than eight inches (8") in thickness shall have the reinforcement for each direction placed in two layers parallel with the faces of the wall. One layer consisting of not less than one-half and not more than two-thirds the total required shall be placed not less than one and one-half inches ($1\frac{1}{2}$ ") nor more than one-third the thickness of the wall from the exterior surface. The other layer, comprising the balance of the required reinforcement, shall be placed not less than three-fourths inch ($\frac{3}{4}$ ") and not more than one-third the thickness of the wall from the interior surface. Bars, if used, shall be not less than the equivalent of three-eighths inch ($\frac{3}{8}$ ") round bars, nor shall they be spaced more than eighteen inches (18") on centers. Welded wire reinforcement for walls shall be in flat sheet form.

Piers

Sec. 2917. The unsupported height of piers of reinforced concrete walls shall not exceed 10 times their least dimension unless designed as reinforced concrete columns.

Walls in which the openings are of such an extent as to leave relatively narrow sections exceeding (10) times their least dimension in height shall be considered as piers.

Chases and Recesses

Sec. 2918. Chases and recesses shall be as permitted in solid masonry walls in Section 2906.

Openings for doors and windows shall have reinforced concrete lintels designed as specified in Chapter 26, or fire-protected steel lintels as specified in Chapter 27.

Stone Walls

Quality of Material

Sec. 2919. Stone used in masonry wall construction shall be at least equal in strength to the minimum specified for plain concrete in Section 2407.

Sections 2920-2926

Sec. 2920. The maximum allowable compressive stresses in Working rubble stonework due to combined live, dead and other loads Stresses shall not exceed those specified in Sections 2411 and 2412.

Sec. 2921. Rubble stone walls shall be four inches (4") Lateral thicker than is required for solid brick or concrete walls of the Support and same respective heights, but in no part less than sixteen inches Thickness (16").

The minimum thickness for walls or piers of ashlar masonry properly bonded shall be the same as required for solid brick walls and piers under similar conditions.

The lateral support for stone walls shall conform to the same requirements specified for solid masonry walls in Section 2901.

Sec. 2922. Bond stones extending through the wall and uni- Bond formly distributed shall be provided to the extent of not less than 20 per cent of the area, and there shall be at least one bond stone for every five stretchers.

Sec. 2923. Chases and recesses in stone walls shall not exceed Chases and in extent those permitted for solid masonry walls under the Recesses same conditions.

Veneered Walls

Sec. 2924. Materials used in the veneering of masonry and reinforced concrete walls shall conform in all respects to the requirements for such materials in Chapter 24 of this Code. Stone, cellular architectural terra cotta, slab terra cotta, tile, cast stone, ashlar or other approved masonry materials used for veneering shall be of the thicknesses set forth as follows: Quality of Material

Stone.....	not less than 3 in.
Cellular architectural terra cotta.....	not less than 3 in.
Slab terra cotta.....	not less than 1 1/4 in.
Flat tile.....	not more than 1 in.
Brick (clay, concrete or sand-lime).....	not less than 2 in.
Hollow tile.....	not less than 2 in.
Cast stone.....	not less than 2 in.
Other approved masonry.....	not less than 3 in.

In stone ashlar, each stone shall have a reasonably uniform thickness, but all stones need not necessarily be of the same thickness.

Sec. 2925. The maximum allowable compressive stresses on the backing of veneered walls, due to combined live and dead loads, shall not exceed those permitted for masonry of the type which forms such backing. In no case shall the veneering be considered a part of the wall in computing the strength of bearing walls, nor shall it be considered a part of the required thickness of the wall. Working Stresses

Sec. 2926. When walls are veneered with brick, hollow tile, cellular architectural terra cotta, slab terra cotta, stone and/or cast stone, the veneering shall be tied into the backing either by a header for every three hundred square inches (300 sq. ins.) of wall surface or by substantial, non-corrosive metal wall ties spaced not farther apart than one foot (1') vertically and two Attachment of Veneering

feet (2') horizontally. Headers shall project at least three and three-quarters inches ($3\frac{3}{4}"$) into the backing and anchors shall be of substantial pattern. Tile veneering not more than one inch (1") in thickness with individual units not exceeding thirty inches (30") in any one dimension and having not more than five hundred and forty square inches (540 sq. in.) of superficial area and having corrugations or scorings on the back side thereof, need not be anchored in accordance with the above requirements but shall be cemented solidly to the backing with cement mortar so as to provide a continuous integral support to the backing.

Height of Veneered Walls

Sec. 2927. Veneer on masonry or reinforced concrete walls other than panel walls shall not exceed forty feet (40') in height above foundations or other definite and secure supports. Where slab terra cotta is anchored by means of substantial, non-corrosive metal ties, spaced as required in Section 2926, and grouted or cemented solidly with cement mortar to provide a continuous integral support to the masonry backing and where flat tile is anchored in accordance with the provisions of Section 2926 for tile veneer, this height limit does not apply.

Faced Walls

Quality of Material

Sec. 2928. Material used in the backing and facing of faced walls shall conform in all respects to the requirements prescribed for such materials in Part VI.

Materials used for facing shall be not less than three and three-fourths inches ($3\frac{3}{4}"$) thick, and in no case less in thickness than one-eighth the height of the unit, excepting that spandrel and other recessed panels, when approved, may be higher than eight times their thickness, provided they are of the minimum thickness required in this paragraph.

Working Stresses

Sec. 2929. The maximum allowable compressive stresses on faced walls due to combined live, dead and other loads shall not exceed those permitted for masonry of the type which forms the backing. Where bonded to the backing as provided in Section 2931, the full cross section of the facing may be considered in computing bearing strength.

Thickness

Sec. 2930. Faced walls shall be not less in thickness than is required for masonry walls of the type which forms the backing. Where bonded to the backing as provided in Section 2931 the facing may be considered a part of the wall thickness.

Bond

Sec. 2931. Solid unit masonry facing, or cellular architectural terra cotta facing, with all voids filled solidly with masonry or concrete grout shall be bonded to walls of solid masonry or of hollow clay tile, or of concrete block or tile with at least one header course in every six courses, or there shall be at least one full length header in every seventy-two square inches (72 sq. ins.) of wall surface.

Stone ashlar facing, or cellular architectural terra cotta facing with all voids filled solidly with masonry or concrete grout shall have at least 15 per cent of the superficial area not less

Sections 2931-2935

than three and three-fourths inches ($3\frac{3}{4}$ ") thicker than the remainder of the facing to form bond units, which shall be uniformly distributed throughout the wall.

Special Wall Requirements

Sec. 2932. No eight inch (8") wall shall be broken into subsequent to building for the insertion of structural members. A separation of not less than four inches (4") of solid masonry shall be provided in all walls between combustible members which may enter such walls from opposite sides.

**Solid
Masonry
Walls**

Sec. 2933. When combustible or unprotected steel building members frame into the hollow part of hollow masonry walls of thicknesses not greater than twelve inches (12") they shall not project more than four inches (4") into the walls and shall be so spaced that the distance between embedded ends is not less than four inches (4"). The space above, below and between such members shall be filled solidly with burnt clay materials, mortar, concrete or equivalent fire-resistive materials, to a depth of not less than four inches (4") on all sides of the members.

**Hollow
Masonry
Walls**

All open cells in tile or blocks occurring at wall ends shall be filled solid with concrete or cement mortar for at least a depth of six inches (6"), or closure tile set in the opposite direction shall be used.

Sec. 2934. Party walls which carry any loads other than their own weight shall conform to the requirements for load-bearing walls.

**Party
Walls**

When a party wall is unpierced and extends above the roof, and is of four-hour fire-resistive construction as specified in Section 4302, the portions of the building on each side thereof may be considered as separate buildings.

Sec. 2935. On all buildings, except on Group H and I occupancies three stories or less in height, all exterior or party walls shall project above the roof as parapets; provided, that where such wall fronts on a street or where the roof construction is entirely of incombustible materials, such parapet wall may be omitted; and provided, further, that for buildings twenty feet (20') or less in height or where the adjoining roof slopes more than 20 degrees from the horizontal, such parapet walls may be omitted. All required parapet walls shall be not less than thirty inches (30") above the roof immediately adjacent thereto and when exceeding six times their thickness in height shall be laterally supported.

**Parapet
Walls**

All parapet walls shall have a coping of incombustible material. On Group H and I occupancies not more than three stories high, exterior and party walls shall extend above combustible roofs to a height not less than twenty-four inches (24") above the roof where the pitch of the roof does not exceed three inches (3") in twelve inches (12"). Where the pitch of the roof exceeds three inches (3") in twelve inches (12") such walls may terminate at the upper side of the roof boards.

Sections 2936-2938

TABLE No. V.—MINIMUM THICKNESS AND MAXIMUM HEIGHT—NON-BEARING PARTITIONS

Thickness Exclusive of Plaster (Inches)	Maximum Unsupported Height (Feet)
2	8*
3	12
4	15
6	20
8	25

*Height or length.

Partitions**Bearing
Partitions**

Sec. 2936. All interior bearing walls, which do not extend through more than one story shall be considered as bearing partitions.

Solid masonry bearing partitions shall be not less than eight inches (8") thick and those of hollow clay tile, concrete block or tile or hollow walls of brick shall be not less in thickness than one-eighteenth of the height between floors or floor beams but never less than eight inches (8").

**Non-bearing
Partitions**

Sec. 2937. Brick non-bearing partitions shall be not less than three and three fourths inches ($3\frac{3}{4}$ ") thick for a height not exceeding twelve feet (12') between floors or floor beams or roofs. Non-bearing partitions of hollow clay tile, concrete block or tile, plain concrete, hollow walls of brick or of gypsum block or other similar materials shall be built solidly against the floor and ceiling construction below and above and shall not exceed the unsupported heights shown in Table No. V of this Chapter.

Solid or hollow non-bearing partitions of reinforced plaster shall have a thickness of not less than one-sixtieth of the unsupported height, but never less than one and one-half inches ($1\frac{1}{2}$ ") for solid partitions nor have a shell thickness of less than three-fourths inch ($\frac{3}{4}$ ") for hollow partitions. Such partitions shall have vertical steel or iron channels with a depth of not less than one-half the thickness of the partition, made of not less than No. 24 U. S. Gauge metal and spaced not more than twenty-four inches (24") on center.

Solid or hollow non-bearing partitions of reinforced gunite shall have a thickness of not less than one-seventieth of the unsupported height but never less than one and one-half inches ($1\frac{1}{2}$ ") for solid partitions nor have a shell thickness of less than three-fourths inch ($\frac{3}{4}$ ") for hollow partitions. Vertical channels shall be installed in gunite partitions as specified for plaster partitions above.

Foundation Walls**Foundation
Walls**

Sec. 2938. Solid masonry foundation walls and those of concrete block or coursed stone shall be not less in thickness than

Sections 2938-2939

the wall immediately above and in no case less than twelve inches (12") thick unless otherwise specified in this Chapter, except that when the space enclosed within the foundation is not excavated they may be eight inches (8") if included within the allowable height of eight inch (8") walls and if the walls supported by such foundation are not more than eight inches (8") in thickness. When built of concrete cast in place, foundation walls shall be at least as thick as the walls supported, but in no case less than eight inches (8"). When built of rubble stone, they shall be at least sixteen inches (16") thick. Rough or random rubble without bonding or level beds shall not be used as foundations for walls exceeding thirty-five feet (35') in height nor shall coursed bonded rubble walls be used as foundations for walls exceeding seventy-five feet (75') in height.

Foundations for walls of hollow clay tile, concrete block or tile and hollow walls of brick, shall be of the same thickness, respectively, as required in the paragraph above, and shall be built of brick, stone, concrete (plain or reinforced), hollow clay tile, concrete block or tile, or as a hollow wall of brick. Tile foundation walls shall be not less than twelve inches (12") thick.

When the stresses due to earth pressure and superimposed building load exceed the maximum working stress permitted in this Code for the materials used, and the additional stresses are not otherwise provided for, the wall thickness shall be increased to bring the stresses within the required limits.

All foundation walls shall extend below the level of frost action, and shall not be constructed of gypsum.

Materials for foundation walls shall be equal in quality in all respects to those required for exterior bearing walls, except that mortar used for exterior foundation walls below grade shall be cement mortar.

Foundations built of masonry units, whether hollow or solid, shall be sealed below any woodwork with a cement wash or equally effective seal.

Panel and Enclosure Walls

Sec. 2939. Panel and enclosure walls in skeleton framed buildings shall be not less than eight inches (8") thick if of solid brick, hollow clay tile, concrete block or tile, plain concrete or hollow walls of brick, nor less than one-twentieth the distance between supporting or enclosing members. Panel and enclosure walls of reinforced concrete shall be not less than five inches (5") thick nor less than one-thirtieth the distance between the supporting or enclosing members, and sufficiently reinforced to resist the wind pressure specified in Section 2307 from either direction. Panel and enclosure walls of reinforced gunite shall be not less than four inches (4") thick and shall be reinforced as required for reinforced concrete walls.

Enclosure walls shall be securely fastened to the adjoining framing members. .

When panel or enclosure walls are built monolithic with columns or bearing walls they may be reinforced to carry their own weight.

Panel and Enclosure Walls

Miscellaneous Requirements

Anchoring of Walls

Sec. 2940. All walls shall be securely anchored and bonded at points where they intersect and where they abut or adjoin the frame of a skeleton framed building.

When walls are not built at the same time the perpendicular joint shall be regularly toothed with not less than four inch (4") offsets and the joint shall be provided with anchors not less than two inches by three-eighths inch ($2" \times \frac{3}{8}"$) metal with ends bent up not less than two inches (2") or with cross pins to form anchorage. Such anchors shall be not less than three feet (3') long extending eighteen inches (18") in from each side of the joint and spaced not more than three feet (3') apart in the direction of the height of the wall.

Reinforcing in concrete walls shall be extended not less than twenty-four inches (24") around all corners and wall intersections.

Use of Existing Walls

Sec. 2941. An existing masonry wall may be used in the renewal or extension of the building providing it meets the requirements of this Code, and is structurally sound or can be made so by reasonable repairs. Existing walls which are structurally sound but which are of insufficient thickness when increased in height shall be strengthened by an addition of the same material not less than eight inches (8") in thickness laid up in portland cement mortar, or the wall may be built out with gunite to the thickness required for a new wall of that height. Foundations and lateral supports shall be provided as required for newly constructed walls under similar conditions. All additions or linings shall be thoroughly bonded into existing masonry by toothings to assure combined action of wall and lining. Such toothings shall be distributed uniformly throughout the wall and shall aggregate in vertical cross-sectional area not less than 15 per cent of the total vertical area of the wall or lining.

CHAPTER 30—ENCLOSURE OF VERTICAL OPENINGS

Sec. 3001. Vertical openings are required to be enclosed in certain buildings depending upon the occupancy of the building, height of building or the Type of Construction. The vertical openings required to be enclosed are specified under Occupancy in Part III, and for stairways and ramps are specifically included in Chapter 33.

**Enclosures:
When
Required**

Sec. 3002. When stairways and/or ramps are required to be enclosed such enclosures shall extend from the lowest point to the highest point required and shall also include a complete passageway not less in width at any point than the required width of such stairway or ramp and such enclosure. All doors opening into such enclosures shall be of metal or shall be metal-clad doors as set forth in Section 4304, and all windows shall be of wire glass and metal frames and sash; except that when such openings face directly on a street or court and are not within ten feet (10') of an adjacent lot line such protection may be omitted. All such doors shall be self-closing and be kept normally closed.

**Stairway,
Ramp and
Elevator
Enclosures**

Walls and partitions enclosing stairways, ramps or elevators shall be of not less than two-hour fire-resistive construction as specified in Section 4302; except as specifically provided in Sections 1907, 2007, 2107 and 2207, where one-hour fire-resistive construction is permitted. Enclosing walls of elevator shafts may consist of wire glass set in metal frames on the entrance side only. Elevator shafts extending through more than two stories shall be equipped with an approved means of adequate ventilation to and through the main roof of the building.

Sec. 3003. All shafts, ducts, chutes and other vertical openings not covered in Section 3002 shall have enclosing walls conforming to the requirements specified under Type of Construction of the building in which they are located when they exceed nine square feet (9 sq. ft.) in area, and all other shafts shall be lined with sheet metal having lock jointed or riveted seams and joints. Combustible material of partitions and floors through which the ducts pass shall be kept at least three inches (3") from the metal lining or be protected by not less than three-eighths inch ($\frac{3}{8}$ ") of plaster or one-fourth inch ($\frac{1}{4}$ ") of asbestos or plasterboard. Openings between any ducts and the floor construction through which they pass shall be filled with mortar or other incombustible material supported by wire baskets that prevent the passage of fire. All doors opening into such vertical shafts shall be of metal or shall be covered on the shaft side by not less than one-fourth inch ($\frac{1}{4}$ ") of asbestos and not less than 26 U. S. gauge metal returned around all edges and well fastened to the door. Windows in such shafts shall be wire glass and metal frames and sash or such frame and sash may be of wood entirely clad with metal of not less than 26 U. S. gauge.

**Other
Vertical
Openings**

Sections 3101-3103

CHAPTER 31—FLOOR CONSTRUCTION

General

Sec. 3101. Floor construction shall be of materials and construction as specified under Occupancy in Part III and under Types of Construction in Part V.

All floors shall be so framed and tied into the framework and supporting walls as to form an integral part of the whole building. Fire-resistive standards of floor construction are specified in Section 4303.

The type of floor construction used shall provide means to keep the beams and girders from spreading by installing ties or bridging.

Concrete Floors

Sec. 3102. Concrete slab floors shall be not less than two and one-half inches ($2\frac{1}{2}$ ") thick. Topping when poured monolithic with the slab may be included as a structural part of the slab. Sleepers for the nailing of a wood floor shall not decrease the required structural depth of the slab unless placed in the direction of span and then shall not be placed more than one-half inch ($\frac{1}{2}$ ") into the slab. Concrete joists shall be solidly bridged for lateral support as follows: One row of concrete bridging shall be placed in clear spans of fifteen feet (15') to twenty-four feet (24'); two rows of bridging shall be placed in all clear spans of twenty-four feet (24') or more. Bridging shall be reinforced continuously top and bottom with not less than one-half inch ($\frac{1}{2}$ ") round rod or the equivalent area in other shapes. Such bridging shall be the full depth and width of the joists.

Steel Joisted Floors

Sec. 3103. Steel joisted floors shall consist of steel joists as specified in Section 2715. When used in Type I or Type II buildings they shall have a reinforced concrete or gypsum slab not less than two and one-half inches ($2\frac{1}{2}$ ") thick placed on and secured to the top thereof, and a fire-resistive ceiling as specified in Section 4303 on the under side thereof, fully covering and protecting the joists; provided that when such joists are used in places where unprotected wood joists are permitted the steel joists need not be protected with fire-resistive materials as specified above. Fire-resistive ceilings as specified in Section 4303 shall, except in the case of one-hour fire-resistive construction, be designed and constructed to support a load of not less than 10 pounds per square foot in addition to its own weight.

The reinforced concrete or gypsum slab placed on and secured to the top of the steel joists shall be sufficiently reinforced to support all dead, live and/or other loads between joists. Joists shall be securely cross bridged at intervals not to exceed eight feet (8') along the joist length. The lateral unsupported length of the top chord of any steel joist shall not exceed 40 times the width of the compression flange.

Bridging shall be provided during the period of construction to adequately support the top chord or flange against lateral movement and such bridging shall be designed to hold each joist in a vertical plane. Sufficient permanent bridging shall be

Sections 3103-3104

installed to laterally stay the joists and to transmit any horizontal forces in either direction perpendicular to the direction of the joists. Such bridging shall consist of solid concrete sections, structural steel shapes or plates, portal bridging, diagonal rods, or other bridging which will provide equal stiffness. Any row of bridging shall be capable of transferring 500 pounds from each joist to the adjoining joists.

Sec. 3104. Mill constructed floors shall be not less than three inches (3") nominal splined or tongued and grooved plank covered with one inch (1") nominal flooring laid crosswise or **Mill Constructed Floors**

TABLE No. I ALLOWABLE SPANS FOR FLOOR JOISTS

Size of Joists (Inches)	Spacing of Joists, Center to Center (Inches)	Maximum Allowable Span (Feet and Inches)	
		Plastered Ceiling Below	Without Plastered Ceiling Below
2 x 6	12	10- 0	12- 0
	16	9- 1	10- 0
	24	8- 0	8- 7
2 x 8	12	13- 0	15-11
	16	12- 1	13-11
	24	10- 8	11- 5
2 x 10	12	16- 8	19-11
	16	15- 3	17- 4
	24	13- 5	14- 5
2 x 12	12	20- 1	23-11
	16	18- 5	20-11
	24	16- 2	17- 5
2 x 14	12	23- 5	27- 8
	16	21- 5	24- 4
	24	18-11	20- 3
3 x 6	12	11- 8	15- 0
	16	10- 8	13- 1
	24	9- 4	10-10
3 x 8	12	15- 4	19- 8
	16	14- 0	17- 4
	24	12- 4	14- 4
3 x 10	12	19- 3	24- 7
	16	17- 8	21- 8
	24	15- 7	18- 0
3 x 12	12	23- 1	29- 4
	16	21- 3	25-11
	24	18- 9	21- 8
3 x 14	12	26-11	30- 0
	16	24-10	30- 0
	24	22- 1	25- 2

Sections 3104-3105

diagonal. Top flooring shall not extend closer than one-half inch ($\frac{1}{2}$ ") to walls to allow for swelling in case the floor becomes wet. Such one-half inch space shall be covered by a molding fastened to the wall and so arranged that it will not obstruct the swelling or shrinking movements of the floor. Corbeling of masonry walls under floor planks may be used in place of such molding.

If laminated floors are used, at least two laminations at the wall shall be omitted until after glazing and roofing has been completed.

See Section 2523 for detailed requirements.

Wood Joisted Floors

Sec. 3105. Wood joisted floors shall be framed and constructed and anchored to supporting wood stud or masonry walls as specified in Chapter 25. Wood joisted floors need not be fire-protected on the under side except where specifically required under Occupancy in Part III, Location in Part IV, or Type of Construction in Part V.

Girders supporting first floor joists in residence buildings shall be not less than four inches by four inches (4" x 4") for spans of five feet (5') or less, or not less than four inches by six inches (4" x 6") (placed on edge) for spans not more than seven feet (7').

Table No. I of this Chapter gives the maximum allowable spans for floor joists for Douglas fir (Oregon pine) using a Number One Dimension grade, surfaced four sides to American Lumber Standard sizes and based on live load of 40 pounds per square foot uniformly distributed.

Joists of other grades, other woods and other sizes may be used, in which case they shall not be stressed to exceed the maximum allowable fiber stress as specified in Chapter 25.

Floor joists shall have a clearance of not less than eighteen inches (18") between the bottom of the joists and the surface of the ground underneath. (See Appendix, Section 2529).

Joists under bearing partitions shall be installed as specified in Chapter 25. All joists, beams and girders shall be framed away at least two inches (2") from all flues and chimneys and at least four inches (4") from the back of any fireplace. All wood floor joists having a span of more than eight feet (8') shall have bridging as specified in Chapter 25.

Solid blocking not less than two inches (2") in thickness and the full depth of the joists shall be provided in the following places; over all girders except when not ceiled on the under side of joists, bearing walls, bearing partitions and around all stairways or other vertical openings. Such solid blocking shall serve as the required bridging specified in Chapter 25.

CHAPTER 32—ROOF CONSTRUCTION AND COVERING

Sec. 3201. Roof covering shall be as required under Occu- **General**
pancy in Part III, Location in Part IV or Types of Construction
in Part V. All roofs shall be so framed and tied into frame-
work and supporting walls as to form an integral part of the
whole building.

Sec. 3202. The general requirements for construction of **Construction**
floors as specified in Chapter 31 shall apply to roofs except that
in Type II buildings the roof sheathing shall be not less than
two and one-half inches (2½") nominal in thickness and except
that concrete or gypsum roof slabs shall be not less than two
inches (2") in thickness.

Roof trusses shall have all joints well fitted and shall have
all tension members well tightened before any load is placed
on the truss. Diagonal and sway bracing shall be used to brace
all roof trusses. The allowable working stresses of materials
in trusses shall be as specified in Chapters 25 and 27. The
minimum net section of the members after framing shall be
used in determining the strength of the truss at any point.

Sec. 3203. The design of the roof construction shall be in **Design**
accordance with engineering regulations for the materials used.

Table No. I gives the maximum allowable spans for ceiling
joists and roof rafters of Douglas fir (Oregon pine) using a

**TABLE No. I—MAXIMUM ALLOWABLE SPANS FOR
CEILING JOISTS AND ROOF RAFTERS.**

Size of Joists (Inches)	Spacing of Joists, Center to Center (Inches)	Maximum Allowable Span (Feet and Inches)	
		For Ceiling Joists	Rafters For Roof
2 x 4	12	11- 0	11- 8
	16	10- 0	10- 1
	24	8-11	8- 4
	32	7-10	7- 2
2 x 6	12	16- 7	17- 8
	16	15- 4	15- 6
	24	13- 8	12- 9
	32	12- 0	10- 8
2 x 8	12	21- 8	23- 2
	16	20- 2	20- 4
	24	18- 0	16-11
	32	15-10	14- 9
2 x 10	12	26-10	28-11
	16	25- 0	25- 6
	24	22- 6	21- 3
	32	19- 6	18- 8

Sections 3203-3206

Number One Dimension grade, surfaced four sides to American Lumber Standards sizes.

Joists or rafters of other grades, other woods and other sizes may be used, in which case they shall not be stressed to exceed the maximum allowable fiber stress as specified in Chapter 25.

The allowable span of roof rafters shall be measured from plate to ridge, except that where rafters are braced to ceiling joists and a complete truss is formed, the span shall be considered as the distance between intersecting points of trussing.

Roof framing and trussing shall be thoroughly and effectively angle braced. Roof joists when supported on a ribbon board shall be well nailed to the stud.

Roof Coverings

Sec. 3204. Roof covering shall be required over all combustible roof construction and shall be of one of the classes set forth in Section 4305 as required under Occupancy in Part III, Location in Part IV and Type of Construction in Part V. [See also Sec. 104 (e).]

Attics: Access and Areas

Sec. 3205. All buildings shall have access provided to the attic space by means of a stairway or permanent ladder or a scuttle. The openings provided through the ceiling for such access into the attic space shall be not less than two feet by three feet (2'x3') and shall be located in the hallway or corridor of all Type III and V buildings three stories or more in height.

Type III or V buildings, one or two stories in height shall have scuttle holes into the attic space which are not less than eighteen inches (18") square.

In wood frame roof construction where ceilings occur the attic spaces or spaces between ceilings and the under side of roofs shall be divided into horizontal areas of not more than twenty-five hundred square feet (2500 sq. ft.) with tight one-inch (1") partitions of matched wood or of approved incombustible materials. All openings through these partitions shall be protected by self-closing doors of the same thickness and materials as the partition.

In buildings with no ceilings and having rooms with floor areas of over thirty thousand square feet (30,000 sq. ft.), tight draft stops shall be installed to prevent a free current of air under the roof. These draft stops in trussed roofs shall extend from the roof down to the bottom chord of the truss and shall divide the under roof or attic into sections not to exceed twenty thousand square feet (20,000 sq. ft.) in area.

Roof Drainage

Sec. 3206. Roofs of all buildings shall be sloped so that they will drain to gutters and downspouts which shall be connected with conductors to carry the water down from the roof underneath the sidewalk to and through the curb. Overflows shall be installed at each low point of the roof to which the water drains.

CHAPTER 33—STAIRS, RAMPS AND SMOKEPROOF TOWERS

Sec. 3301. All exits as required for buildings in this Code shall comply with the requirements specified in this Chapter for a stairway, ramp or smokeproof tower. Wherever stairways are mentioned, ramps may be substituted when constructed as specified in Section 3310. A smokeproof tower constructed as specified in Section 3315 shall be considered as a required stairway as specified in Section 3309. Such smokeproof towers may be substituted for stairways wherever the latter are required in this Code.

General Requirements

All stairways shall be constructed of materials permitted for floors as specified under Types of Construction in Part V for that type of building in which such stairways are located, except as specified in Sections 3315 and 3316. All stairways of wood construction shall be protected on the under side by not less than one-hour fire-resistive construction as specified in Chapter 43. Metal stairways entirely enclosed as specified in this Chapter shall not be required to be fire-protected as required for floors in Part V of this Code. The provisions of this Chapter shall not apply to Group I occupancies except as specifically stated in Sections 3302, 3307 and 3314.

Sec. 3302. All stairways and all platforms, landings and balconies forming a part of such stairway shall be designed to sustain an assumed live load of not less than 100 pounds per square foot.

General Design

There shall be no variation in the width of treads in any flight and the variation in heights of risers in any flight shall not exceed three-sixteenths inch (3/16"). All treads shall have a nosing of not less than one inch (1").

The surface material of stair treads and landings shall be such as not to involve danger of slipping.

An arrangement of treads known as winders shall be permitted in Group I occupancies or for monumental stairways which are not serving as a required means of exit but in no case shall any tread have a width at any point less than eight inches (8") exclusive of nosing.

Stairways and intermediate landings shall continue with no decrease in width along the direction of exit travel, except that when three or more stairways are required, one-half the required number of stairways may be combined at the second floor level with such combined width extending to the first floor level.

Sec. 3303. One-half of the required number of stairways shall be continued their full width to and through the roof by means of a penthouse in all buildings three stories or more in height; provided, that not more than one stairway shall be required to continue to and through the roof when the roof has a slope of more than six inches (6") for each twelve inches (12") of horizontal projection. In two-story buildings scuttles not less than two feet by three feet (2' x 3') shall be provided to and through the roof. Stairways leading to roofs of buildings shall have signs conspicuously placed with letters not less than four

Arrangement and Access

inches (4") high indicating such access at the ground floor level.

All stairways shall lead to the street directly or by means of a yard, court or fire-resistive passageway having a width at least equal to the aggregate widths of all the exits discharging into it; provided, that not to exceed one-half of the required number of stairs may terminate at the second floor level provided they lead directly to a street or alley front of the building and are provided with a balcony on the exterior of the building not less than three feet (3') wide and five feet (5') long. Such balcony shall be constructed of incombustible materials and when the floor of such balcony is located more than twelve feet (12') above the sidewalk directly below, such balcony shall be equipped with an approved counterbalanced stairway or ladder.

Where stairways discharge through the fire-resistive passageways such passageways shall be not less than seven feet (7') in clear height and with a width at least equal to the stairway or stairways served by such passageways. All openings into such passageways shall be protected by one-hour fire-resistive doors as specified in Section 4304.

All exits shall be so arranged as to make clear the direction of egress to the exterior of the building and shall be so located that they are readily accessible and visible. When not visible to all occupants, adequate signs shall be provided to indicate their location. For buildings with sleeping rooms, schools and places of detention, exits shall be so arranged that it is possible to go in either direction at any point in a corridor to an exit.

Stairways shall abut on not more than one side of an elevator enclosure.

No portion of any building shall be more than one hundred fifty feet (150') (along the line of travel) from the nearest exit, and no corridor exit door shall be more than one hundred feet (100') (measured along the line of travel) from the nearest exit. In Group D and H occupancies all doors providing egress from public hallways and all doors providing egress from the building shall open in the direction of exit travel, except sliding doors as provided in Section 3304.

Doors

Sec. 3304. Doors shall not open immediately on a flight of stairs but on a landing at least equal to the width of the door.

Doors giving access to stairways shall swing with the direction of exit travel but where swinging doors are not practicable sliding doors approved by the Building Inspector may be permitted. Vertical sliding doors and rolling shutters shall not be used. There shall be no obstructions on stairways or landings nor to the full swing of doors. Swinging doors in their swing shall not reduce the effective width of stairways or landings to less than thirty inches (30") nor when open interfere with the full use of the stairs.

All doors in exit enclosures or providing access to exterior stairways shall be self-closing and be kept normally closed and shall be of not less than one-hour fire-resistive construction as specified in Section 4304, except that doors facing a street and at street level may be of unprotected wood. All doors shall be tight-fitting and constructed and installed in a workmanlike manner.

Sections 3304-3307

All doors used in connection with exits shall be so arranged as to be opened readily from the side from which egress is made or from both sides when the building is occupied. Locks if provided shall not require a key to operate from the inside.

Sec. 3305. All stairways shall have walls or well secured balustrades or guards on each side and handrails shall be placed on at least one side of every stairway and stairways exceeding forty-four inches (44") in width shall have handrails placed on each side. Stairways over seven feet (7') wide shall be provided with one or more continuous intermediate handrails substantially supported and the number and position of intermediate handrails shall be such that there is not more than sixty-six inches (66") between adjacent handrails.

Railings

Handrails and railings shall be placed thirty inches (30") above the nosing of treads and ends of handrails shall be returned to the wall.

Sec. 3306. Every stairway or other means of exit into corridors and passageways appurtenant thereto shall be provided with an adequate system of lighting, either natural or artificial. Lights in the exit signs shall be kept burning at all times that the building served by such stairways or exits is being used or occupied.

Lighting

Sec. 3307. Stairways and landings, returns and passageways serving such stairways shall be not less than forty-four inches (44") wide; except, that for dwellings and when serving mezzanines or not more than one family or one apartment in buildings not exceeding two stories in height the required width may be reduced to not less than three feet (3'). All such widths shall be clear of all obstructions; except that handrails attached to walls may project within the required width not more than three and one-half inches (3½") at each side when the stairway is forty-four inches (44") or more in width and on one side when the stairway width is less than forty-four inches (44"). If newels project above tops of rails a minimum clear width of not less than that specified in this paragraph shall be provided between the face of the newel and the face of the wall or newel opposite.

Detailed Requirements

The rise of stairway shall be not more than seven and one-half inches (7½") and the tread exclusive of the nosing not less than ten inches (10") (maximum pitch 37 degrees), and there shall be not more than 17 risers in any one run between landings; provided, that stairways in dwellings and stairways serving mezzanine floors may have a rise of not more than eight inches (8") and a tread exclusive of the nosing of not less than nine inches (9").

In Groups A, B, and C occupancies the walls at the outer corners of landings shall be curved on a radius of at least two feet (2'), or a 45 degree splay not less than twenty inches (20") wide shall be provided to eliminate right angle corners.

Every required stairway including stairways in Group I occupancies shall have a head room clearance of not less than six feet six inches (6' 6") measured vertically from the nearest nosing to the nearest soffit.

Stairway Enclosures

Sec. 3308. All required stairways and ramps in buildings three stories or more in height, including landings and parts of floors between stairways which lie in the path of travel shall be enclosed as specified under Occupancy in Part III, under Types of Construction in Part V, and in Chapter 30; except that monumental stairways leading only from the street floor level to the second floor or basement which do not constitute required means of exit in public buildings or stores shall be exempted from the enclosure requirements.

Exit enclosures shall not be used for storage in any manner whatsoever and shall not contain any material or equipment liable to cause fire, explosion or panic.

At the top of every stairway enclosure a ventilating skylight with a horizontal area of not less than eight square feet (8 sq. ft.) shall be installed as specified in Section 3402, or in lieu of such skylight an equivalent window opening glazed with plain glass may be provided in the penthouse walls. Fixed openings not less than five hundred square inches (500 sq. in.) in area shall be provided at the top of each stairway enclosure for ventilation.

Stairways Required

Sec. 3309. The number of stairways provided for each use or occupancy shall be as required in Table No. I of this Chapter for three-story buildings. For two-story buildings the allowable areas may be increased 50 per cent. For buildings four stories or more in height the allowable areas shall be decreased two per cent per floor for each floor above the third floor to and including the eighth floor and shall be decreased one per cent for each additional floor above the eighth floor; provided, that in no case shall there be less than two stairways serving each floor for each building three stories or more in height. Where the entire building is sprinklered in accordance with the provisions of Chapter 38 the allowable areas in Table No. I may be increased 33 1/3 per cent.

**TABLE No. I BASIC AREAS FOR COMPUTING REQUIRED
NUMBER OF STAIRWAYS**

No. of Stair- ways Re- quired	Maximum Areas for Types I and II Buildings (Sq. Ft.)				
	Group D Buildings	Group E Buildings	Group F Buildings	Group G Buildings	Group H Buildings
1	Up to 3,000	Up to 4,000	Up to 5,000	Up to 6,000	Up to 3,000
2	Up to 8,000	Up to 9,000	Up to 12,000	Up to 12,000	Up to 9,000
3	Up to 18,000	Up to 20,000	Up to 25,000	Up to 25,000	Up to 20,000
4	Up to 28,000	Up to 30,000	Up to 40,000	Up to 40,000	Up to 30,000
5	Up to 40,000	Up to 40,000	Up to 57,000	Up to 60,000	Up to 42,000
6	Up to 54,000	Up to 50,000	Up to 76,000	Up to 85,000	Up to 56,000
7	Up to 70,000	Up to 60,000	Up to 97,000	Up to 115,000	Up to 72,000
8	Up to 88,000	Up to 70,000			Up to 90,000
9	Up to 108,000	Up to 80,000			Up to 110,000
10		Up to 90,000			
Maximum Areas for Types III, IV and V Buildings (Sq. Ft.)					
1	Up to 3,000	Up to 4,000	Up to 5,000	Up to 6,000	Up to 3,000
2	Up to 8,000	Up to 9,000	Up to 12,000	Up to 12,000	Up to 9,000
3	Up to 15,000	Up to 17,000	Up to 21,000	Up to 24,000	Up to 17,000
4	Up to 24,000	Up to 27,000	Up to 32,000	Up to 38,000	Up to 26,000
5	Up to 34,000	Up to 38,000	Up to 45,000	Up to 56,000	Up to 37,000
6	Up to 48,000	Up to 52,000	Up to 60,000	Up to 79,000	Up to 50,000
7	Up to 63,000	Up to 68,000	Up to 77,000	Up to 108,000	Up to 65,000
8	Up to 80,000	Up to 86,000	Up to 96,000		Up to 82,000

The number of required stairways for Group A, B and C occupancies is specified in Chapters 6, 7 and 8, respectively.

Where a cellar or basement in a Group D, E, F, G and H occupancy is used for other than storage or furnace room purposes, exits, stairs or ramps shall be provided as for the same occupancies on the second floor.

Exceptions: 1. Group D occupancies shall be provided with not less than one smokeproof tower constructed as specified in Section 3315 when such building exceeds two stories in height.

2. Group E—In automobile storage garages, where a system of ramps continuous from the ground floor to the top floor is used to transport automobiles from floor to floor, the number of stairways required shall be not less than one-half that shown in Table No. I.

3. Where one horizontal exit is provided, the allowable areas tabulated may be increased 15 per cent and where more than one such exit is provided, such areas may be increased not to exceed 25 per cent.

Sec. 3310. Wherever stairways are required by this Code, **Ramps** ramps with a slope not greater than one foot (1') in eight feet (8') may be substituted.

Ramps shall comply with all the requirements for stairways as to construction, width, enclosures, landing, lighting and ventilation.

Ramps shall be surfaced with an approved non-slip material. Handrails shall not be required where the slope of the ramp is less than one foot (1') in ten feet (10').

Sec. 3311. A horizontal exit shall consist of one or more **Horizontal** protected openings through or around an exterior wall or occupancy separation or of one or more bridges connecting two **Exits** buildings or parts of buildings entirely separated by occupancy separations.

Openings used in connection with horizontal exits shall be protected by one-hour fire-resistive doors as specified in Section 4304. If swinging doors are used there shall be adjacent openings with doors swinging in opposite directions, with signs on each side of the wall indicating the exit door which swings with the travel from that side.

Such doors shall be kept continuously unlocked whenever the building is occupied and be normally closed or be self-closing and equipped with fusible links.

Sec. 3312. Signs having white letters not less than five inches (5") high on a green field indicating location of exits shall be provided not only at the exit but at other points in the building wherever necessary to clearly indicate the direction of egress. **Signs and Lighting** Lights shall be kept burning during all times that the building is used or occupied.

Sec. 3313. Safe and continuous passageways, aisles, or corridors leading to exits and so arranged as to provide convenient **Passage-ways and Corridors** access to exits for every occupant shall be maintained at all

Sections 3313-3315

times on all floors and in all buildings. The minimum clear width of any passageway, aisle or corridor shall be three feet (3') at the narrowest point and doors swinging into such passageway shall not restrict the effective width at any point during their swing to less than the minimum width herein required.

Exceptions

Sec. 3314. Stairways in Group I occupancies, stairways serving only one apartment not above the second floor level, or stairways leading to mezzanine floors not exceeding one thousand square feet (1,000 sq. ft.) in area are exempted from the width, rise, tread and enclosure provisions in this Chapter but in no case shall such stairways have a rise of more than eight inches (8") and a tread exclusive of the nosing of less than nine inches (9").

Smokeproof Towers

Sec. 3315. (a) Where Required. A smokeproof tower consisting of a stairway with exterior access, entirely enclosed by masonry walls of not less than four-hour fire-resistive construction and floors and ceilings of not less than two-hour fire-resistive construction as specified in Chapter 43 and constructed as specified in this Section shall be required in every building of Group D, E, F, G and H occupancies five stories or more in height. Smokeproof towers shall be installed in Group A, B and C occupancies as specified in Chapters 6, 7 and 8, respectively.

(b) Construction. The stairways, landings, platforms and balconies of smokeproof towers shall be constructed as required for stairways, except that they shall be of incombustible materials throughout, except for handrails which may be of wood. The enclosure shall extend from the street level to a penthouse on the roof of the building and shall be roofed over with incombustible materials. Light and ventilation shall be provided at the top of every such enclosure as required for stairways.

Balustrades on the vestibules and balconies shall be not less than three feet six inches (3' 6") in height. Exit lights shall be provided as required in Section 3312.

(c) Access and Egress. Access to the smokeproof tower shall be provided from each story by means of vestibules open to the outside on an exterior wall or by means of balconies overhanging an exterior wall but not subject to severe fire exposure. Every such vestibule, balcony or landing shall have an unobstructed length not less than the combined required width of exit doors opening upon such balcony or landing and shall be directly open to a street, alley or yard or to an enclosed court open at the top and not less than fifteen feet (15') in width and six hundred square feet (600 sq. ft.) in area.

Access from the building to vestibules or balconies and to the enclosure shall be through doorways not less than thirty inches (30") wide nor less than seventy-five inches (75") in clear height. These openings shall be provided with self-closing fire doors of not less than one-hour fire-resistive construction as specified in Section 4302, swinging in the direction of exit travel; provided that clear wire glass not exceeding seven hundred and twenty square inches (720 sq. in.) in area shall be provided in all such doors giving access to the enclosure from the balcony or vestibule. Where locks or latches are provided they shall be of

Sections 3315-3316

an approved pressure-release type and shall be so designed as to provide access from the building at every floor and roof level.

Stairways of smokeproof towers shall provide continuous uniform egress from the roof and all stories to street grade. Egress shall be provided at the ground floor level either directly or through a passageway not less than forty-four inches (44") in clear width and eight feet (8') in clear height to a street, yard or alley not less than ten feet (10') in width. The walls of such passageway shall be of not less than four-hour fire-resistive construction and the ceiling and floor of not less than two-hour fire-resistive construction as specified in Chapter 43. The walls of any such passageway shall be unpierced throughout their entire length.

(d) **Location.** Every smokeproof tower required by this Code shall be located so as to furnish the best means of egress for the occupants of the building and access shall be provided thereto by means of a public room, public hall or passageway not less than thirty-six inches (36") in clear width and in no case shall access thereto be through another apartment, guest room, office or private room of any nature.

Sec. 3316. Outside stairways of the return platform or straight-run type may be used as a required means of exit for buildings not exceeding five stories or fifty-five feet (55') in height but in no case shall such stairways constitute more than 50 per cent of the required exit capacity. All outside stairways shall be located so as to lead directly to a street or alley or to a yard directly connected with a street or alley. **Outside Stairways**

The stairways, landings, platforms and balconies shall be constructed as specified for stairways in this Chapter, except that they shall be of incombustible materials throughout; provided that stairways serving only the second floor may be constructed of combustible material. Structural metal shall be not less than one-quarter inch ($\frac{1}{4}$ ") thick and shall be so framed as to permit ready access for inspection and painting. All windows and other openings adjacent to such stairways shall be provided with fixed metal covered sash and frames and wire glass or be provided with shutters or doors of one-hour fire-resistive construction as specified in Chapter 43.

No part of any such outside stairway shall be within ten feet (10') of a lot line which does not form the boundary of a street or alley.

CHAPTER 34—DOORS, WINDOWS AND SKYLIGHTS

Doors and Windows

Sec. 3401. Fire doors where required shall be as specified in Section 4304. All such doors shall be self-closing and if not kept normally closed shall be arranged to close automatically with the fusing of an approved fusible link.

Windows required to have metal frames shall be constructed either of steel or wrought iron rolled shapes or of hollow galvanized sheet iron, as specified in Section 4304.

When wire glass is required, it shall mean glass the thickness of which at the thinnest point shall be not less than one-fourth inch ($\frac{1}{4}$ ") and in which a wire netting is embedded. Wire glass shall be set with putty and metal stops.

Skylights

Sec. 3402. All skylights constructed with metal frames shall be substantially built with interlocking seams. Frames of skylights shall be designed to carry loads required for roofs as specified in Section 2305. All skylights, the glass of which is set at an angle of less than 45 degrees from the horizontal, if located above the first story, shall be set at least one foot (1') above the roof. The curbs on which the skylight rests shall be constructed as required for inner court walls or for masonry.

When wire glass is required for skylights the size shall not exceed seven hundred and twenty square inches (720 sq. in.) in area or forty-eight inches (48") in any dimension in any one panel. All glass in skylights shall be wire glass, except that skylights over vertical shafts extending through two or more stories shall be glazed with plain glass as specified in this Section; provided, that wire glass may be used if ventilation equal to not less than one-eighth the cross sectional area of the shaft but never less than four feet (4') is provided at the top of such shaft.

Any glass not wire glass shall be protected above and below with a screen constructed of wire not smaller than No. 12 B. and S. gauge with a mesh not larger than one inch (1"). The screen shall be substantially supported below the glass.

Skylights installed for the use of photographers may be constructed of metal frames and plate glass without wire netting.

Ordinary glass may be used in the roofs and skylights for greenhouses, provided the height of the greenhouse at the ridge does not exceed twenty feet (20') above the grade. The use of wood in the frames of skylights will be permitted in greenhouses outside of Fire Zones No. 1 and 2, if the height of the skylight does not exceed twenty feet (20') above the grade, but in other cases metal frames and metal sash bars shall be used.

Glass used for the transmission of light, if placed in floors or sidewalks, shall be supported by metal or reinforced concrete frames, and such glass shall be not less than one-half inch ($\frac{1}{2}$ ") in thickness. Any such glass over sixteen square inches (16 sq. in.) in area, shall have wire mesh embedded in the same or shall be provided with a wire screen underneath as specified for skylights in this Section. All portions of the floor lights or sidewalk lights shall be of the same strength as is required by this Code for floor or sidewalk construction, except in cases where the floor is surrounded by a railing not less than three feet six inches (3' 6") in height, in which case the construction shall be calculated for not less than roof loads.

Section 3501**CHAPTER 35—BAYS AND BALCONIES**

Sec. 3501. Construction of walls and floors in bay and oriel windows shall conform to the construction allowed for exterior walls and floors of the type of construction of the building to which they are attached. The roof covering of a bay or oriel window shall conform to the requirements for roofing of the main roof of the building. **Construction**

All exterior balconies attached to or supported by masonry walls shall have brackets or beams constructed of wire, steel, concrete or other incombustible material. All railings for balconies or porches shall be not less than three feet (3') in height above the floor of such balcony or porch. (See Section 2304)

CHAPTER 36—PENTHOUSES AND ROOF STRUCTURES

Penthouses and Roof Structures

Sec. 3601. No penthouse or other projection above the roof shall exceed twenty-eight feet (28') in height above the roof when used as an enclosure for tanks or for elevators which run to the roof and in all other cases shall not extend more than twelve feet (12') in height above the roof. The aggregate area of all penthouses and other roof structures shall not exceed 20 per cent of the area of the roof. No penthouse, bulkhead or any other similar projection above the roof shall be used for manufacturing, business, habitation, offices or storage, except that they may be permitted to be used for the making of blue prints, photographic prints, for scientific observation, for summer houses or for Group I occupancies.

Roof structures of Type I buildings shall be constructed with walls, floors and roof as required for the main portion of the building.

Walls of roof structures parallel to and within four feet (4') of the exterior walls of Type II or III buildings shall be constructed the same as the exterior wall of the story immediately below. Such wall shall project two feet (2') above the roof and two feet (2') beyond the sides of such roof structure, except that the side projection shall not be required when the adjoining side walls are of masonry. Walls other than those occurring within four feet (4') of an exterior wall on Type II or III buildings shall be of not less than one-hour fire-resistive construction. The restrictions of this paragraph shall not prohibit the placing of wood flagpoles or similar structures on the roof of any building.

Towers and Spires

Sec. 3602. Towers or spires when enclosed shall have exterior walls as required for the building to which they are attached. Towers not enclosed and which extend more than seventy-five feet (75') above grade shall have their framework constructed of iron, steel or reinforced concrete. No tower or spire shall occupy more than one-fourth of the street frontage of any building to which it is attached and in no case shall the base area exceed sixteen hundred square feet (1,600 sq. ft.) unless it conforms entirely to the type of construction requirements of the building to which it is attached and is limited in height as a main part of the building. If the area of the tower or spire exceeds one hundred square feet (100 sq. ft.) at any horizontal cross section its supporting frame shall extend directly to the ground. The roof covering of spires shall be as required for the main roof of the rest of the structure.

Skeleton towers used as wireless masts and placed on the roof of any building shall be constructed entirely of incombustible materials when more than twenty-five feet (25') in height and shall be directly supported on an incombustible framework to the ground. They shall be designed to withstand a wind load from any direction as specified in Section 2307 in addition to any other loads.

CHAPTER 37—CHIMNEYS AND HEATING APPARATUS

Sec. 3701. Chimneys shall be constructed in conformance with "A Standard Ordinance for Chimney Construction" recommended by the National Board of Fire Underwriters, Third Edition, revised 1927, except as specified in this Chapter. Chimneys

The walls of all chimneys whether used for appliances using coal, coke, wood, gas or oil shall be built of brick, concrete, stone, hollow tile of clay or concrete or of concrete blocks; provided that a metal smokestack or a patent chimney as specified in Sections 3702 and 3704, respectively, may be used.

Flue linings shall be made of fire clay or of other suitable refractory clays adapted to withstand reasonably high temperatures and flue gases and shall have a softening point not lower than 1994 degrees Fahrenheit. Flue linings shall be not less than five-eighths inch ($\frac{5}{8}$ ") in thickness and shall be built in as the outer walls of the chimney are constructed. All joints and spaces between the masonry and lining shall be thoroughly slushed and grouted full as each course of masonry is laid. Cracked, broken or otherwise defective linings shall not be used. Flue linings shall start from a point not less than eight inches (8") below the center line of smoke pipe intakes or in the case of fireplaces from the apex of the smoke chamber and shall be continuous to a point not less than four inches (4") above the enclosing walls. Flue lining may be omitted in brick chimneys for Group I occupancies provided the walls of the chimneys are not less than eight inches (8") thick and that the inner course shall be of fire brick with a fire resistance equal to that required for flue linings.

The walls of brick chimneys shall be not less than three and three-fourths inches ($3\frac{3}{4}$ ") thick and shall be lined except as provided above. All brick work shall be laid with full mortar joints, and shall be struck smooth where exposed to the weather. No mortar lining shall be permitted.

Concrete chimneys cast in place shall be suitably reinforced vertically and horizontally. The walls shall be not less than three and three-fourths inches ($3\frac{3}{4}$ ") thick and shall have a flue lining as specified in this Section; provided, that flue linings may be omitted in reinforced concrete chimneys for Group I occupancies when the walls of such chimneys are not less than six inches (6") thick.

Hollow blocks or hollow tile of clay or concrete shall not be used for the walls of an independent chimney but may be used for chimneys built in connection with exterior or party walls of hollow units for buildings not exceeding three stories in height. The outer eight inches (8") of such a wall may serve as the outside wall of the chimney.

Chimneys shall extend at least three feet (3') above flat roofs and not less than two feet (2') above the ridge of gable and hip roofs or the high point of mansards irrespective of the distance of the chimney from such obstruction to draft.

Chimneys shall be built upon solid masonry or reinforced concrete foundations properly proportioned to carry the weight imposed without settlement or cracking. The chimney shall

¹See "Specification Documents".

Sections 3701-3702

carry no load except its own weight and such load shall be transmitted to the foundation in such manner as to prevent the shearing or falling off of any part of the chimney. The footing for an exterior chimney shall start below the frost line.

Flues shall be built as nearly vertical as possible and in no case at an angle greater than 30 degrees from the vertical.

When any single flue has an effective area exceeding two hundred square inches (200 sq. in.) the wall shall be not less than eight inches (8") thick and shall have flue lining as specified in this Section, except that when flues become too large for fire clay flue lining, such flues shall be lined with fire brick for a distance of at least twenty-five feet (25') from the point of intake.

There shall be but one connection to a flue irrespective of whether the fuel used be coal, coke, wood, or oil. Ordinary and low pressure heating devices burning solid fuels shall have a minimum effective flue area of not less than the following, and such area shall be provided by a flue having its short dimension not less than two-thirds the long dimension.

Small special stoves and heaters.....	28 sq. in.
Stoves, ranges and room heaters.....	40 sq. in.
Fireplaces (at least 1/12 the fireplace opening).....	50 sq. in.
Warm air furnaces, steam and hot water boilers.....	70 sq. in.

All flues to which large ranges, heating furnaces, boilers, automatic gas water heaters or fireplaces are to be connected shall be subjected to a smoke test before acceptance but the test shall not be made until the mortar has thoroughly seasoned. Such test shall be made by the mason contractor in the presence of the Building Inspector.

Smoke-stacks

Sec. 3702. Steel or iron smokestacks may be used in place of brick chimneys specified in Section 3701, in which case the thickness of the metal shall be not less than one-fourth inch ($\frac{1}{4}$ "). Such stacks when used for manufacturing, for high pressure boilers, furnaces or other similar heating or manufacturing appliances shall be lined with fire brick for a distance of not less than twenty-five feet (25') from the place where the smoke pipe enters and shall be protected on the outside up to and through the roof of the building with eight inches (8") of masonry or a metal shield which provides an eight inch (8") ventilated air space between such shield and the steel or iron stack; provided, that a metal smokestack when located inside of a vent shaft having masonry enclosing walls not less than eight inches (8") thick and having an air space between the walls and the stack on all sides may have such masonry or metal shield protection omitted. All stacks shall be properly guyed when the height of the stack exceeds 15 times its least diameter.

Smokestacks constructed of not less than No. 10 U. S. Gauge steel, with either welded or riveted joints, may be mounted directly upon industrial, heating and/or power boilers which are designed to support the stack load. A clearance of not less than six inches (6") shall be maintained at all times around such smokestack and any flammable material within twelve inches (12") of such smokestack shall be protected by one-fourth inch ($\frac{1}{4}$ ") of asbestos covered by sheet metal.

Sections 3703-3704

Sec. 3703. Gas furnaces, gas water heaters and other gas appliances which are required to be vented, may in lieu of the chimney required in Section 3701, be provided with a vent of unglazed fire clay or concrete tile pipe not less than one-half inch ($\frac{1}{2}$ ") in thickness and having a sleeve or flange not more than twenty-four inches (24") apart and at every joint in such vent pipe. Such sleeves or flanges shall project at least three-fourths inch ($\frac{3}{4}$ ") beyond the outer surface of the joint and shall securely join the sections of such vent and all joints shall be well cemented. The sleeves or flanges shall be securely attached to the portions of the building or structure adjoining such vents and act as a spacer to provide an air space around such vent, or such vent may be entirely enclosed in a galvanized iron pipe with such sleeves or flanges separating the outer pipe at least one-half inch ($\frac{1}{2}$ ") from the clay or concrete vent. The area of any flue or vent shall be not less than the area of the largest vent connection inlet plus 50 per cent of the areas of all other additional inlets, provided that no gas flue or vent shall have an area of less than twelve square inches (12 sq. in.), and shall be not less than two inches (2") in any internal dimension. No vent connection inlet shall be located at the bottom of any gas vent, and any two inlets must be offset or staggered so that it will be impossible for any horizontal plane to pass through any part of both inlets.

Gas Vents

A single galvanized or copper bearing metal vent connection exposed to view in a room throughout its entire length may be used to connect the appliance to the vent. Such metal vent connection shall be not less in diameter than the connection on the appliance and shall be maintained not less than six inches (6") distant from any combustible portion of the building or the combustible material shall be protected by not less than one-hour fire-resistive construction as specified in Chapter 43. Every portion of a vent connection shall have a rise of not less than one inch (1") to the foot from the appliance to the chimney and the length of such connection shall be no greater than the height of the vent from the point at which the vent connection enters to the top of the vent.

Every vent shall extend in as nearly a vertical position as possible and be continuous from the gas appliance to the outside of the building and extend at least two feet (2') above any portion of the roof within fifteen feet (15') of said vent.

No vent connection connected to any gas appliance having pilot provision for automatic or remote control, shall be connected to any chimney flue which is used as a smoke flue for any stove, boiler, heater or other apparatus designed to burn wood, coal, oil or other fuel other than gas unless such pilot provision is so designed that the supply of gas to the main burners in connection therewith will be automatically shut off when combustion of gas is not taking place at the pilot.

Sec. 3704. Patent chimneys may be used, except for oil burners, when complying with the requirements of this Code.

Patent Chimneys

All patent chimneys shall be constructed with a flue lining enclosed in a metal outer casing which is so arranged as to provide not less than a one inch (1") air space between the flue lining and the casing. The flue lining shall be made of fire clay or suitable refractory clays adapted to withstand reasonably

Section 3705

high temperatures and flue gases, shall have a softening point not lower than 1994 degrees Fahrenheit and shall be not less than one inch (1") in thickness. Such chimneys shall be built up from the floor level on which they are used and in no case shall a stove pipe enter the bottom of a patent chimney.

When such chimneys are erected on the outside of a building they shall be supported by a substantial iron bracket attached to the studs or framework of the building with through-bolts. When erected on the inside of a building such patent chimneys shall be provided with a smokeproof clean-out of approved design at or near the floor. The floor on which they are placed shall be protected by not less than eight inches (8") of masonry or terra cotta set on a one-fourth inch ($\frac{1}{4}$ ") metal plate. Partitions enclosing patent chimneys shall have an opening opposite the clean-out on the chimney for the purpose of cleaning the flue.

When such chimneys are used with fireplaces, they shall be supported by a metal plate embedded in mortar at the throat of the fireplace. The metal plate shall provide a means of keeping the one inch (1") air space between the flue lining and the casing.

All patent chimneys shall be built plumb and without bends. All joints in such chimneys shall be made with cement mortar and the bands covering the joints shall be of not less than 24 U. S. Gauge galvanized iron. All patent chimneys shall be braced every six feet (6') in their height by not less than 16 gauge wire secured to the chimney by locks or collars and extending in at least three directions.

Not more than two inlets for smoke pipes will be permitted in any patent chimney. When only one inlet is provided the flue shall be not less than six inches (6") in diameter and shall be not less than eight inches (8") in diameter where two inlets are provided.

All galvanized iron used for the casing of patent chimneys shall be of 24 U. S. Gauge riveted together with rivets not more than three inches (3") apart or seamed and with such seams secured with rivets at the top and bottom of each section. There shall be not less than one inch (1") clearance between the chimney and the casing at all points and such casing shall be ventilated by not less than six one inch (1") holes punched near the top of the chimney above the roof so as to permit the escape of hot air.

Smoke Pipes, and Thimbles

Sec. 3705. All smoke pipes shall be as short and straight as possible. Smoke pipes for furnaces, boilers or apparatus burning solid or liquid fuel shall be constructed of black iron of not less than 24 U. S. Gauge or masonry and shall fit tightly into the chimney. Galvanized iron shall not be used.

Smoke pipes shall enter the side of chimneys through a fire clay or metal thimble or a flue-ring of masonry. The top of smoke pipe intakes shall be set not less than eighteen inches (18") below sheet metal ceilings, wood lath and plaster or exposed wood framing. Neither the intake pipe nor the thimble shall project into the flue. No wood-work shall be placed within six inches (6") of the thimble. When a smoke pipe enters a chimney breast through a studded-off chimney partition the thimble shall be kept six inches (6") clear of all woodwork.

Sections 3706-3707

Sec. 3706. All fireplace walls shall be not less than eight inches (8") thick and if built of stone or hollow units shall be not less than twelve inches (12") thick. The faces of all such minimum thickness walls exposed to fire shall be lined with fire brick, soap stone, cast iron or other suitable fire-resistive material. When lined with four inches (4") of fire brick such lining may be included in the required minimum thickness. All fireplaces shall be connected to a regulation chimney as specified in Section 3701, or to a patent chimney as specified in Section 3704.

Fire-places

All fireplaces and chimney breasts shall have trimmer arches or other approved fire-resistive construction supporting hearths. The arches and hearths shall be not less than twenty inches (20") wide measured from the face of the chimney breast and not less than twelve inches (12") wider than the fireplace opening on each side. The arches shall be of brick, stone or hollow tile not less than four inches (4") thick. A flat stone or reinforced concrete slab may be used to carry the hearth instead of an arch if it be properly supported and a suitable fill provided between it and the hearth. Hearths shall be of brick, stone, tile or concrete. Wood centering under a trimmer arch shall be removed after the masonry has thoroughly set.

False fireplaces for gas or electrical heaters shall not be constructed in imitation of fireplaces unless complying with all the requirements for fireplaces. Gas and electrical space heaters may be installed in recesses not more than six inches (6") in depth, provided the entire recess is constructed of incombustible material. Such recesses shall be labeled by means of a metal plate bearing the words "For Gas and Electrical Appliances Only".

No heater burning solid or liquid fuel shall be placed in a fireplace which does not comply with the requirements of this Section. No such heaters shall be connected to a gas vent flue. No wood shall be placed within eight inches (8") of the jambs or within twelve inches (12") of the top or arch of any fireplace opening.

Sec. 3707. Warm air furnaces designed to burn solid or liquid fuel shall be encased in a double metal shield with an air space between and shall be protected with at least three inches (3") of sand on top and shall rest on masonry or concrete floors. No wood partitions shall be built within seven feet (7') of the front or four feet (4') of the sides of the outer shield of such furnaces, but the distance to the partitions at the side may be reduced to two feet (2') if they are covered with sheet metal or metal lath and plaster. The distance from the top shield of such furnace to any ceiling or framing of wood above shall be not less than twenty-four inches (24") unless such wood ceiling or framing is protected with not less than one-hour fire-resistive construction as specified in Section 4302.

**Warm
Air
Furnaces**

Every furnace designed to burn solid or liquid fuel shall set upon a masonry floor or be placed on a bed of not less than four inches (4") of masonry and every portion thereof including the smoke pipe shall be at least two feet (2') from any combustible material or such combustible material shall be protected by a covering of No. 24 U. S. Gauge galvanized iron, furred with metal furring not less than one and one-half inches (1½")

Sections 3707-3709

from such combustible construction or shall be entirely covered by one-hour fire-resistive construction. Any such furnace set in masonry shall be completely and tightly covered with at least four inches (4") of brick, concrete, tile, sand or a combination of such materials. Every such furnace shall be connected to a regulation chimney as specified in Section 3701.

Every gas furnace other than single pipe floor furnaces shall be set in a furnace room upon a masonry floor or shall be set upon not less than two inches (2") of masonry on asbestos board not less than one-half inch ($\frac{1}{2}$ ") in thickness covered with No. 20 U. S. Gauge galvanized iron or steel. The top of such furnace shall be not less than nine inches (9") from protected combustible material nor less than eighteen inches (18") from unprotected combustible material. Gas furnaces shall not be installed in any location inaccessible for inspection and repair. An opening or door not less than thirty by thirty-six inches (30"x36") shall be provided for access to the room or space in which any gas furnace is installed. Every such furnace shall be vented into a regulation chimney as specified in Section 3701 or as provided in Section 3703.

An air supply for combustion shall be provided for every warm air furnace. Such supply shall be from outside the building into the furnace space through one or more openings. Such openings shall have a net area of not less than four hundred square inches (400 sq. in.). No obstruction of any kind shall be placed over such openings except wire netting with openings not less than one-half inch ($\frac{1}{2}$ ") square. Air used for conveying heat and for ventilation may be taken from outside the building, from inside the building or from both sources. Where such air is taken from inside the building or from both inside and outside the building it shall be conducted to the furnace by means of ducts of incombustible material.

The furnace room or rooms shall be located in the basement or cellar of any building having a gravity system and the least horizontal dimension of such room shall be six feet (6'). The floor of the furnace room shall be not less than seven feet (7') in the clear below the bottom of the lowest joists of any floor under which lateral heat pipes from the furnace or furnaces are taken and such floor shall be constructed of incombustible materials.

Low Pressure Steam Heating Plants

Sec. 3708. Steam hot water heating plants, for not more than 15 pounds pressure, and hot water heaters using solid or liquid fuel, shall rest upon masonry or reinforced concrete floors and shall be protected on the outside by asbestos. The clearance of wooden partitions, ceilings, and other combustible materials shall be the same as given for warm air furnaces.

Boilers

Sec. 3709. Large boilers for power or steam purposes or for generating high pressure steam shall be so located that no wood or other combustible material shall be less than five feet (5') from the top or sides or ten feet (10') from the front of such apparatus and all combustible material less than ten feet (10') from the top or sides or less than twenty feet (20') from the front shall be protected with at least four inches (4") of concrete, brick or other similar incombustible material and shall be well ventilated to prevent the temperature rising above 125

Sections 3709-3712

degrees Fahrenheit. Steel, cast iron or concrete columns adjacent to such boilers shall not be in direct contact with furnace settings but there shall be an open and unobstructed space at least four inches (4") wide for ventilation.

Sec. 3710. All stoves used for heating, cooking or laundry purposes using solid or liquid fuel shall have all combustible partitions in back of and extending not less than twelve inches (12") beyond each side of such stove protected by not less than one-hour fire-resistive construction as specified in Chapter 43. Such stoves shall be securely supported at least twelve inches (12") above any wood floors by metal supports and there shall be a metal and asbestos pad at least three-eighths inch ($\frac{3}{8}$ ") thick below such stove extending at least six inches (6") beyond each side and at least twelve inches (12") in front of such stove. Such stoves shall not be placed nearer than six inches (6") to any combustible partition.

Stoves

All such stoves shall be connected by a smoke pipe to a chimney meeting the requirements specified in Section 3701.

Sec. 3711. Gas ranges, domestic hot water heaters and hot plates shall be supported at least six inches (6") above any wood floor or other combustible material and where burners are not provided with a shield below, the wood or other combustible material shall be protected with a double metal shield with a one inch (1") air space between or with a one-half inch ($\frac{1}{2}$ ") pad of metal and asbestos. Combustible partitions or walls within six inches (6") of any gas range, hot plate or ordinary domestic hot water heater, and within three inches (3") of any approved domestic automatic storage hot water heater shall be protected by one-fourth inch ($\frac{1}{4}$ ") of asbestos, covered with a 26 U. S. gauge metal covering or shall have not less than a one-hour fire-resistive protection as specified in Chapter 43, provided that approved domestic gas ranges of the fully insulated type shall be exempt from the foregoing requirements. Wood ceiling or other combustible materials shall be at least three feet (3') above such installations. All water heaters shall be connected to a vent pipe meeting the requirements of Section 3703 or to a regulation chimney as specified in Section 3701.

Gas Ranges, Domestic Water Heaters and Hot Plates

In the kitchen of every building hereafter erected there shall be provided a chimney as provided in Section 3701, a vent as provided in Section 3703 or in lieu of such chimney or vent, when approved by the Building Inspector, there may be installed in the wall or ceiling approximately over the gas outlet, a ventilating opening with an area of not less than six inches by eight inches (6" x 8"), connected to a ventilating duct leading to the outside air, such duct for each kitchen to be not less than twenty-four square inches (24 sq. in.) in cross sectional area. An approved system of forced draft ventilation may be substituted for the natural draft ventilating system.

Sec. 3712. Gas ranges for restaurants, bakeries or hotels shall be supported at least six inches (6") above any wood floor and if less than twelve inches (12") above the floor, the wood shall be protected by a metal shield or such ranges may rest on a steel and masonry support. Such ranges shall not be placed nearer to any wood partitions or other combustible material than six inches (6") and if nearer than twelve inches (12") such par-

Gas Ranges For Restaurants and Hotels

Sections 3712-3715

titions shall be protected with a metal or asbestos shield. The distance from any such range to any wood ceiling or other combustible material above shall not be less than twelve inches (12") and if less than three feet (3') the ceiling or combustible material above shall be protected with a double metal shield with one inch (1") air space between or with one inch (1") of metal lath and portland cement plaster or one inch (1") of asbestos. Hood and ventilating flues from such ranges may be of sheet metal or masonry and if of sheet metal shall be protected from all wood or other combustible materials by four inches (4") of concrete, gypsum or terra cotta tile or an eight inch (8") air space and a metal shield. Such ventilating flues shall not be carried through wood floors or up combustible partitions unless protected by at least four inches (4") of masonry or concrete.

Oil Burners

Sec. 3713. Stoves, furnaces and other heating or power apparatus in which oil burners are installed shall be constructed and erected as required for similar apparatus using solid fuel.

Oil burning apparatus using commercial fuel oil, furnace oil, diesel oil or other flammable liquids shall be constructed and installed in compliance with the regulations of the National Board of Fire Underwriters for the "Construction and Installation of Oil Burning Equipment and for the Storage and Use of Oil Fuels in Connection Therewith" recommended by the National Fire Protection Association, Edition of 1934, with amendments of 1936¹.

Other Sources of Heat

Sec. 3714. Other sources of heat and flame not specifically mentioned herein shall be constructed and so protected as to prevent heating any wood or other combustible material used in the construction of floors, ceilings, partitions or other parts of a building to a temperature of over 125 degrees Fahrenheit, when in full operation, and shall be so constructed as not to be liable to undue corrosion or deterioration and not subject to accidental overturn or other disarrangement conducive to dangerous conditions.

Warm Air Ducts and Appurtenances

Sec. 3715. For gravity systems no leader heat pipes shall be over twenty feet (20') in length measured horizontally, except where a booster fan is installed when such length shall not exceed forty feet (40'). All such pipes under first floor joists shall have a uniform rise of at least one inch (1") per lineal foot of horizontal run. Warm air pipes and appurtenances serving first floor rooms shall have a minimum cross sectional area in square inches of not less than the cubic foot capacity of the room or rooms in which registers are located, divided by 40; provided, that no leader pipe shall have a net area less than fifty square inches (50 sq. in.). Risers and appurtenances serving floors above the first floor shall have a net area of not less than two-thirds that required to serve the first floor.

Registers shall be located in or near the wall of the room nearest the furnace. No register shall be located in outside walls except in cases of absolute necessity. Where double registers are supplied by one leader pipe each register shall have a capacity of not less than two-thirds the area of the leader pipe. When necessary to install appurtenances in an outside

¹ See Specification Documents.

wall at least the weather side shall be covered with air-cell asbestos paper.

Ninety degree bends in round pipe shall be made by not less than four piece elbows. Sixty degree bends shall be made by means of not less than three piece elbows. All warm air pipes and fittings, cold air or recirculating pipes, ducts, boxes and fittings shall be made of bright tin or galvanized iron. All such appurtenances except leader heat pipes under the first floor shall be covered with two thicknesses of asbestos paper weighing at least eight pounds to one hundred square feet (100 sq. ft.) or with air-cell asbestos insulation, or shall be double walled with a one-fourth inch ($\frac{1}{4}$ ") space between the inner and outer walls. Horizontal warm air pipes shall be kept at least three inches (3") from any combustible material or shall be protected with an asbestos shield and a one inch (1") air space. Air-cell asbestos paper not less than one-fourth inch ($\frac{1}{4}$ ") in thickness shall be securely cemented around all leader pipes.

All riser pipes shall be braced or held in place by means of metal strips securely fastened to the pipe and shall in no case be held in place by nailing diagonally through the corners of such pipe. No joint shall depend wholly upon solder to make it tight. All leader pipes shall be securely fastened in place by means of wires or metal strips.

In the installation of Y runs or branch runs the cross sectional area of the warm air pipe at the furnace shall equal in square inches the cubic contents of all the rooms served by such warm air pipe divided by 40. Sizes of branch runs shall be determined in the same manner on the basis of the room or rooms served. Branches from trunk lines shall be taken off in a generally horizontal plane at an angle not less than 45 degrees from the line of the pipe. Fifteen degree Y branches may be permitted in forced draft systems. Riser pipes shall not be taken off the top of the first floor register boxes.

Where warm air pipes and appurtenances are to be installed in a building the joists and studs shall be so arranged as to provide not less than 14 inches (14") clear space in continuous horizontal runs and/or vertical risers from the furnace to the register served.

Sec. 3716. All incinerators which are built as an integral part of the building shall have the enclosing walls of the fire boxes or combustion chamber of solid masonry or reinforced concrete not less than eight inches (8") in thickness where the horizontal area does not exceed fifteen square feet (15 sq. ft.) and not less than twelve inches (12") in thickness where the combustion chamber is of greater area. The inner four inches (4") of such combustion chamber walls shall be of fire brick laid in fire clay or cement mortar, except that the walls surrounding the ash chamber below the fire grate need not be so lined. The inner walls of any combustion chamber shall not be offset in excess of one inch (1") for every three inches (3") of rise in the height of the wall unless supported by reinforced concrete or structural steel.

The chimney for every incinerator shall be constructed as specified in Section 3701, with an approved spark arrester placed over the top of the chimney.

CHAPTER 38—FIRE EXTINGUISHING APPARATUS

**Automatic
Sprinklers;
Where Re-
quired**

Sec. 3801. Standard automatic sprinklers shall be installed as specified in this Chapter in the following places:

1. In the cellar of every building.
2. In buildings of Groups A, B and C occupancy: under the gridiron, under the stage floor, under all fly and tie galleries, in all dressing rooms, storerooms, property rooms, carpenter shops, paint shops, passageways and all places back of the proscenium wall. A line of sprinklers shall be installed on the stage side of, and immediately back of the proscenium curtain and not more than five feet (5') above the proscenium arch.
3. In all Group E occupancies occupied wholly or in part as a planing mill, box factory, wood working establishment where lumber is made into a finished product and in which more than two power operated wood working machines exclusive of saws are used.
4. In all Group E occupancies occupied wholly or in part as a mattress factory used to manufacture, assemble or renovate mattresses or stuffed furniture using cotton, silk floss, mohair or other like material for packing or stuffing.
5. In all Group E occupancies used as film exchanges.
6. In Group B and C occupancies in any enclosed occupied space below or over a stairway, except where the entire construction is as required for Type I buildings, and in all portions of basements or cellars used for storage or maintenance work rooms.

Exception: The above provisions shall not apply in the following places:

Automatic sprinklers shall not be required in the cellars of Group H and I occupancies having four or less apartments, nor in the cellars of Group C, D, E, F, G, and H occupancies when the ceiling of such cellar or basement is three feet (3') or more above grade, nor when such cellars or basements have an area of fifteen hundred square feet (1500 sq. ft.) or less.

**Detailed
Require-
ments**

Sec. 3802. Every automatic sprinkler system required by this Code shall comply in all respects with the "Regulations of the National Board of Fire Underwriters recommended by the National Fire Protection Association for the "Installation of Sprinkler Equipment" Edition of 1936' with amendments of September, 1937.

Exceptions: A single water supply equal to the primary supply required by such regulations may be accepted as complying with the requirements of this Code. In no case where a connection to a city water main constitutes the source of supply shall such connection be less than four inches (4") in diameter.

Sprinklers required in paragraph 6, Section 3801, may be supplied from the domestic water system and need not comply with the provisions of this section except as to pipe sizes and spacing of heads, provided that where the domestic water supply has a pressure less than 15 pounds per square inch, an approved

¹See "Specification Documents".

Sections 3802-3804

automatic chemical extinguisher may be used in lieu of the sprinklers.

The alarm valve required for a standard automatic sprinkler system shall not be required in the cellars of Group C, D, E, F, G, and H occupancies where the area of such cellar is less than three thousand square feet (3000 sq. ft.)

Sec. 3803. Every building three or more stories in height shall be equipped with one or more dry standpipes.

Dry Standpipes; Where Required

Detailed Requirements

Sec. 3804 (a) Construction. Dry standpipes shall be of wrought iron or galvanized steel and together with fittings and connections shall be of sufficient strength to withstand 300 pounds of water pressure to the square inch when ready for service, without leaking at the joints, valves or fittings.

Tests shall be conducted by the owner or contractor in the presence of a representative of the Fire Department whenever deemed necessary and ordered by the Building Inspector. The tests shall be applied at the top and bottom connections of such standpipes and the owner or contractor shall be responsible for any damage caused by breakage or faulty installation while such tests are being conducted. After such standpipes have been tested, the owner or contractor shall remove all water therefrom.

(b) Size. Dry standpipes shall be of such a size as to be capable of delivering 250 gallons per minute from each of any three outlets simultaneously under the pressure created by one fire engine or pumper, based on the existing city equipment available. No part of a dry standpipe system other than hose connections shall be less than three inches (3") in diameter.

(c) Number Required. Every building three or more stories in height where the area of any floor above the second floor is ten thousand square feet (10,000 sq. ft.) or less shall be equipped with not less than one dry standpipe and an additional standpipe shall be installed for each additional ten thousand square feet (10,000 sq. ft.) or fraction thereof.

(d) Location. Standpipes shall be located within stairway enclosures or as near such stairways as possible or shall be on the outside of, embedded within, or immediately inside of an exterior wall and within one foot (1') of an opening in a stairway enclosure or the balcony or vestibule of a smokeproof tower or an outside exit stairway.

(e) Siamese Connections. All four inch (4") dry standpipes shall be equipped with a two-way Siamese fire department connection. All five inch (5") dry standpipes shall be equipped with a three-way Siamese fire department connection and all six inch (6") dry standpipes shall be equipped with a four-way Siamese fire department connection. All Siamese inlet connections shall be located on a street front of the building and not less than one foot (1') nor more than four feet (4') above the grade and shall be equipped with clapper-checks and substantial plugs. All Siamese inlet connections shall be recessed in the wall or otherwise substantially protected.

Sections 3804-3806

(f) **Outlets.** All dry standpipes shall extend from the ground floor to and over the roof and shall be equipped with a two and one-half inch (2½") outlet not more than four feet (4') above the floor level at each story. All dry standpipes shall be equipped with a two-way two and one-half inch (2½") outlet above the roof. All outlets shall be equipped with gate-valves with substantial chains.

(g) **Threads.** All hose threads in connection with such standpipe installations shall be uniform with that used by the local fire department.

(h) **Signs.** An iron or bronze sign with raised letters at least one inch (1") high shall be rigidly attached to the building adjacent to all Siamese connections and such sign shall read: "CONNECTION TO DRY STANDPIPE."

**Wet
Standpipes;
Where
Required**

Sec. 3805. Every Group A, B and C occupancy of any height and every Group D, E, F, G and H occupancy three or more stories in height and every Group E and F occupancy over 20,000 square feet in area shall be equipped with one or more interior wet standpipes extending from the cellar or basement into the topmost story, provided that Group C buildings having no permanent stage and having a seating capacity of less than 500 need not be equipped with interior standpipes.

**Detailed
Require-
ments**

Sec. 3806 (a) Construction. Interior wet standpipes shall be constructed as required for dry standpipes.

(b) **Size.** Interior wet standpipes shall have an internal diameter sufficient to deliver 50 gallons of water per minute under 30 pounds per square inch pressure at the hose connection, based on the available water supply. Buildings of Groups A and B occupancies shall have wet standpipe systems capable of delivering the required quantity and pressure from any two outlets simultaneously, for all other occupancies only one outlet need be figured to be open at one time. In no case shall the internal diameter of a wet standpipe be less than two inches (2").

Any approved formula which determines pipe sizes on a pressure drop basis may be used to determine pipe sizes for wet standpipe systems. The Building Inspector may require delivery and pressure tests on completed wet standpipe systems before approving such systems.

(c) **Number Required.** Wet standpipes shall be so located that any portion of the building can be reached therefrom with a hose not exceeding seventy-five feet (75') in length.

(d) **Location.** In Groups A, B, and C occupancies, outlets shall be located as follows:

On each side of the stage, on each side of the rear of the auditorium and on each side of the rear of the balconies. Where seating capacities are less than 500 the number of locations noted above may be reduced upon the approval of the Building Inspector. In Group D, E, F, G, and H occupancies the location of all interior wet standpipes shall be approved by the Building Inspector.

(e) **Siamese Connections.** All interior wet standpipes shall be equipped with a Siamese fire department inlet connection located

Section 3808

on the street front of the building and such connection shall have two inlets for buildings five stories or less in height, three inlets for buildings six to ten stories inclusive in height, and four inlets for buildings more than ten stories in height.

(f) **Outlets.** All interior wet standpipes shall be equipped with a one and one-half inch (1½") straightway composition gate-valve in each story including the basement or cellar of the building and located not less than one foot (1') nor more than five feet (5') above the floor.

(g) **Threads.** All hose threads in connection with the installation of such standpipes, including valves and reducing fittings, shall be uniform with that used by the local fire department.

(h) **Signs.** An iron or bronze sign with raised letters at least one inch (1") high shall be rigidly attached to the building adjacent to all Siamese connections and shall read: "CONNECTION TO WET STANDPIPE."

(i) **Water Supplies.** All interior wet standpipes shall be connected to a street water main of not less than four inches (4") in diameter or when the water pressure is insufficient to maintain 30 pounds pressure at the highest hose outlet such standpipe shall be connected to a pressure tank, gravity tank or fire pump. Such supply shall be sufficient to furnish at least 30 pounds pressure at the topmost standpipe outlet.

When more than one interior wet standpipe is required in the building, such standpipes shall be connected at their bases or at their tops by pipes of equal size.

(j) **Pressure and Gravity Tanks.** Tanks shall have a capacity sufficient to furnish at least 250 gallons per minute for a period of not less than 10 minutes. Such tanks shall be located so as to provide not less than 25 pounds pressure at the topmost hose outlet for its entire supply. Discharge pipes from pressure tanks shall extend two inches (2") into and above the bottom of such tanks. All tanks shall be equipped with a manhole, ladder and platform, drain pipe, water and pressure gauges. Every pressure tank shall be tested in place after installation and proved tight at a hydrostatic pressure 50 per cent in excess of the working pressure required. Where such tanks are used for domestic purposes the supply pipe for such purposes shall be located at or above the center line of such tanks. Incombustible supports shall be provided for all such supply tanks and not less than a three foot (3') clearance shall be maintained over the top and under the bottom of all pressure tanks.

(k) **Fire Pumps.** Fire pumps shall have a capacity of not less than 250 gallons per minute with a pressure of not less than 25 pounds at the topmost hose outlet. The source of supply for such pumps shall be a street water main of not less than four inch (4") diameter or a well or cistern containing a one-hour supply. Such pumps shall be supplied with an adequate source of power and shall be automatic in operation.

(l) **Hose and Hose Reels.** Each hose outlet of all interior wet standpipes shall be supplied with a hose not less than one and one-half inches (1½") in diameter. Such hose shall be equipped

Sections 3806-3809

with a suitable brass or bronze nozzle and shall be not over seventy-five feet (75') in length. An approved standard form of wall hose reel or rack shall be provided for the hose and shall be located so as to make the hose readily accessible at all times and shall be recessed in the walls or protected by suitable cabinets.

Basement Pipe Inlets

Sec. 3807. Basement pipe inlets shall be installed in the first floor of every store, warehouse or factory where there are cellars or basements under same, except where in such cellars or basements there is installed an automatic sprinkler system as specified by this Code, or where the cellars or basements are used for banking purposes, safe deposit vaults or similar uses.

All basement pipe inlets shall be of cast iron, steel, brass or bronze with lids of cast brass or bronze and shall consist of a sleeve not less than eight inches (8") in diameter through the floor extending to and flush with the ceiling below and with a top flange, recessed with an inside shoulder, to receive the lid and flush with the finish floor surface. The lid shall be a solid casting and have a ring lift recessed in the top thereof, so as to be flush. The lid shall have the words "Fire Department Only, Do Not Cover Up," cast in the top thereof. The lid shall be installed in such a manner as to permit its removal readily from the inlet.

The location of such basement pipe inlets shall be approved by the Building Inspector and shall be kept readily accessible at all times to the Fire Department.

Approvals

Sec. 3808. All fire extinguishing apparatus, including automatic sprinklers, wet and dry standpipes, automatic chemical extinguishers, basement pipe inlets and the appurtenances thereto shall meet the approval of the chief of the Fire Department as to installation and location and shall be subject to such periodic tests as he may require.

Flame Protection

Sec. 3809. Where it is desired to require flame-protection of all stage scenery provisions will be found in the Appendix.

CHAPTER 39—STAGES AND PLATFORMS

Sec. 3901. There shall be one or more ventilators constructed of metal or other incombustible material near the center and above the highest part of any permanent stage raised above the stage roof and having a total ventilation area equal to at least five per cent of the floor area within the stage walls. The entire equipment shall conform to the following requirements or their equivalent:

Stage Ventilators

1. Doors shall open by force of gravity sufficient to overcome the effects of neglect, rust, dirt, frost, snow or expansion by heat or warping of the framework.

2. Glass, if used in ventilators, must be protected against falling on the stage. A wire screen, if used under the glass, must be so placed that if clogged it cannot reduce the required ventilating area or interfere with the operating mechanism or obstruct the distribution of water from the automatic sprinklers.

3. The doors and other covers shall be arranged to open instantly after the outbreak of fire, by the use of approved automatic fusible links which will fuse and separate at not more than 160 degrees Fahrenheit. A manual control must also be provided by a cord running down to the stage at a point on each side of the stage designated by the Building Inspector.

4. The fusible link and the cord must hold the doors closed against a force of at least 30 pounds excess counter weight tending to open the door. The fusible links shall be placed in the ventilator above the roof line and in at least two other points in each controlling cord and so located as not to be affected by the sprinkler heads above. Each stage ventilator shall be operated to an open and closed position at least once before each performance.

Sec. 3902. Gridirons, fly galleries and pin-rails shall be constructed of incombustible materials and fire-protection of steel and iron may be omitted. Gridirons and fly galleries shall be designed to support not less than 75 pounds live load per square foot.

Gridirons

The main counter-weight sheave beam shall be designed to support a horizontal and vertical uniformly distributed live load equal to not less than five pounds per square foot over the area of the gridiron directly back of the proscenium opening.

Sec. 3903. In buildings of Groups A and B occupancy, Division 1, the dressing room sections, workshops, and storerooms shall be located on the stage side of the proscenium wall and shall be separated from each other and from the stage by a "Special Occupancy Separation" as provided in Section 503.

Rooms Accessory to Stage

In buildings of Group C occupancy the dressing room sections, workshops and storerooms shall be located as required for Groups A and B occupancy and shall be separated from the rest of the building and from each other by an "Ordinary Occupancy Separation."

Sec. 3904. In buildings of Groups A and B occupancy, a stage as defined in Section 401 shall be completely separated from the auditorium by a proscenium wall of masonry of not

Proscenium Walls

Sections 3904-3908

less than four-hour fire-resistive construction as provided in Section 4302. The proscenium wall shall extend not less than four feet (4') above the roof over the auditorium.

In buildings of Group C occupancy, a stage as defined in Section 401, shall be completely separated from the auditorium by a proscenium wall of masonry or by incombustible studs protected on the stage side by two inches (2") of portland cement stucco on metal lath and on the auditorium side by three-quarters inch ($\frac{3}{4}$ ") of plaster on metal lath.

Proscenium walls may have, in addition to the main proscenium opening, one opening at the orchestra pit level and not more than two openings at the stage floor level, each of which shall be not more than twenty-five square feet (25 sq. ft.) in area.

Openings in the proscenium wall shall be protected on each side by one-hour fire-resistive doors as specified in Section 4304, except that in buildings of Group C occupancy only one fire-door will be required for each opening. The proscenium opening, which shall be the main opening for viewing performances, shall be provided with a self-closing fire-resistive curtain as provided in Chapter 41.

Stage Floors

Sec. 3905. For buildings of Group A and B occupancy, and when the space under the stage is usable in Group C occupancy all parts of stage floors shall be of Type I construction except the part of the stage extending back from and the full width of the proscenium opening, which may be constructed of steel or heavy timbers covered with a wood floor not less than one and five-eighths inches ($1\frac{5}{8}$ ") thick. No part of the combustible construction except the floor finish shall be carried through the proscenium opening. All parts of the stage floor shall be designed to support not less than 125 pounds per square foot.

Openings through stage floors shall be equipped with tight-fitting trap doors of wood not less than two inches (2") thick.

Platforms

Sec. 3906. Walls and ceilings of a platform in an assembly room shall be fire-protected on the inside with not less than the equivalent of metal lath and plaster.

Any usable space under a raised platform of an assembly room shall be of one-hour fire-resistive construction throughout.

Stage Exits

Sec. 3907. At least one exit two feet and six inches (2' 6") wide shall be provided from each side of the stage opening directly or by means of a passageway not less than three feet (3') in width to a street or exit court. An exit stair not less than two feet six inches (2' 6") wide shall be provided for egress from each fly gallery. Each tier of dressing rooms shall be provided with at least two means of egress each not less than two feet six inches (2' 6") wide and all such stairs shall be constructed as specified in Chapter 33. The stairs required in this sub-section need not be enclosed.

Miscellaneous

Sec. 3908. A protecting hood shall be provided over the full length of the stage switchboard.

CHAPTER 40—MOTION PICTURE MACHINE BOOTHS

Sec. 4001. Every motion picture machine using flammable films, together with all electrical devices, rheostats, sewing machines and all films present in any Group A, B or C occupancy, shall be enclosed in a booth large enough to permit the operator to walk freely on either side or in back of the machine and shall be not less than seven feet (7') high and have a floor area of not less than fifty square feet (50 sq. ft.) to each motion picture machine in such booth.

Motion Picture Machine Booths

The floor of such booth shall be constructed of masonry or reinforced concrete or shall be covered with not less than two inches (2") of masonry. The walls and ceiling shall be of not less than one-hour fire-resistive construction as specified in Chapter 43.

The entrance to booth shall be equipped with a tight-fitting self-closing fire door of Types 4, 5 or 6 as specified in Section 4304. Such door shall open outwardly and shall not be equipped with any latch.

Machine and observation ports in machine booth walls shall be of three kinds; projection ports, observation ports, and combination observation and spot light ports. These ports shall be limited in size and number as follows: There shall be not more than one projection port for each machine head, including stereopticon machines. The area of each projection port shall be not more than one hundred twenty square inches (120 sq. in.). There shall be not more than one observation port for each projection port and their area shall not exceed one hundred fifty square inches (150 sq. in.) each. There shall be not more than three combination observation and spotlight ports and they shall not exceed thirty inches (30") by twenty-four inches (24"). Where the openings in the front wall of the projection booths are larger than the ports specified, they may be reduced to the required size by bolting No. 10 U. S. gauge steel plate over the opening on the booth side of the wall, in such a manner that they cannot be readily removed or moved on the slides. These steel plates shall have the openings of the required size cut in them. There shall be not less than one foot (1') of wall space between openings for combination ports. In no case shall the openings which are to be reduced in size by the steel plate be larger than thirty-six inches (36") square. Each port opening in the projection booth wall shall be completely covered with a single pane of plate glass. Each such opening together with any fresh air inlets, shall be provided with a shutter of not less than No. 10 U. S. gauge sheet metal large enough to overlap at least one inch (1") on all sides of such opening and arranged to slide without binding. These shutters shall be held normally open by means of small chains fastened to a 160 degree Fahrenheit fusible link, the whole so arranged that the shutters may be easily released and closed either by hand or automatically when released by the fusible link and shall be so designed as to effect a weight of not less than eight pounds on each fusible link. Pieces of film shall not be used in place of fusible links. The shutters shall be so hung that the operation of closing shall be

Section 4001

smooth and without noise. The closing of all shutters shall be effected in five seconds.

Every booth shall be equipped with a ventilating inlet not less than thirty square inches (30 sq. in.) in area placed near the floor on each of three sides and protected by wire netting. At the top of every booth there shall be at least a ten inch (10") diameter vent for each motion picture machine. Such vent shall be constructed of sheet metal not less than No. 24 U. S. gauge and shall connect into a masonry flue or go directly through the roof and twelve inches (12") above, and shall be provided with an exhaust fan which will produce a complete change of air in the booth every 10 minutes. No wood or other combustible material shall be allowed to come within four inches (4") of the vent. There shall be not more than one elbow or change in direction of this metal vent in any attic space. No such vent shall pass through any occupied room unless encased in not less than four inches (4") of solid masonry.

All shelves, furniture and fixtures within the booth shall be constructed of metal or other incombustible material. Every motion picture machine shall be securely fastened to the floor to prevent overturning.

All films not in actual use shall be stored in metal cabinets or boxes constructed of galvanized iron or steel with metal partitions and shelves. Each such compartment shall have a capacity not in excess of 10 reels of film, and shall have tight self-closing doors of iron or steel. No solder shall be used in the construction of such metal boxes or cabinets.

CHAPTER 41—PROSCENIUM CURTAINS

Sec. 4101. Proscenium curtains when required shall be made of incombustible materials constructed and mounted so as to intercept hot gases, flames and smoke, and to prevent glow from a severe fire on the stage showing on the auditorium side within a period of five minutes. The curtain shall be raised and lowered each evening at the close of the performance. The closing of the curtain from the full open position shall be effected in less than thirty seconds, but the last five feet (5') of travel shall require not less than five seconds.

**Proscenium
Curtains;
General
Require-
ments**

Sec. 4102. A proscenium curtain for stage openings over sixty feet (60') in width shall comply with the regulations contained in "Appendix P" of the building code recommended by the National Board of Fire Underwriters, Fifth Edition, revised reprint, 1934, or with the regulations contained in "Schedule for Rating Motion Picture Plants and Film Vault Buildings" of the Board of Fire Underwriters of the Pacific, Revision of November 12, 1931. A proscenium curtain for stage openings sixty feet (60') or less in width, shall be constructed and installed as specified in this Chapter. The curtain shall be made of one thickness of asbestos cloth weighing not less than three and one-quarter pounds per square yard.

**Curtain
Coverings**

The asbestos cloth used in the construction of the curtain shall have incorporated into the yarn, before weaving, either monel metal, nickle, brass or other metal or alloy having not less strength than these metals at temperatures up to 1700 degrees Fahrenheit and no less resistance to corrosion at ordinary temperatures. Asbestos cloth made of long fiber blue crocidolite asbestos may be used in place of crysotile asbestos cloth of the same weight. The wires used to reinforce the yarn shall be either single or double but the tensile strength of each wire shall be sufficient to support a load of not less than three pounds at ordinary temperatures, and the strength of two strands of yarn and one wire twisted together shall be sufficient to support a load of six pounds. The strength of the cloth in tension when tested by the strip method shall be not less than 160 pounds per inch of width of warp and 52 pounds per inch of filling.

The asbestos fiber of yarns may contain cotton or other combustible fiber not to exceed 20 per cent of the weight of the asbestos. The total carbon content of the cloth shall not exceed 10 per cent of the total weight of the fiber. When required by the Building Inspector, a sample of the cloth of sufficient size for testing shall be submitted.

In addition to any decoration, the curtain shall be painted on both sides with a mineral paint having a silicate of soda binder, which will completely fill the cloth. Filler paint shall have not less than four parts of casein in each 10 parts of silicate of soda. This paint shall be well brushed into the cloth so that no light or smoke can come through.

Sec. 4103. The curtain shall be made of continuous vertical strips of asbestos cloth. The widths of cloth shall overlap at the seams not less than one inch (1") and shall be sewed with a double row of stitching of asbestos thread.

**Design and
Construction**

The curtain shall be wide enough to extend into steel smoke grooves on each side of the proscenium opening at least eight

Sections 4103-4104

inches (8") and shall overlap the top and sides of the proscenium opening at least twelve inches (12").

Six-inch (6") pockets shall be sewed in the top and the bottom of the curtain to hold the pipe battens; the sides shall be hemmed at least six inches deep. A two-inch pipe batten shall be placed at the top and a one and one-half inch (1½") batten at the bottom. For stage openings over forty feet (40') in width the bottom batten shall be not less than two and one-half inches (2½") in diameter. The battens shall be reinforced at the joints with twelve-inch (12") sections of pipe housed and riveted.

The curtain shall be held to the steel guides in the smoke pockets with substantial roller grips riveted or bolted to the side hem, not more than eighteen inches (18") on center. Each roller grip shall be fastened to the curtain with not less than three bolts or rivets.

No. 16 U. S. gauge galvanized metal shall be bent and placed vertically along each side hem of the curtain material, so that both faces of the hem are covered not less than six inches (6"). This metal edging shall be fastened to the side hem with rivets spaced not more than six inches (6") on center.

The top of the curtain shall have a smoke stop fitted to make it as smoke-tight as practicable. The bottom of the curtain shall have a yielding pad of incombustible material not less than three inches (3") thick to form a seal against the floor.

Operating Equipment

Sec. 4104. Smoke grooves which protect the sides of the curtain shall be of structural steel shapes and plates not less than one-quarter inch (¼") thick. These grooves shall be not less than fourteen inches (14") deep and six inches (6") wide and shall be set back from the face of the arch at least six inches (6"). Grooves shall extend from the stage floor to a point three feet (3') above the top of the raised curtain, and shall be securely bolted to the proscenium wall. Details of the grooves shall be submitted to the Building Inspector and Fire Chief for approval.

Steel tracks shall be built into the smoke grooves upon which shall travel the roller curtain guides. This track must be so installed that it is held rigidly in place and so that roller guides will operate smoothly. Safe support and smooth operation are required with a wind load of one pound per square foot over the entire area of the curtain.

Support for the curtain shall be by means of one-quarter-inch (¼") flexible steel cables for curtains forty feet (40') or less in width, and three-eighths-inch (⅜") flexible steel cables for curtains over forty feet (40') in width. These cables shall be spaced not more than twelve feet (12') on centers, and the end overhang shall be not more than fifteen inches (15"). Supporting cables shall be tied to the top batten with a clove-hitch and the end secured with two iron rope clips. A substitute method of attachment will be allowed if approved by the Building Inspector.

The supporting cables shall pass through sheaves in the gridiron and over to the counter-weight guides and shall fasten to the counter-weight by means of three-eighth-inch (⅜") turn-

Section 4104

buckles with clove-hitches and cable clips. Turnbuckles shall be locked to prevent backing out. Weight of the curtain shall be evenly divided on the cables.

There shall be safety stay chains of straight welded link fastened to the top curtain batten of sufficient strength to support safely the weight of the curtain. There shall be one more stay chain than the number of supporting cables and, except for the stay chains at the ends of the curtain, shall be centered between the supporting cables. Stay chains shall be securely attached to the top batten of the curtain and thence to the gridiron, if of steel construction, or shall be bolted through the proscenium wall with three-fourths-inch ($\frac{3}{4}$ ") bolts. Safety chains shall be so adjusted that they support the curtain when it is lowered and the bottom batten is resting on the pad supported by the floor.

All cables shall be carried over head and loft blocks fitted with ball or roller bearings of ample capacity to accommodate the weight at the speeds required. Grooves in the blocks shall be machined properly to cradle and protect the cable. All blocks supporting the proscenium curtain shall be supported on the proscenium wall by means of steel brackets of suitable size safely to carry the weight, or shall be mounted on structural steel beams.

Blocks shall be installed so that the head-block is sufficiently higher than the loft blocks to prevent cables from fouling loft block housings.

Diameters of the blocks shall be a minimum of twelve inches (12") for three-line sets and sixteen inches (16") for all other sets.

The mechanism and devices for controlling the curtain shall be of simple design and shall be positive in operation. Opening of the curtain shall be by hydraulic or electric power. For curtains where the overbalance on the curtain side does not exceed 150 pounds, manual operation may be used. In this case, manual operation will be allowable only if a method is provided which allows the curtain and counterbalance to be approximately equal under normal conditions, but which adds the required over-weight on the curtain side automatically in case of an emergency.

Emergency release shall be by gravity obtained by over-balancing the curtain. The emergency control line shall be of cotton sash cord, fitted with not less than four fusible links, one on each side of the stage and two overhead in the gridiron, which when the links are fused or the sash cord burned will allow the curtain to lower itself automatically. This control line shall extend up both sides of the proscenium arch and across the gridiron, and shall be so arranged that when released it will also automatically open the stage ventilators.

On each side of the proscenium arch, at a location in plain view shall be located an easily read sign, bearing the inscription: "In case of fire, cut line to lower fire curtain," with an indicator pointing to the location of a knife for that purpose. The knives shall be attached to the wall by a chain sufficiently long to reach the release line.

Sections 4104-4108

For electric operation there shall be installed push buttons plainly marked: "Fire Curtain—stop; Fire Curtain—down." One set of control buttons shall be installed on each side of the proscenium opening. For hydraulic or manual operation the endless line shall be marked plainly with an arrow pointing the direction for closing.

For manual operation the operating hand line shall be not less than three-fourths inch ($\frac{3}{4}$ ") diameter manila rope secured to the top and bottom of the counterweight arbor, and shall pass under a floor block, adjustable for tension, of not less than twelve-inch (12") diameter.

The top and bottom counterweight sections of the arbor shall be of cast iron, sufficiently heavy to accommodate safely the loads. The top and bottom sections shall be connected with rods not less than three-fourths-inch ($\frac{3}{4}$ ") diameter, with one tie-plate for every four feet (4') of rod. There shall be smooth grooves on the ends of the top and bottom weights which engage the steel guides. Intermediate weights shall be of cast iron, grooved to drop into place on top of the lower carrying weight. The turnbuckles connecting the supporting cables to the top weight shall be attached to eye-bolts passing through the top weight.

Counterweight guide tracks shall be structural "T's" or angles, properly tied together and securely anchored to the proscenium wall. All joints where the counterweight travels shall be ground smooth and a liberal coating of grease shall be applied to the tracks. These guides shall extend from the gridiron a length equivalent to the length of the arbor, plus the travel of the curtain, plus five feet (5'). The specified length shall be considered as the minimum. A structural steel stop shall be provided at the bottom of the arbor.

For proscenium curtains in which the overbalance is in excess of 150 pounds, an approved adjustable checking device shall be installed to check the speed of fall during the last five feet (5') of travel and an alarm shall be installed at the center of the top of the proscenium arch, which will sound when the curtain is descending through the emergency release.

Tests

Sec. 4105. The complete installation of every proscenium curtain shall be subjected to operating tests and any theater in which such proscenium curtain is placed shall not be opened to public performances until after the proscenium curtain has been accepted and approved by the Building Inspector.

New Designs

Sec. 4106. Curtains of other designs and materials, when not obviously of greater fire resistance than specified in this Chapter, shall before acceptance be subjected to the standard fire test specified in Chapter 42, as applicable to non-bearing partitions, except that such tests shall be continued only for a period of five minutes unless failure shall have occurred previously. The unexposed face of the curtain shall not glow within a period of five minutes nor shall there be any passage of smoke or flame through the curtain.

PART VIII

FIRE-RESISTIVE STANDARDS FOR FIRE PROTECTION

CHAPTER 42—GENERAL

Sec. 4201. Building materials, systems, units and forms of construction as regulated by this Code shall be classified as "four-hour fire-resistive construction," "three-hour fire-resistive construction," "two-hour fire-resistive construction" and "one-hour fire-resistive construction," for fire-resistive purposes and protection. Materials, systems, units and forms of construction, in order to be classed as four-hour, three-hour, two-hour or one-hour fire-resistive construction shall meet the respective requirements for such rating as specified in the "Standard Specifications for Fire Tests of Building Construction and Materials," (A. S. T. M. Designation C19-33)¹ of the American Society for Testing Materials.

Fire-Resistive Construction Defined

Any materials, systems, units or forms of construction which meet the requirements of the aforesaid standard specifications shall be accepted as fire-resistive construction of the degree specified, if and when they shall be shown by an authoritative test conducted in accordance with all of the provisions of such aforesaid specifications, to possess such fire resistance.

Sec. 4202. The following materials, combinations of materials, systems and units shall be classed as fire-resistive materials:

Fire-Resistive Materials

- Brick
- Concrete brick, block or tile
- Gypsum block or tile
- Gypsum (plain or reinforced)
- Gypsum plaster board (or lath) and plaster.
- Hollow clay tile
- Metal
- Metal and asbestos
- Metal lath and plaster
- Portland cement concrete (plain or reinforced)
- Sand-lime brick

Sec. 4203. All fire-resistive construction of burned clay, concrete or gypsum units or other similar units shall be solidly bedded and laid in gypsum mortar, lime-cement mortar or cement mortar; provided, that gypsum units shall be laid in gypsum mortar only. All such units shall be thoroughly bonded together by broken joints in alternate courses or by sufficient metal ties or bonds.

Fire-Resistive Construction

All concrete, gunite, gypsum or similar protection for steel or iron structural members which is cast, poured or similarly applied shall be reinforced at the edges of such members in a

¹See "Specification Documents".

Section 4203

manner sufficient to prevent cracking and disintegrating of such protection. All such applied fire protection materials shall be reinforced by metal rods, wire or mesh to provide against cracking and disintegrating of the protecting material.

All plaster fire protection shall consist of gypsum mortar, portland cement mortar or other equally fire-resistive material. Gypsum plaster only shall be used for plastering on gypsum units. When plaster is used for fire protection purposes it shall be reinforced with a metal mesh or lath when the plaster is more than one inch (1") thick. Gunite applied to masonry need not be reinforced and when properly bonded shall be considered a part of the required thickness.

CHAPTER 43—FIRE-RESISTIVE STANDARDS

Sec. 4301. The thickness of fire-resistive materials for fire protection of structural parts shall be as shown in Table No. I of this Chapter for the respective degree of fire protection shown. The figures shown shall be the net thickness of the protecting materials and shall not include any hollow space or spaces between the fire-protecting materials and the member protected. The thickness of plaster protection shall be measured from the face of the plaster to the plane of the back surface of the metal or wire lath where such lath is used and shall include two-thirds of the thickness of the gypsum plaster board (or lath) where such board (or lath) is used.

Protection of Structural Parts

Grade A concrete shall mean concrete with a coarse aggregate of limestone, pumice, calcareous pebbles, trap rock, blast furnace slag, burnt clay, burnt shale or other coarse aggregates containing not more than 65 per cent of siliceous material, such as granite, sandstone, chert pebbles, flint, cinders or quartz.

Grade B concrete shall mean concrete with a coarse aggregate other than that allowed in Grade A concrete.

For flat ceilings where the ceiling protection for beams, girders or slabs is suspended to form a free air space of not less than one inch (1") between the member and the protection, the protection thicknesses may be one-half inch ($\frac{1}{2}$ ") less than that required in Table No. I of this Chapter for flat ceiling protection, but no thickness shall be less than three-fourths inch ($\frac{3}{4}$ ").

Soffit tile protecting beam and girder flanges shall be tied to the flange with steel or iron ties.

If the structural part is of iron or steel the thickness given in Table No. I of this Chapter shall be measured outside of the extreme edges of the structural shapes, except that projecting edges of lugs and brackets shall be given a minimum protection of one-inch (1") thickness. For reinforced concrete members, the thickness given in Table No. I of this Chapter shall be outside of the reinforcement. For purposes of design the protection shall not be considered as carrying load except as permitted for columns in Section 2620.

Plaster protections of over one-inch (1") in thickness shall have an additional layer of metal lath, wire or metal mesh embedded not more than three-fourths inch ($\frac{3}{4}$ ") from the surface and securely tied into the supporting members.

Wire of not less than No. 10 B. and S. gauge wound or tied around members at not more than a six-inch (6") pitch, or wire or expanded metal mesh shall be placed and well embedded in all concrete, poured gypsum and gunite protections.

Wire mesh or other forms of metal ties in concrete protections shall be held away from the structural members and embedded in the protection not less than three-fourths inch ($\frac{3}{4}$ ") from its outer surface at points of minimum thickness. Hollow tile or gypsum block protections shall have iron or steel ties embedded in each horizontal joint, or have outside iron or steel ties over each unit, the diameter of wire to be 0.18 inch, or of equivalent area in ties of other forms. Wire mesh, where used for tying protections, shall weigh not less than one and

Section 4301

TABLE NO. 1—Minimum Protection of Structural Parts Based on Time Periods for Various Incombustible Insulating Materials

Structural Parts to Be Protected	Insulating Material Used	Minimum thickness of material in inches for the following fire resistive periods				
		4 hr.	3 hr.	2 hr.	1 hr.	
Steel or Cast Iron Columns; Projecting Steel Beam or Girder Flanges; All Members of Primary Trusses	Grade A concrete	2	2	1½	1	
	Grade B concrete	3	2½	2	1½	
	Gunitite	2	1½	1	¾	
	Brick of clay, shale, concrete or sand-lime	3¾	3¾	2¾	1¾	
	Clay tile, clay tile and concrete or concrete block (see note 2)	4 or 2 pl.	4 or 2 pl.	2	2	
	Solid gypsum blocks	2 pl.	2 pl.	2	2	
	Hollow gypsum blocks	3 pl.	3	2	2	
	Poured gypsum	2	1½	1	1	
	Metal lath and gypsum or portland cement plaster	—	—	2½*	1	
	Webs of Steel Beams and Girders	Grade A concrete	2	1½	1	1
Grade B concrete		3	2½	1½	1	
Gunitite		2	1½	1	¾	
Brick of clay, shale, concrete or sand-lime		3¾	2¾	2¾	2¾	
Clay tile, clay tile and concrete or concrete block		3 or 2 pl.	2	2	2	
Solid gypsum block		2 pl.	2	2	2	
Hollow gypsum block		3 pl.	2	2	2	
Poured gypsum		2	1½	1	1	
Reinforcing Steel in Reinforced Concrete Columns, Beams, Girders and Trusses	Metal lath and gypsum or portland cement plaster	—	—	2	1	
	Grade A concrete	1½	1½	1½	1	
Reinforcing Steel in Reinforced Concrete Joists	Grade B concrete	2	1½	1½	1	
	Grade A concrete	1¾	1¾	1	¾	
Ceiling Protection for Roof Members including Roof Trusses and Secondary Trusses (See Note 3)	Grade B concrete	1¾	1½	1	¾	
	Metal or wire lath and gypsum or cement plaster, concrete, burned clay products or gypsum	2	1½	1	¾	
	Gunitite	1½	1	¾	¾	
Reinforcing and Tie Rods in Floor and Roof Slabs	Grade A concrete	Thickness 1	1	¾	¾	
	Grade B concrete	includes gypsum or cement plaster	1½	1	1	¾
	Gypsum		1	1	¾	¾

NOTE: (1) pl. in above table shall be not less than ½ in. gypsum or cement plaster.
(2) Reentrant parts of protected members shall be filled solid for 4 and 3 hour protections.
(3) See paragraph 4, Section 4301.
* Two ¾ in. layers with ¾ in. air space between.

Sections 4301-4302

one-half pounds per square yard. Where metal lath or wire mesh is used as a plaster base or tie it shall weigh not less than two and two-tenths pounds per square yard, and shall have two and one-half or more meshes per inch or equivalent. Gypsum plaster board not less than three-eighths inch ($\frac{3}{8}$ ") thick and having not more than 15 per cent combustible material combined with the gypsum may be substituted for metal lath for resistance periods of not more than two hours, provided the plaster is reinforced with metal or wire mesh weighing not less than one and one-half pounds per square yard, standing away from the board and secured to the supporting members, and two-thirds of the thickness of the plasterboard may be considered as plaster.

Concrete aggregates whose mineral composition is unknown or undetermined shall for the application of these regulations be classed as Grade B aggregates.

Sec. 4302. Fire-resistive bearing and non-bearing walls and partitions shall be of not less than the thicknesses and construction set forth in this Chapter, to be classed for the respective degrees of protection indicated.

The structural requirements of the masonry and reinforced concrete walls shown in Table No. II of this Chapter are specified in Chapters 24 and 29 for the specific location or use of the walls and all walls shall comply with those structural requirements as well as the fire-resistive limitations as specified in this Chapter.

The tabulated thicknesses given in Table No. II of this Chapter are minimum and shall not be broken into; provided that where combustible floor or partition members project into solid masonry or reinforced concrete walls or partitions the required effective thickness of wall shall be measured from two inches (2") back along the member from the end in the wall, to the opposite face of the wall. Where such members project into hollow walls and the space between the members and for not less than four inches (4") above and below them is filled solid with fire-resistive incombustible materials for the full thickness of the wall, or where such hollow walls are constructed of hollow units laid with cells horizontal (side construction) the required thickness shall be measured as specified for solid masonry walls in this paragraph. Where the hollow spaces are not thus filled or where hollow units are laid with cells vertical (end construction) the required effective thickness of wall shall be measured from the end of member in wall to the opposite face of wall.

Plaster, in order that it may be considered as adding to the fire resistance of walls and partitions shall be gypsum or portland cement plaster applied to an average thickness of not less than one-half inch ($\frac{1}{2}$ ") on each side. Plaster over one inch (1") in thickness, as measured to the plaster base, shall have an additional layer of metal lath, wire or metal mesh embedded not more than three-fourths inch ($\frac{3}{4}$ ") from the surface and securely tied into the supporting members.

Required fire-resistive plastering or stucco on the outside of exterior masonry walls may be omitted from inaccessible portions of the wall provided the inside plastering opposite the inaccessible portions is doubled in thickness.

Fire-Resistive Walls and Partitions

TABLE NO. II—Rated Fire Resistive Periods for Various Walls and Partitions

MATERIAL	CONSTRUCTION	Minimum Finished Thickness face to face (including plaster where mentioned) in inches			
		4-hr.	3-hr.	2-hr.	1-hr.
Brick of Clay, Shale, Sand-Lime or Concrete, and Plain Concrete	Solid unplastered	8			4*
	Solid plastered	9		5*	
	Hollow (rowlock) unplastered	12	10	8	
	Hollow (rowlock) plastered	9			
Hollow Clay Tile Wall	End or side construction. One cell in wall thickness. Plastered				3*
	End or side construction. Two cells in 8-in. or less thick- ness. Unplastered	16	12		6* or 8
	End or side construction. Two cells in 8-in. or less thick- ness. Plastered	13	9	7*	
	End or side construction. Two cells in wall thickness. Unplastered			6	
Hollow Clay Tile A. S. T. M. Load Bearing	End or side construction. Two cells in wall thickness. Plastered			5*	
	End or side construction. Three cells in 8-in. or less thickness. Unplastered	12			
	End or side construction. Three cells in 8-in. or less thickness. Plastered one side		8½		
	End or side construction. Three cells in 8-in. or less thickness. Plastered	9			
Combination of Brick and A. S. T. M. Load-Bearing Tile	4-in. brick and 4-in. tile plastered one side (tile side)	9			

TABLE NO. II (Continued)

MATERIAL	CONSTRUCTION	Minimum Finished Thickness face to face (including plaster where mentioned) in inches			
		4-hr.	3-hr.	2-hr.	1-hr.
"Special" Hollow Concrete Block or Tile	One cell in 8-in. or less thickness. Unplastered	12†	8	6	4*
	One cell in 8-in. or less thickness. Plastered	9†		5*	
Hollow Concrete Block or Tile	One cell in 8-in. or less thickness. Unplastered	16	12	10	6* or 8
	One cell in 8-in. or less thickness. Plastered	13	11	7* or 9	7*
Solid Concrete	Reinforcement not less than 0.2% in each direction	6	5*	4*	2*
Solid Gunite	Reinforcement not less than 0.2% in each direction	5* or 6	4*	3*	2*
	Unplastered	6*	5*	4*	3*
	Plastered	5*	4*	4*	3*
Hollow Gypsum Blocks	Outer shell 2-in. thick for 10-in. wall and 1½ in. thick for 8-in. wall	10*	8*		
Hollow Wall of Reinforced Gunite	Incombustible studding with metal or wire lath.				2*
	Incombustible studding with metal or wire lath, neat wood fiber gypsum plaster.			2*	
	Incombustible studding with metal or wire lath. ¾ in. plaster on each side				3*
Hollow Partition with Gypsum or Portland Cement Plaster or Gunite on Each Side.	Incombustible studding with metal or wire lath. 1 in. plaster on each side			2* & 4½*	
	Wood studs with metal or wire lath. Fire-stopped. ¾ in. plaster on each side.				3* or 5
	Wood studs with metal or wire lath. Fire-stopped. 1 in. neat wood fiber plaster each side.			5*	

*Indicates that such walls and partitions shall be used for non-bearing purposes only.

†This thickness to be given a four-hour rating only after an A. S. T. M. certified fire test.

Sections 4302-4303

Fire-Resistive Walls and Partitions (Cont.)

Gypsum plaster board (or lath) not less than three-eighths inch ($\frac{3}{8}$ ") in thickness and having not more than 15 per cent of combustible material combined with the gypsum may be substituted in interior construction for metal lath for resistance periods of not more than two hours, provided the plaster is reinforced with metal or wire mesh weighing not less than one and one-half pounds per square yard, standing away from the board (or lath) and secured to the supporting studs or joists. Two-thirds of the thickness of the plaster board (or lath) may be considered as plaster.

Gypsum plaster board (or lath) conforming to the specifications contained in the preceding paragraph may be substituted for metal lath and the reinforcement of the plaster omitted, provided that the joints of the plaster board (or lath) are covered with strips of metal fabric not less than three inches (3") in width and the plaster board (or lath) is plastered with not less than one-half inch ($\frac{1}{2}$ ") of fibered gypsum plaster containing not more than 33 $\frac{1}{2}$ per cent by weight of silica.

A three-eighths inch ($\frac{3}{8}$ ") gypsum plaster board (or lath) with a mechanical key may be substituted for metal lath without the necessity for stripping the joints in the plaster board (or lath) with strips of metal fabric, provided, wall assemblies containing such plaster board (or lath) have passed the standard fire test as specified in Section 4201.

Metal or wire lath shall weigh not less than two and two-tenths pounds per square yard. Metal or wire mesh where used as ties in concrete shall weigh not less than one and one-half pounds per square yard. Where used as ties for plaster it shall weigh not less than two and two-tenths pounds per square yard and have not less than two and one-half meshes per inch, or equivalent.

Wood studs for bearing partitions or walls shall be not less than the two inch by four inch (2"x4") nominal size and be spaced not more than sixteen inches (16") apart.

Note: The term "plastered" in Table No. II, in this Chapter, shall mean walls plastered with not less than one-half inch ($\frac{1}{2}$ ") of gypsum or portland cement plaster on each side of wall.

Fire-Resistive Floor and Ceiling Construction

Sec. 4303. Fire-resistive floor construction shall be accepted for the following respective degrees of fire-resistive protection when constructed as specified in this Section. For the structural details of any floor construction, the particular details specified under Part VI of this Code shall govern.

Four-hour, three-hour and two-hour fire-resistive floors as specified in this Section shall be constructed entirely of incombustible materials.

(a) **Four-Hour.** Four-hour fire-resistive floor construction shall consist of reinforced concrete, gypsum and/or solid masonry slabs or arches not less than four inches (4") in thickness or shall consist of hollow masonry slabs or arches not less than four inches (4") in thickness with a top covering of not less than two inches (2") of solid masonry, or shall consist of steel joists protected with fire-resistive materials of the kind and thickness shown in Table No. III in this Chapter. Except in the case of steel joisted construction, all reinforcing, tie rods and supporting structural members in such floors shall be protected

**TABLE NO. III—Minimum Protection for Metal and Wood Joists
Based on Time Periods for Various Insulating Materials**

Joists to be Protected	Insulating Material Used	Minimum thickness of material in inches for the following fire-resistive periods			
		4-hr.	3-hr.	2-hr.	1-hr.
Ceiling protection of Steel Joists, where incombustible slab not less than 2½ in. thick is placed above	Metal or wire lath and gypsum or portland cement plaster, concrete, burned clay products or gypsum	2	1½	1	¾*
	Gunite	1½	1	¾	¾*
Ceiling Protection of Wood Joists with double floor on top	Metal or wire lath and gypsum or portland cement plaster				¾*

*When unusable spaces occur above ceiling, protection may be omitted. When unusable spaces occur below first floor, plaster may be omitted.

with not less than four-hour fire-resistive construction as specified in Section 4301.

(b) **Three-Hour.** Three-hour fire-resistive floor construction shall consist of reinforced concrete, gypsum and/or solid masonry slabs or arches not less than three inches (3") in thickness or shall consist of hollow masonry slabs or arches not less than four inches (4") in thickness with a top covering of solid masonry not less than one and one-half inches (1½") in thickness, or shall consist of steel joists protected with fire-resistive materials of the kind and thickness shown in Table No. III in this chapter. Except in the case of steel joisted construction all reinforcing, tie rods and supporting structural members in such floor construction shall be protected with not less than three-hour fire-resistive construction as specified in Section 4301.

(c) **Two-Hour.** Two-hour fire-resistive floor construction shall consist of reinforced concrete, gypsum and/or solid masonry slabs or arches not less than two and one-half inches (2½") in thickness or shall consist of hollow masonry slabs or arches not less than three inches (3") in thickness with a top covering of not less than one inch (1") of solid masonry, or shall consist of steel joists protected with fire-resistive materials of the kind and thickness shown in Table No. III in this Chapter. Except in the case of steel joisted construction all reinforcing, tie rods and supporting structural members in such floor construction shall be protected with not less than two-hour fire-resistive construction as specified in Section 4301.

(d) **One-Hour.** One-hour fire-resistive floor construction shall consist of one of the following:

1. Reinforced concrete, gypsum and/or solid masonry slabs or arches not less than two and one-half inches (2½") in thickness.
2. Hollow masonry slabs or arches not less than three inches (3") in thickness with all joints in such hollow unit construction thoroughly filled with cement or gypsum mortar.

Sections 4303-4304

Fire-Resistive Floor Construction (Con't.)

3. Steel joists protected with fire-resistive materials of the kind and thickness shown in Table No. III in this Chapter.
4. Wood joisted construction with a double wood floor on top (the subfloor not less than three-fourths inch ($\frac{3}{4}$ ") thick, and the total thickness of the two layers not less than one and one-fourth inches ($1\frac{1}{4}$ ") thick) and with a fire-resistive ceiling, as shown in Table No. III of this Chapter, securely fastened to or suspended from the under side of such joists, except the metal lath and plaster ceiling shall not be required below the lowest floor joist over unusable space. Five-eighths-inch ($\frac{5}{8}$ ") approved plywood subfloor may be used in lieu of three-quarter-inch ($\frac{3}{4}$ ") solid wood subfloor.

Except in the case of steel joisted construction, all reinforcing, tie rods and supporting structural members shall be protected with not less than one-hour fire-resistive construction as specified in Section 4301.

All flat ceilings where the ceiling protection for beams, girders or slabs is suspended to form a free air space between the member and the protection, the protection thicknesses may be one-half inch ($\frac{1}{2}$ ") less than that required in Table No. III in this chapter for flat ceiling protection, but no thickness shall be less than three-fourths inch ($\frac{3}{4}$ ") minimum protection of metal and wood joists based on time periods for various insulating materials.

In any reinforced concrete floor construction which includes a metal lath and cement or gypsum plastered ceiling on the under side, not less than three-fourths inch ($\frac{3}{4}$ ") thick, the required slab thickness may be reduced one-half inch ($\frac{1}{2}$ ") but in no case shall be less than two and one-half inches ($2\frac{1}{2}$ ") thick.

Fire Doors, Shutters and Windows

Sec. 4304. (a) Fire-Resistive Doors. One-hour fire-resistive doors shall be constructed as specified for one of the following types, 1, 2 or 3, or any door which will successfully pass the one-hour fire test specified in Section 4201, and all such doors to receive the one-hour rating, shall be hung in place as specified in this Section.

Fire-resistive doors used for openings in stairway enclosures, smokeproof towers, corridors and passageways, moving picture booths, room partitions, exterior walls facing streets or more than twenty-five feet (25') from adjacent property lines and for "Ordinary Occupancy Separations" as specified in Section 503, shall be constructed as specified for one of the following types: 1, 2, 3, 4, 5 or 6 or any door which will provide equivalent protection against fire when hung in place as specified in this Section.

1. Tin-clad wood-core doors with the core made of three plies of wood one inch (1") nominal in thickness and covered with sheet metal, the door to be constructed in accordance with the "Underwriters' Standard for Tin-Clad Fire Doors and Shutters," Edition of July, 1937.¹

2. Sheet metal doors constructed of two sheets of not less than No. 26 U. S. Gauge corrugated sheet metal, one sheet on

¹See "Specification Documents".

each side of a structural steel frame, corrugations vertical on one side and horizontal on the other and having not less than one-sixteenth inch ($\frac{1}{16}$ ") of asbestos placed in between the two metal sheets.

3. Sheet metal doors constructed of two sheets of metal of not less than No. 26 U. S. Gauge fastened to a structural steel frame in such manner as to leave a one inch (1") space in the panels, which space shall be filled with asbestos and with a one-eighth inch ($\frac{1}{8}$ ") asbestos covering on the stiles and structural steel frame.

4. Tin-clad wood-core doors made of two plies of wood one inch (1") nominal in thickness and covered with sheet metal, the door to be constructed in accordance with the "Underwriters' Standard for Tin-Clad Fire Doors and Shutters," Edition of July, 1937.

5. Sheet metal doors as specified in paragraph 3 above, but with one-fourth inch ($\frac{1}{4}$ ") of asbestos placed between the metal sheets in the panels and with no asbestos required on the stiles and structural frame.

6. Metal-clad doors which shall be wood panel doors with frame not less than one and three-fourths inches ($1\frac{3}{4}$ ") in thickness and with wood panels not less than three-fourths inch ($\frac{3}{4}$ ") in thickness, the whole door covered with not less than No. 26 U. S. Gauge metal. The panels of such doors shall fit into the frame not less than three-fourths inch ($\frac{3}{4}$ ") and all joints of metal shall be lapped and nailed tightly to the wood frame.

In all cases metal shall be fastened to the wood or metal frame by nailing, bolting or riveting and no solder shall be used on any door except for filling of joints.

Glass panels of one-fourth inch ($\frac{1}{4}$ ") wire glass shall be permitted in any of the above doors except when such doors are used on all openings for the stage portion of any Group A occupancy or for openings in "Special Occupancy Separations" as specified in Section 503. Such glass panels shall be not more than seven hundred and twenty square inches (720 sq. in.) in area, nor exceed fifty-four inches (54") in height or forty-eight inches (48") in width. Grooves not less than three-fourths inch ($\frac{3}{4}$ ") in depth and three-eighths inch ($\frac{3}{8}$ ") in width providing not less than five-eighths inch ($\frac{5}{8}$ ") of bearing for the glass shall be required.

Fire doors bearing the label of the Underwriters' Laboratories, Incorporated, shall be accepted as meeting the requirements of any of the above doors.

Hardware for sheet metal and tin-clad fire doors referred to in paragraphs No. 1, 2, 3 and 4, shall be made of good quality malleable iron not less than one-fourth inch ($\frac{1}{4}$ ") thick or of flat rolled structural steel not less than three-eighths inch ($\frac{3}{8}$ ") thick; provided, that tubular steel track made of at least one-eighth inch ($\frac{1}{8}$ ") steel may be used. Sliding tracks shall be supported so that a wall fastening is directly opposite each door hanger when door is in a closed position. Hangers supporting doors shall be fastened to the door with not less than three one-

Section 4304

Fire Doors, Shutters and Windows (Con't.)

half inch ($\frac{1}{2}$ ") bolts extending through the door. Latches for fire doors shall be not less than two and one-half inches by three-eighths inch ($2\frac{1}{2}$ " $\times$ $\frac{3}{8}$ "), and latch bars shall be not less than one and one-half inches by one-fourth inch ($1\frac{1}{2}$ " $\times$ $\frac{1}{4}$ ").

Hardware for swinging hollow metal and metal-clad doors as referred to in paragraphs 5 and 6 shall be made as follows:

Hinges. For doors not exceeding eight feet (8') in height the hinges shall be of steel or bronze. If made of steel they may be either full, half surfaced, or butt hinges four and one-half inches by four and one-half inches ($4\frac{1}{2}$ " $\times$ $4\frac{1}{2}$ ") and not less than one-eighth inch ($\frac{1}{8}$ ") in thickness. If made of bronze they shall be butt hinges four and one-half by four and one-half inches ($4\frac{1}{2}$ " $\times$ $4\frac{1}{2}$ ") and not less than three-sixteenths inch ($\frac{3}{16}$ ") in thickness. When bronze hinges are used a steel stud and socket shall be provided at each hinge. The studs shall be attached to the rear jamb and shall engage a socket at least three-fourths inch ($\frac{3}{4}$ ") deep in the rear edge of the door.

Locks. Doors shall be provided with a mortise or unit lock which has a latch bolt with a throw of not less than three-fourths inch ($\frac{3}{4}$ ").

When mounted in pairs the normally standing door shall have a push bolt at the top and at the bottom which has a throw of not less than three-fourths inch ($\frac{3}{4}$ ").

Special locking devices shall be provided as required in Part III under Occupancy, and as provided in Sections 3304, 3311 and 3315.

Astragals. Swinging fire doors mounted in pairs shall be provided with at least one astragal attached to one door and overlapping the opposite door at least three-fourths inch ($\frac{3}{4}$ "). The above provision need not apply when the doors meet on a mullion.

Fire doors required by this Code shall be installed in the manner prescribed in the "Regulations for the Protection of Openings in Walls and Partitions Against Fire," of the National Board of Fire Underwriters, recommended by the National Fire Protection Association, Edition of January, 1939.

All fire doors shall be so hung that when closed they will fit tightly into place against the wall or frame so as to prove an effective stop for fire and smoke. Space around fire doors necessary for their operation shall at all times be kept unobstructed and when deemed necessary by the Building Inspector a screen or railing protection shall be installed to insure no storing or placing of material against any fire door which would prevent its operation in case of emergency.

(b) **Fire-Resistive Shutters.** One-hour fire-resistive shutters shall be constructed as specified for any one of the types of fire-resistive doors specified in part (a) of this Section.

(c) **One-Hour Fire-Resistive Windows.** One-hour fire-resistive windows shall have frames and sash of solid metal bars or hollow metal forms fabricated by pressing, welding or crimping

¹See "Specification Documents".

Sections 4304-4305

together but not by the use of solder or other fusible alloy. All glass used in fire-resistive windows shall be wire glass and shall be not less than one-fourth inch ($\frac{1}{4}$ ") in thickness and no one light shall exceed seven hundred and twenty square inches (720 sq. in.) in area. Grooves three-fourths inch ($\frac{3}{4}$ ") in depth shall be provided and glass so arranged as to have not less than five-eighths inch ($\frac{5}{8}$ ") of bearing in hollow metal frames and with grooves not less than one-half inch ($\frac{1}{2}$ ") and with glass provided with not less than three-eighths inch ($\frac{3}{8}$ ") of bearing in windows of solid metal section. Continuous glazing angles shall be provided on the inside. Fire-resistive windows with hollow metal frames shall be limited to a maximum size of sixty square feet (60 sq. ft.) with a six-foot (6') maximum width and a ten-foot (10') maximum height for double hung and counterbalanced windows and to a maximum size of seventy square feet (70 sq. ft.) with a seven-foot (7') maximum width and ten-foot (10') maximum height for stationary windows. Solid metal section windows shall be limited to a maximum size of eighty-four square feet (84 sq. ft.) in area with a maximum dimension in either direction of twelve feet (12'). Multiple section windows of these above sizes may be used when hollow metal or solid section mullions are provided. Hollow metal mullions shall be limited to a maximum length of twelve feet (12') and shall be used for non-bearing purposes only. Solid section mullions when used in lengths exceeding twelve feet (12') shall be fire-protected as required in Section 4301 in accordance with the fire-resistive construction of the building in which they are placed. Where fire-resistive windows are required by this Code, wood sash and plain glass may be substituted when protected as specified in Subsections (a) and (b) of this Section.

Fire-resistive windows bearing the label of the Underwriters' Laboratories, Incorporated, shall be accepted as one-hour fire-resistive windows.

Section 4303. (a) General. Roof coverings for all buildings shall be either "Fire Retardant" or "Ordinary" roofings as specifically required either by Location in Part IV, or by Type of Construction in Part V. The roof covering shall be securely fastened to the supporting roof construction.

(b) Composition Roofing Materials. 1. Definitions. FELT is the dry or de-saturated product produced by "felting" vegetable or animal fibers or other suitable materials or by "felting" not less than 85 per cent by weight of asbestos fibers.

ROOFING FELT is felt saturated with a bituminous compound.

ROLL ROOFING is felt saturated with a bituminous saturant, then coated on both sides with a bituminous coating and then surfaced on both sides with powdered talc, mica or other suitable mineral matter; provided, that such roll roofing need not be coated nor surfaced if felt is produced from asbestos and two or more layers are used in combination.

FELT MEMBRANE is felt saturated with bituminous saturant, then coated on one or both sides with a bituminous coating.

Section 4305

Roof Coverings (Con't.)

2. Physical Properties: Materials used in composition roofing shall conform to the requirements set forth in the "Standard for Class C Asphalt, Rag Felt, Sheet Roofing and Shingles," published by the Underwriters' Laboratories, Incorporated, edition of December 15, 1938.

3. Method of Laying. Where there is not a ceiling underneath, a layer of unsaturated building paper weighing not less than five pounds to each one hundred square feet (100 sq. ft.) of such paper shall be laid over wood decks before the laying of composition fire retardant roof covering, except asphalt shingles.

Built-up composition roofings shall be thoroughly mopped between layers with an approved bituminous compound so that no layer touches unmopped the layer next above.

Gravel top covering shall mean flowing a coat of an approved bituminous compound and completely covering with gravel, crushed rock, crushed brick, other crushed earthenware of similar mineral surfacing material, a sufficient quantity being embedded in the bituminous compound in accordance with good standard practice.

4. Tests. Test methods, used to determine the specific requirements for physical properties of roll roofing, roofing felt, or felt membrane given in this Section shall be those methods set forth in the "Tentative Methods of Testing Felted and Woven Fabrics Saturated with Bituminous Substances for Use in Waterproofing and Roofing," A.S.T.M. Designation D 146-38T of the American Society for Testing Materials.

(c) **Fire Retardant Roofings.** "Fire Retardant" roofing shall be any roof covering which meets the requirements specified for any one of the following roofings, 1 to 7 inclusive, or shall be any roofing meeting the requirements of the Class A or B specifications of the Underwriters' Laboratories, Incorporated.

1. Any built up composition roofing consisting of layers of roofing felt, roll roofing, felt membrane or gravel, the sum of whose fire retardant values as given in Table No. IV of this Chapter, equals not less than 15 including a top covering selected from parts (b) or (c) of said table.

2. Hydraulic compressed rigid shingles not less than one-eighth inch ($\frac{1}{8}$ ") thick, composed of portland cement and asbestos fibers, laid over a layer of saturated felt weighing not less than 14 pounds to the one hundred square feet (100 sq. ft.) or hydraulic compressed rigid sheets not less than seven thirty-seconds inch ($\frac{7}{32}$ ") thick, composed of portland cement and asbestos fibers. The aforesaid felt may be omitted when the compressed shingles are placed over an existing roof covering.

3. Asphalt-saturated mineral-surfaced prepared composition shingles laid so there are not less than two thicknesses at any point. The combined weight of such shingles shall be not less than 200 pounds to the one hundred square feet (100 sq. ft.) of completed roof area.

4. Concrete slab or concrete tile roofs, constructed as specified in Chapter 26 without additional roof covering.

TABLE NO. IV
MINIMUM PHYSICAL PROPERTIES AND FIRE RETARDANT VALUE OF ROOFING MATERIALS

Reference Number	Type of Roofing	Min. Wt. per 108 sq. ft.	Min. Felt wt. per 108 sq. ft.	Min. Saturation Percentage*	Fire Retardant Value
(a) BASE SHEETS					
No. 15	Roofing Felt (Rag).....	14	5.6	140	3
No. 14	Roofing Felt (Asbestos).....	14	9.5	40	5
No. 18	Felt Membrane (Asbestos).....	18	8.5	50	5
No. 20	Felt Membrane (Rag).....	20	5.0	120	3
No. 40	Roll Roofing (Rag).....	37	7.5	140	6
No. 42	Roll Roofing (Rag).....	40	10.0	150	6
No. 30	Roofing Felt (Rag).....	26	10.0	150	6
(b) CAP SHEETS (MAY BE USED AS BASE SHEETS)					
No. 116	Split Sheet Roofing (2 layers min.).....	58 (each)	10.0 (each)	150	15
No. 41	Roll Roofing (Asbestos).....	40	13.0	50	9
No. 43	Built up Felt (Asbestos).....	41	6.4 (each)	40	9
No. 90	Mineral Surfaced (Rag).....	87	10.0	150	10
No. 14	(2 layers) Roofing Felt (Asbestos).....				10
No. 55	Roll Roofing Black Top (Asbestos).....	50	17.5	50	10
No. 35	Roll Roofing White Top (Asbestos).....	30	9.5	40	5
(c) GRAVEL AND CERAMIC MATERIAL					
Gravel		250			4
Crushed Hard Burned Ceramic Material.....		200			4

* These figures shall be not less than 80% of the Kerosene value of the felt.

NOTE: For Fire Retardant Roofings top covering shall be selected from (b) or (c).

Section 4305

Roof
Coverings
(Con't.)

5. Metal roof covering of corrugated, standing seam or flat type of not less than No. 26 U. S. gauge metal. All flat metal roof coverings shall be laid on solid sheathing. Corrugated or standing seam metal roof covering shall be designed to support the required live load between supporting members.

6. Slate shingles securely fastened with copper nails or with copper nails and No. 14 B. and S. gauge copper wire, with nails of such length as to provide not less than three-fourths inch ($\frac{3}{4}$ ") of penetration into the nailing strips or sheathing. Under all such shingles there shall be placed at least one layer of asphalt saturated felt weighing not less than 30 pounds to 108 square feet.

7. Clay roof tile securely fastened with copper nails or copper wire; provided that for roofs not exceeding a rise of eight inches (8") in twelve inches (12"), galvanized iron nails may be used, and provided further that tile with projection lugs need not be nailed or wired in place. Wire shall be not smaller than No. 14 B and S gauge. Nails shall penetrate the supporting roof construction not less than three-fourths inch ($\frac{3}{4}$ ").

Roofing tile other than flat pan tile with or without flanges, or flat shingle tile, or flat decorative tile, shall satisfy the following strength requirements: When supported on the turned down edges at points six inches (6") each side of the center of the tile, giving four points of support and a span of twelve inches (12") and loaded with a concentration at the center, the average breaking load per tile for five representative tile tested shall be not less than 400 pounds and the breaking load for any individual tile tested shall be not less than 350 pounds.

Roof tile shall not absorb more than 15 per cent of the dry weight of the tile during a 48-hour immersion test.

Under all burned clay units, there shall be placed not less than two layers of asphalt saturated rag felt, each layer weighing not less than fourteen pounds (14 lbs.) to 100 sq. ft., solidly mopped between and surfaced with asphalt.

(d) **Ordinary Roofings.** "Ordinary" roofing shall be any roof covering which meets the requirements specified for any one of the following roofings, 8 to 11 inclusive, or shall be any roofing meeting the Class C Specifications of the Underwriters' Laboratories, Inc., as of December 15, 1938.

8. Any composition roofing or any built up composition roofing consisting of layers of roofing felt, roll roofing, felt membrane or gravel, the sum of whose fire retardant values as given in Table No. IV of this Chapter equals not less than 10.

9. Asphalt shingles laid in one or more layers.

10. Wood shingles of clear vertical grain all-heart wood, not less in thickness than five shingles to two inches (2") at the butt, laid with the following exposures:

Total Length of Shingle	Permissible Exposed Length
16 in.	5 in.
18 in.	5½ in.
24 in.	7½ in.
32 in.	9½ in.
36 in.	11 in.

All wood shingles shall be nailed firmly with copper, zinc, zinc-coated or commercially pure iron nails of at least 14 B. and S.

Section 4305

gauge and not less than one and one-fourth inches (1¼") long. Each shingle shall be nailed with two nails driven substantially into the supporting roof construction.

Wood shingles bearing the label of any recognized inspection agency, certifying compliance with Commercial Standard CS 31-38 of the United States Department of Commerce Bureau of Standards may be accepted as meeting the requirements of this Code.

(e). **Roofings for Group J Occupancies.** On buildings housing Group J Division 1 occupancies any composition roofing having a fire-retardant value as given in Table No. IV of this Chapter equal to not less than 6, unless otherwise required because of location as specified in Parts IV and V of this Code.

PART IX

REGULATIONS FOR USE OR OCCUPANCY OF STREETS AND PROJECTIONS OVER PUBLIC PROPERTY

CHAPTER 44.—TEMPORARY USE OF STREETS DURING CONSTRUCTION

Temporary Use of Streets During Construc- tion

Sec. 4401. No building material or materials shall be placed upon the streets or sidewalks except as provided in this Chapter.

Building materials required for use immediately or in connection with the construction of a building may be placed upon the street or sidewalk in front of the building in course of construction or alteration. The maximum width of such occupied space shall not exceed one-third the width of the street, measured between curbs, and in no case shall the space within five feet (5') of the nearest rail of any railway tracks be occupied for building materials. The sidewalk space may be occupied for building construction purposes provided the owner or his agent constructs a temporary sidewalk not less than five feet (5') in width in the outer portion of the permissible occupied space, and such temporary sidewalk shall be protected on the building side by a tight fence not less than eight feet (8') in height.

In Fire Zone No. 1 and when the proposed building exceeds a height of two stories in any part of the city, the owner or his agent shall construct, before any building is commenced, a temporary covered walk-way not less than five feet (5') wide, of sufficient strength to protect the public from falling materials during construction and such covered walk-way shall remain in place until the completion of all of the exterior portions of the building. When the area occupied by the sidewalk or temporary walk-way is to be excavated, such walk shall be made of boards not less than two inches (2") thick, designed to support a load of not less than 150 pounds per square foot, provided with suitable ramps at each end, and with hand rails on each side. The roof over such walk-way shall be the full width of the walk-way and of not less than two layers of one inch (1") boards with joints broken, and shall be placed not less than ten feet (10') above the temporary walk-way. In lieu of one inch (1") boards, either one or both layers of roof covering may be of five-eighths inch ($\frac{5}{8}$ ") or thicker plywood. Whenever such roof is used for storing of materials a railing and foot board shall be so installed as to prevent the materials from spilling into the street.

Building materials may be placed in front of the property adjoining a building site under the same conditions as provided for the occupation of the street immediately in front of the building site, provided the written consent and waiver of claim for damages against the City is obtained from the owner or owners of such adjoining property, and filed in the office of the Building Inspector.

Section 4401

No building material, fence, shed or any obstruction of any kind shall be placed so as to obstruct free approach to any fire hydrant, lamp post, manhole, fire alarm box, or catch basin, or so as to interfere with the passage of water in the gutter.

Mortar or concrete may be prepared in the space permitted for storage of building materials, but shall be done in a mechanical mixer or in a tight box or on a tight mixing board in such a manner that dripping or splashing is prevented. Pavements shall be well cleaned of all building materials at the completion of the construction of a building.

The covered walk-way shall be kept well lighted continuously between sunset and sunrise and the outer edge of the occupied space of the street or sidewalk shall have placed thereon red lights which shall be kept burning continuously between sunset and sunrise.

The street side of any barricade or fence and handrails and sidewalks shall be kept reasonably smooth and in good repair while construction work is in progress or while such barricades, fences or walk-ways are placed on or over public property.

CHAPTER 45—PERMANENT OCCUPANCY OF PUBLIC PROPERTY

Permanent Occupancy of Public Property

Sec. 4501. No portion of any building whatsoever nor any accessory thereto other than signs shall project over the public street or sidewalk except as specified in this Section.

(a) **Balconies over Sidewalks.** Unroofed porches, balconies or oriel windows may extend not more than three feet (3') over public streets or sidewalks, but shall in no case be less than ten feet (10') in the clear above the sidewalk or street level immediately below.

(b) **Movable Awnings.** Movable awnings of combustible materials supported throughout on metal frames may extend over the sidewalk portion of a public street a distance equal to two-thirds the width of the sidewalk space; provided, that every such awning frame shall be not less than seven feet six inches (7' 6") above the sidewalk immediately below and that any fringe attached to such awning shall be not less than seven feet (7') from the sidewalk level immediately below.

(c) **Cornices.** Cornices constructed of fire-resistive materials if more than ten feet (10') above the sidewalk may project over a public street not more than four feet (4').

(d) **Marquees.** A fixed awning or marquee projecting over the sidewalk shall conform to the following regulations:

1. Such awning or marquee shall be supported entirely from the building.

2. In Fire Zone No. 1 all structural members of any fixed awning or marquee shall be of incombustible material. In Fire Zones No. 2 and 3 all combustible material used in the construction of any fixed awning or marquee shall be protected by not less than one-hour fire-resistive construction as specified in Chapter 43.

3. Such awning or marquee shall be at least eight feet (8') in the clear between the lowest point of any projection and the sidewalk immediately below and shall not occupy more than two-thirds the width of the sidewalk, measured from the building, except that when such awning or marquee is twelve feet (12') in the clear above the sidewalk immediately below, it may extend the full width of the sidewalk for a distance of not more than fifteen feet (15') along the direction of the length of the street.

4. Every awning or marquee shall be so located as not to interfere with the operation of any exterior standpipes, stairways or exits from the building and such location shall meet with the approval of the Building Inspector.

5. The roof of any such awning or marquee shall be sloped to downspouts which shall conduct any drainage under the sidewalk to the curb.

(e) **Ornaments Over Sidewalks.** Water tables, belt courses, sills, bases, columns, pilasters, capitals or other decorative fea-

Section 4501

tures shall not project more than six inches (6") beyond any lot line.

(f) **Show-Windows Over Sidewalks.** No part of any show-window, store-front or show-case except the sill, as provided in paragraph (e) of this Section, shall project beyond the property line. Doors in Fire Zones No. 1 and 2 shall not project more than one foot (1') beyond the property line bordering a street and shall not project into any alley. Doors in buildings outside of Fire Zones No. 1 and 2 which swing over the street property line shall be maintained normally closed.

(g) **Space Below Sidewalk.** The space below the sidewalk level may be used for any purpose not inconsistent with any other requirements of this or other Ordinances, but the occupation of this space may be revoked by the City at any time, and the owner of the building occupying such space shall be required to pay all costs attendant therewith.

(h) **Projection Into Alleys.** No projection whatsoever shall be allowed in alleys except a curb or buffer block extending not more than nine inches (9") from the face of the building and not more than nine inches (9") above the adjacent alley grade.

PART X

LEGISLATIVE

CHAPTER 46—LEGISLATIVE

Validity

Sec. 4601. If any section, subsection, sentence, clause or phrase of this Ordinance is, for any reason held to be unconstitutional, such decision shall not affect the validity of the remaining portions of this Ordinance. The City Council hereby declares that it would have passed this Ordinance, and each section, subsection, clause or phrase thereof, irrespective of the fact that any one or more sections, subsections, sentences, clauses and phrases be declared unconstitutional.

Appended Documents

Sec. 4602. The specifications, suggested ordinances and regulations which are mentioned by title and date of publication in various parts of this Ordinance are hereby declared to be a part of this Ordinance when not in conflict with a specific statement contained in the body of this Ordinance to the contrary. (See Appendix for list of above mentioned documents.*)

Ordinances Repealed

Sec. 4603. Ordinance No.....and all ordinances amendatory thereto, and all ordinances or parts of ordinances in conflict with this Ordinance are hereby repealed.

Date Effective

Sec. 4604. This Ordinance shall be, and is hereby declared to be in full force and effect, from and after 30 days from its date of final passage and approval.

*Published in book form under title "Specification Documents."

PART XI

SPECIAL SUBJECTS

CHAPTER 47—PLASTERING

Plastering Provisions

Secs. 4701 to 4721, Inclusive. Complete plastering provisions. (See Appendix Chapter 47, page 301.)

CHAPTER 48—FILM STORAGE

Film Storage

Secs. 4801 and 4802. Where it is desired to regulate for film storage complete provisions covering handling and storage of photographic and X-Ray nitrocellulose films may be found in Appendix Chapter 48, page 312.

CHAPTER 49—MECHANICAL REFRIGERATION

Refrigeration

Secs. 4901 to 4903. Where it is desired to regulate the type and installation of mechanical refrigeration complete provisions may be found in Appendix Chapter 49, page 313.

APPENDIX

The Appendix, pages 281-313, contains suggested ordinances covering subjects which may not be desired in all cities, also other pertinent information designed to be of assistance to the Building Inspector.

CHAPTER A8 — REQUIREMENTS FOR GROUP S OCCUPANCIES

Sec. A801. For the purposes of this Code, a Group S occupancy shall be an occupancy regularly used or intended to be used for school purposes, and involving assemblage for instruction, education, recreation, and including administration and accessory service.

**Group S
Occupancies
Defined**

Detached and separate buildings not containing school rooms shall not be a Group S occupancy.

Portions of Group S buildings, both school rooms and administrative rooms, shall be separated from each other and other portions of the building as required in Section 503. Such rooms shall be assigned the use which they most closely resemble in Tables Nos. I and No. II.

See Tables Nos. I and II, Section 503, for all occupancy classifications and separations.

Sec. A802. (a) General. Buildings classed in Group S shall be one of the "Types of Construction" and shall not exceed the number of stories shown in Table No. I of this Chapter. The floor area in any story of any such building shall not exceed that permitted for the corresponding type of construction and story shown in the table. The seating capacity in any one room shall not exceed that permitted for the corresponding type of construction.

**Construction
Height and
Area
Allowable**

A yard which is thirty feet (30') or more in width adjacent to property lines and to other buildings on the same property, and which is a clear access to a street, may be considered a street for the purposes of this Chapter.

Exceptions:

1. When a building of Type IV or V construction is provided with certain fire-resistive protection, as specified in Subsections (c) or (d) of this Section, permissible gross floor areas and height may be increased as indicated.

2. The provisions of Section 1813 shall not apply to openings in buildings not more than three stories high when such openings are not less than twenty feet (20') from adjacent property lines and not less than twenty feet (20') from buildings on the same property.

(b) **Special Provisions.** All Group S buildings more than two stories in height shall comply with all of the provisions for Type I buildings except for the partitions which may be of not less than one-hour fire-resistive construction.

TABLE NO. I—TYPES OF CONSTRUCTION, NUMBER OF STORIES AND FLOOR AREAS PERMITTED FOR GROUP S OCCUPANCIES

Types of Construction	Number of Stories	Max. Capacity in any 1 room	Max. Area any 1 room	Max. Floor Area of Story (indicated in sq. ft.) When Building Fronts on			
				1 Street	2 Streets	3 Streets	4 Streets
Type I	Over 1st	500	NO RESTRICTIONS				
	1st Story		NO RESTRICTIONS				
Type II	2nd Story***	100	Use Capacity Unit	12,000	15,000	18,000	21,000
	1st Story***	2000	15,000	24,000	30,000	36,000	42,000
Type III	2nd Story ^b	100	Use Capacity Unit	12,000	15,000	18,000	21,000
	1st Story**	750	5,250	12,000	15,000	18,000	21,000
Type IV	2nd Story***	100	Use Capacity Unit	12,000	15,000	18,000	21,000
Special ^c	1st Story**	1500	10,500	24,000	30,000	36,000	42,000
Type IV	1 Story***	750	5,250	12,000	15,000	18,000	21,000
Type V	2nd Story ^a	100	Use Capacity Unit	12,000	15,000	18,000	21,000
Special ^d	1st Story ^a	1500	10,500	24,000	30,000	36,000	42,000
Type V	1 Story***	750	5,250	12,000	15,000	18,000	21,000

**100% increase allowed for one-hour fire-protection.

^bMust be one-hour fire-protected throughout to permit 2nd story.

***100% increase allowed for sprinkler system, room capacity remaining the same.

• 50% increase allowed for sprinkler system, room capacity remaining the same.

• 25% increase allowed for sprinkler system, room capacity remaining the same.

^c see Sec. A802 (c).

^d see Sec. A802 (d).

For the purposes of this Section, the second story area restriction shall apply only to that portion of the building which is

Section A802

The enclosing walls, including the proscenium wall, of working stages as defined in this Chapter shall be separated from all other portions of the building by a two-hour incombustible construction.

School rooms having a capacity of more than 100 shall not be located above the first story above grade except in buildings of Type I construction.

In all Group S buildings, working stages as defined in this Section shall comply with all the provisions of Chapter 39, except as otherwise provided in this Chapter.

A PLATFORM shall be a raised portion of an assembly room which is not cut off from the audience section by a proscenium wall or arch projecting more than twelve inches (12"). (It is proposed to exempt Group S platforms from the first paragraph of Section 3906.)

A DEAD HUNG STAGE shall be a raised portion of an assembly hall which is cut off from the audience section by a proscenium wall and which does not have a sufficient height above the proscenium arch to allow curtains or drops to be lifted so that their lower edges are higher than one-half the height of the proscenium opening.

A WORKING STAGE shall be a raised portion of an assembly hall which is cut off from the audience section by a proscenium arch to allow curtains or drops to be lifted so that their lower edges are higher than one-half the height of the proscenium opening.

A proscenium curtain as provided in Chapter 41 shall be required on a working stage.

All curtains, drops and drapes in Group S buildings shall be flame-proofed as provided in Section 3809. (See Appendix.)

Balconies shall be constructed as required for floors and shall be of not less than one-hour fire-resistive construction. This shall not apply to balconies in a school gymnasium; provided, that there is not a stage in the gymnasium, that the seating capacity of each such balcony does not exceed 300 persons, and that there are not more than two such balconies in any gymnasium.

(c) **Special Type IV Construction.** For the purposes of this Chapter, Special Type IV construction shall be restricted to buildings two stories or less in height, and shall be Type IV construction with the following restrictions:

Exterior walls and court walls shall be of not less than two-hour fire-resistive construction as specified in Chapter 43.

The structural framework shall be protected with not less than one-hour fire-resistive protection.

All ducts, pipe sleeves and vents shall be fire-stopped.

Floor construction shall be of incombustible materials and shall be of not less than one-hour fire-resistive construction or may be of steel deck type with one-hour fire protection underneath, both as specified in Chapter 43.

Mezzanine floors shall be as required for other floors in the building.

(d) **Special Type V Construction.** For the purposes of this Chapter, Special Type V construction shall be as provided herein,

Sections A802-A804

and shall be restricted to buildings two stories or less in height above the Type I basement ceiling.

The basement or cellar portion of such building and the first floor slab shall be constructed throughout of four-hour fire-resistive construction as specified in Chapter 43 of this code, and there shall be no openings between such basement or cellar portion and the upper superstructure above or adjoining the same, except as provided for ducts and vents in Section A802 (c).

The superstructure, including all exterior walls and the ceiling of the topmost story, shall be constructed throughout with one-hour fire-resistive construction as specified in Chapter 43 of this Code.

When a group of two or more such school buildings employ a single stairway or ramp in common for the required means of egress, such stairway or ramp and the approaches thereto shall be constructed throughout of four-hour fire-resistive construction as specified in Chapter 43 of this Code, and the approaches shall be open on both sides insofar as is structurally practicable; provided, however, that such common stairway shall be proportioned on the basis of its total potential volume of traffic from such buildings.

Buildings of Special Type V construction, as provided in this Chapter, housing Group S Occupancies, may be increased to two stories and may have the areas shown in Table No. I of Section A802 for Special Type V construction.

Where roof trusses and rafters in a Special Type V building are located 14 feet or more above the floor, such members need not be fire-protected.

For gymnasiums, seven-eighths inch ($\frac{7}{8}$ ") tight T & G wall covering may be used in lieu of one-hour fire-protection.

Exit Facilities

Sec. A803. At least one required exit, except for stages, shall open upon a street as defined in this Chapter.

Seating Arrangements and Seats

Sec. A804. For the purpose of this Section:

1. School rooms shall be rooms used for instruction purposes, and shall include such rooms as recitation rooms, lecture rooms, auditoriums, gymnasiums, laboratories, shops, special subject rooms, and any similar rooms.
2. All other rooms in Group S buildings shall be administrative rooms.
3. School rooms shall be classified into five groups with capacity units as follows:
 - (a) Group 1-A shall be lecture rooms, auditoriums and other similar rooms wherein seats are either fixed or movable and the capacity unit therefor shall be seven square feet (7 sq. ft.).
Group 1-B shall be main exercise rooms of gymnasiums and the capacity unit therefor shall be fifteen square feet (15 sq. ft.).
 - (b) Group 2 shall be general class rooms, recreation rooms and other similar rooms and the capacity unit therefor shall be twenty square feet (20 sq. ft.).

Section A804

- (c) Group 3 shall be museums, libraries, laboratories, and other similar rooms not having fixed seats and the capacity unit therefor shall be thirty square feet (30 sq. ft.).
- (d) Group 4 shall be the same as Group 3 but having fixed seats and the capacity unit therefor shall be forty square feet (40 sq. ft.).
- (e) Group 5 shall be all other school rooms such as shops, vocational rooms, and similar rooms, and the capacity unit therefor shall be one hundred square feet (100 sq. ft.).

4. A capacity unit shall be the floor area required per person in a school room.

5. An exit-width unit shall be twenty-two inches (22").

6. Room capacity shall be determined by dividing the superficial floor area of the room in square feet, excluding wardrobes, coat closets, activity alcoves and similar spaces, by the corresponding capacity unit.

7. Total exit width in inches from rooms shall be determined by dividing the room capacity by 100 and multiplying by 22.

8. The basic number of exit-width units required for any corridor, hall, stair or exit door opening therefrom, shall be determined by dividing by 100 the capacity of each school room emptying into such corridor, hall, or stair between exits therefrom, and such individual basic numbers so determined shall be added together as fractions and shall be multiplied by 22.

9. One exit-width unit shall be added to the basic widths for all corridors and halls, provided, however, that no such corridor or hall shall at any point be less than six feet (6') in width, exclusive of rails.

10. A corridor or hall serving additional floors as a required means of egress shall have added to its required width one exit unit.

11. School rooms having required width of exits directly to the exterior need not be considered in determining the capacity of corridors, halls or stairs.

12. Where Group I school rooms other than those designed to be used simultaneously with other school rooms exit into a corridor or hall that serves as a required means of egress from other rooms, the corridor, hall, stairway and exits to the exterior need provide only for the capacity of whichever requires the greater width.

13. Each floor above or below the ground floor shall have not less than two exit stairs, and the required exit width shall be equally divided between such stairs, provided, however, that no stair shall be less than four feet (4') in width at any point, exclusive of rails.

14. Required exit door-openings from corridors, halls or stairs shall be not less than five feet (5') in width and where mullions are used, no single door shall be less than two feet six inches (2'-6") in width.

15. Each school room shall have an exit door located not

Section A804

more than 125 feet distant from the nearest exit to the exterior or enclosed stairway, measured along the line of travel.

16. The width of exit doors opening from combined corridors, halls or stairs shall be not more than one exit-width unit less than the required width of such corridors, halls or stairs.

17. For other requirements refer to the following sections in Chapter 33:

General design	Section 3302
Doors	Section 3304
Railings	Section 3305
Auditorium lighting, signs.....	Section 3306, 3312
Rise and tread.....	Section 3307
Stairway enclosures	Section 3308
Ramps	Section 3309

18. Administrative rooms shall be provided with exit facilities as required in Chapter 33. When such rooms are combined in the same building with school rooms, exit facilities shall be provided either for the administrative rooms or the school rooms, whichever is the most restrictive.

19. There shall be no dead end in any exit, corridor or hall more than ten feet (10') beyond the exit stair or door.

20. Any room, the floor of which is below ground at any point, and which is used by students, either as a school room or for other purposes, shall have at least one exit leading directly to the exterior of the building, and such exit shall be not less in width than one-half the required width of exits from such room, and in no case shall such exit be less than the width provided for in this section.

21. A basement may have a main corridor or hall leading directly to the exterior in lieu of the exterior exit required for each room.

22. A school room shall be any portion of a building completely separated from other portions of a building by fixed or movable walls, partitions or doors, provided such separations extend from the floor to the ceiling or roof immediately above such floor when in place.

23. School rooms, except Group 3 school rooms, having a capacity of more than 100 persons shall have required exits therefrom located on more than one side.

24. All exit doors from school rooms shall be not less than three feet (3') wide.

25. School rooms having a capacity of not more than 50 persons need have only one exit door therefrom.

26. When fixed seats or benches are provided in a school room in excess of the capacities determined otherwise in this section, such capacities shall be used by the Building Inspector for the purposes of this Section.

27. Seating and lighting facilities within and for school rooms of Group 1A, except lecture rooms, shall conform to the provisions of Section 604 (f), (g) and (j) of this code when required by the Building Inspector because of the use or probable use of such rooms.

Section A804

28. The following exceptions shall apply to Group 1A auditoriums having a capacity of 1500 or less:

- (a) Except as required in Section A802, fire-protected doors and windows need not be installed on the exterior of Group S buildings.
- (b) Seats shall not be required to be fixed.
- (c) No foyer shall be required.
- (d) Seating and exit facilities for balconies and galleries shall be provided as required by Section 604 (d).

29. Exterior stairs may be used in lieu of ramps, provided that doors open on a landing not less than eight feet (8') wide.

30. In unusual cases, and where provisions of this section do not specifically define the condition or satisfy the needs presented in the said cases, the Building Inspector shall be guided by the provisions of Chapter 6 in approving the design and arrangement of seating and exit facilities.

31. Exits for platforms, stages and auxiliary rooms shall be provided as follows:

(a) **PLATFORMS.** Any platform of less than 150 square feet (150 sq. ft.) of floor area may have exits only to the main level of the room in which it is located.

(b) **DEAD HUNG STAGES.** Any dead hung stage shall have a minimum classification of a Group 1A school room, and shall have exits as required for such school rooms. Not more than one such required exit shall lead to the main floor level and at least one exit shall lead to a corridor, hall or stair leading to the exterior. In all cases where the superficial floor area of such dead hung stage is in excess of 1,000 square feet (1,000 sq. ft.), there shall be two means of egress other than an exit leading to the main floor level, but one of such means of egress may be through an adjoining school room which in turn opens directly into a corridor, hall or stair.

(c) **WORKING STAGES.** A working stage shall have a minimum classification of a Group 1A school room, and shall have exits as required for such school rooms located on two walls, except that no exit which leads only to the main auditorium floor shall be considered as a required exit. Required exits shall be located on at least two walls and at points relatively remote from each other. Any working stage of over 2,000 square feet (2,000 sq. ft.) of floor area shall have at least one exit located in each of three walls.

(d) **AUXILIARY ROOMS.** On dead hung and working stages, small storage rooms and special equipment rooms not exceeding forty square feet (40 sq. ft.) in area may open only from a stage. All rooms larger than forty square feet (40 sq. ft.), or rooms which are to be used for dressing rooms, costume rooms, workshops, musical instrument practice rooms, green rooms, etc., must be separated from the stage by a corridor or shall have a separate approved means of egress.

All stairs and ramps used in connection with exits from any platform or stage shall conform to the provisions of Chapter 33 and shall have handrails on each side. All required doors from stages shall be swinging doors opening in the direction of egress and shall be equipped with panic hardware permitting of the

Sections A804-A808

opening from within at all times. All exits leading from a working stage shall be only through a Type I, II or III fire-protected door, as provided in Section 4304.

32. Seating and exit facilities for stadiums, bleachers and reviewing stands of Group S Occupancy shall conform to the provisions of Section 1504. (Subject to decision of Conference as to proper location in the code.)

33. No stairs or steps shall be used or placed in any corridor or hall.

Sanitary Facilities

Sec. A805. Toilets shall be provided in approved locations and the number of toilets so provided shall be determined on the basis of one toilet for each 250 persons, or major fraction thereof, based on the capacity of the building, for each sex; provided, however, that there shall be provided at least one toilet for each sex.

Urinals may be substituted for toilets in the case of requirements for males, provided, however, that not to exceed two-thirds of the required number of toilets shall be so replaced, and provided further, that the minimum of one toilet shall not be so replaced.

There shall be provided at least one lavatory for each sex, and there shall be provided one lavatory for each two toilets for each sex, and at least one drinking fountain shall be provided in approved locations on each floor level. Required lavatories shall be located within the toilet rooms.

Enclosure of Vertical Openings

Sec. A806. All vertical openings, such as elevator shafts, stair wells, and vent shafts, which permit the passage of fire or smoke through more than one floor shall be enclosed as specified in Chapter 30 and Chapter 33.

Fire Extinguishing Apparatus

Sec. A807. Automatic sprinklers and standpipes shall be installed as and when specified in Chapter 38, except where an adequate water supply is not available.

Special Hazards

Sec. A808. Chimneys and heating apparatus shall conform to the requirements of Chapter 37.

Every gas service shall be provided with an approved outside shut-off valve conspicuously marked.

Motion picture machine booths shall conform to the requirements of Chapter 40.

Exterior openings in a boiler room or room containing central heating equipment, if located below openings in another story or if less than ten feet (10') from other doors or windows of the same building, shall be provided with one-hour fire-resistive protection as specified in Chapter 43.

Every boiler room or room containing a heating plant which burns liquid or solid fuel shall be separated from the rest of the building with a "Special Occupancy Separation" as specified in Section 503. Every boiler room or room containing a heating plant which burns gas as fuel shall be separated from the rest of the building with not less than an "Ordinary Occupancy Separation" as specified in Section 503. Every such boiler room or room containing a heating plant shall have the door opening directly to the outside of the building.

No flammable liquids shall be placed, stored or used in any Group S Occupancies, except in approved quantities as necessary

Sections A808-A811

in laboratories and approved utility rooms, and such liquids shall be kept in tight or sealed containers when not in actual use.

Sec. A809. Stairways and corridors in Group S buildings shall be not less than one-hour fire-resistive construction as specified in Chapter 43.

**Exceptions
and
Deviations**

All walls, partitions and floors of Group S Occupancies, when more than one story or one story and basement in height, and all walls, bearing partitions and floors shall be of not less than one-hour fire-resistive construction as specified in Chapter 43.

Gymnasiums and similar buildings may have running tracks constructed of wood or unprotected steel or iron.

Any usable space below bleachers in a gymnasium and all janitor closets shall be protected with the fire-resistive equivalent of metal lath and plaster.

Roof covering shall be "Fire Retardant."

Roof trusses, roof girders and beams twenty feet (20') or more above the nearest floor or balcony, elsewhere required to be fire-protected, need not be fire-protected.

No school classroom used for kindergarten, first- or second-grade pupils shall be located above the first story above grade, except in buildings of Type I construction.

Sec. A810. Separation of Group S occupancies from any other occupancies shall be provided as specified in Section 503.

**Mixed
Occupancies**

An arcade connecting buildings and used exclusively as a passageway need not be considered as an adjacent building for the provisions of this Chapter; provided, the walls of the building adjoining the arcade are finished with the same construction as required for the exterior walls of the building with no communicating openings between the arcade and the building, except a door; and provided, the arcade is of not less than one-hour fire-resistive construction or entirely of incombustible materials, or of heavy timber construction with two-inch (2") nominal sheathing.

Sec. A811. Matters not covered in this Chapter shall be governed by the applicable provisions of the remainder of this code as determined by occupancy or type of construction.

NOTE

If the Conference approves Chapter A8, it will be necessary to edit portions of the Uniform Building Code as follows:

Sec. 503—include Group S occupancy in Tables Nos. I and II.

Sec. 1504—decision of Conference as to proper location in Uniform Building Code.

Sec. 1813—add Exception 3:

The provisions of this Section shall not apply to openings in Group S buildings not more than three stories high when such openings are not less than twenty feet (20') from adjacent property lines and not less than twenty feet (20') from buildings on the same property.

Sec. 3906—exempt Group S platforms from first paragraph.

Sections 802(e) and 2204

Reviewing Stands

Refer to Sec. 802(e). The following suggestions are given as a guide for the detailed design and construction of reviewing stands.

Every reviewing stand shall be constructed with four-inch by six-inch (4"x6") girders running parallel to the front of such stand, spaced not more than six feet (6') apart, and supported at distances not exceeding six feet (6') apart by posts of not less than four inches by six inches (4"x6"). These posts shall be braced diagonally with one-inch by six-inch (1"x6") bracing, forming a continuous herringbone bracing, the full length of such stand for each vertical six feet (6') of such posts. The girders at the top of the posts shall be braced with braces not less than four inches by four inches (4"x4") at right angles to the joists above the girders. Every post or brace shall be thoroughly secured to a foot plate, which shall be of sound wood not less than two inches by six inches (2"x6") in cross section laid solidly on the ground at right angles to the front of the stand and forming the base for each line of posts. There shall be joists resting on the girders of not less than two inches by eight inches (2"x8") cross section. Such joists shall be spaced not exceeding forty inches (40") apart and two inch (2") plank shall be used for the seats and steps. Braces shall be provided whenever necessary to make a solid, substantial structure, which shall be safe under any possible emergency. All timbers forming the framing shall be thoroughly spiked together. There shall be a level stringer of two inches by six inches (2"x6") cross section at the bottom of each line of posts, parallel to the stand; also a horizontal piece of two inches by six inches (2"x6") cross section the full length of the stand and at right angles to same for every row of posts, and every six feet (6') of vertical height thereof. All timbers used in the construction of reviewing stands shall be sound (no second-hand or broken lumber permitted). Wherever the stand, or a portion thereof, extends over an excavation, the posts shall be extended to the bottom of said excavation and shall be braced with horizontal braces as hereinbefore provided.

Foundations for Type V Buildings

Refer to Section 2204. Minimum foundation requirements shall be as set forth in the Table No. I-A of this Section.

**Table No. I-A—MINIMUM FOUNDATION REQUIREMENTS
FOR TYPE V BUILDINGS**

Number of Stories	Thickness of Foundation Wall in Inches		Width of Footing in Inches	Thickness of Footing in Inches	Depth of Foundation Below Natural Surface of Ground and Finish Grade in Inches
	Concrete	Unit Masonry			
1	6	6	14	6	12
2	8	8	16	6	18
3	10	10	18	6	30

Section 2301

Refer to Sec. 2301.

WEIGHTS OF BUILDING MATERIALS

	Lbs. Per Cu. Ft.
Brick, Pressed	150
Brick, Common	125
Brick, Common, laid $\frac{3}{8}$ " joints.....	120
Brick, Soft, laid $\frac{3}{8}$ " joints.....	100
Cast Iron	450
Cinders, dry, bituminous, in bulk.....	45
Concrete—	
Cinder, structural	110
Stone or gravel.....	144
Concrete Building Tile, 60% solid.....	87
Concrete Building Tile, 55% solid.....	79
Earth—	
Common loam, dry and loose.....	76
Clay and gravel, dry and loose.....	100
Common earth, dry and packed.....	100
Wet mud	120
Glass	157
Granite	170
Gravel, dry	120
Granite Masonry, dressed.....	165
Granite Masonry, rubble.....	155
Limestone Masonry, dressed.....	162
Marble Masonry, dressed.....	170
Mortar, hard, cement.....	135
Mortar, hard, lime.....	105
Slag (blast furnace).....	130
Steel	490
Terra Cotta, filled with brickwork.....	120
Terra Cotta, Dennison interlock tile, laid.....	65
Timber—	
Fir, dry	32
Fir, wet	44
Oak	46
Water, fresh at 60 degrees Fahrenheit.....	62½
Sand, dry	100
Sand, wet	120
	Lbs. Per Sq. Ft.
Ceilings—	
Wood, lath and plaster.....	8
Metal lath and plaster suspended.....	10
Partitions—	
2"x4" studs, wood lath, $\frac{5}{8}$ " plaster, both sides.....	16
2"x4" studs, plaster board, $\frac{5}{8}$ " plaster, both sides.....	16
Channel studs, metal lath, cement plaster, solid 2" thick.....	20
Plaster on hollow clay tile (one side).....	5
2" Hollow Clay Tile.....	13
3" Hollow Clay Tile.....	16
4" Hollow Clay Tile.....	18
5" Hollow Clay Tile.....	20

Sections 2311-2312

	Lbs. Per Sq. Ft.
6" Hollow Clay Tile.....	25
8" Hollow Clay Tile.....	30
12" Hollow Clay Tile.....	45
Plaster on plaster block partitions (one side).....	5
2" Plaster Blocks.....	7
2½" Plaster Blocks.....	8.5
3" Plaster Blocks.....	9.5
3½" Plaster Blocks.....	10.5
4" Plaster Blocks.....	12
5" Plaster Blocks.....	15
6" Plaster Blocks.....	18
8" Plaster Blocks.....	22

Roofings—

Wood shingles.....	3
Slate ⅞".....	7
Slate ¾".....	10
Tile and clay shingles.....	11 to 14
Roman tile, clay.....	12
Spanish tile, clay.....	19
Ludowici tile, Spanish.....	10
Tile roof laid in mortar, add.....	10
Copper (if no weight is specified).....	1½
Tin.....	1
Corrugated iron.....	2
Tar and gravel.....	6
Prepared composition.....	1
Skylights, metal covered, wire glass.....	5

Refer to Sec. 2312. The following provisions are suggested for inclusion in the Code by cities located within an area subject to earthquake shocks. The design of buildings for earthquake shocks is a moot question but the following provisions will provide adequate additional strength when applied in the design of buildings or structures.

Lateral
Bracing

Sec. 2312. (a) General. Every building or structure and every portion thereof, except Type V buildings of Group I occupancy which are less than twenty-five feet (25') in height, and minor accessory buildings, shall be designed and constructed to resist stresses produced by lateral forces as provided in this Section. Stresses shall be calculated as the effect of a force applied horizontally at each floor or roof level above the foundation. Such force shall be proportional to the total dead plus one-half the vertical design live load, except for warehouses and tanks, in which case such force shall be proportional to the total dead plus the total vertical designed live load. The force shall be assumed to come from any horizontal direction.

All bracing systems both horizontal and vertical shall transmit all forces to the resisting members and shall be of sufficient extent and detail to resist the horizontal forces provided for in this section and shall be located symmetrically about the center

TABLE No. II (a)—HORIZONTAL FORCE FACTORS

<i>Part or Portion</i>	<i>Value of "C"*</i>	<i>Direction of Force</i>
The structure as a whole and every portion not itemized in this table**	.02 on soil, over 2000 lbs. .04 on soil up to 2000 lbs.	Any direction horizontally
Bearing walls, non-bearing walls, partitions, curtain walls, enclosure walls, panel walls	.05	Normal to surface of wall
Cantilever parapet and other cantilever walls, except retaining walls	.25	Normal to surface of wall
Exterior and interior ornamentations and appendages	.25	Any direction horizontally
Towers, tanks, towers and tanks plus contents, chimneys, smokestacks, and penthouses when connected to or a part of a building	.05	Any direction horizontally

*See map on page 294 for zones. The values given "C" are minimum and should be adopted in locations not subject to frequent seismic disturbances as shown in Zone 1. For locations in Zone 2, "C" should be doubled. For locations in Zone 3, "C" should be multiplied by four.

**Where wind load as set forth in Section 2307 would produce higher stresses, this load should be used in lieu of the factor shown.

of mass of the building or the building shall be designed for the resulting rotational forces about the vertical axis.

Junctures between distinct parts of buildings, such as wings which extend more than twenty feet (20') from the main portion of the building, shall be designed at the juncture with other parts of the building for rotational forces, or the juncture may be made by means of sliding fragile joints having a minimum width of not less than eight inches (8"). The details of such joints shall be made satisfactory to the Building Inspector.

(b) **Horizontal Force Formula.** In determining the horizontal force to be resisted, the following formula shall be used:

$$F = CW$$


where "F" equals the horizontal force in pounds.

"W" equals the total dead load plus one-half the total vertical designed live load,

at and above the point of elevation under consideration, except for warehouses and tanks, in which case "W" shall equal the total dead load plus the total vertical designed live load at and above the point or elevation under consideration. Machinery or other fixed concentrated loads shall be considered as part of the dead load.

"C" equals a numerical constant as shown in Table No. II-A.

Section 2312

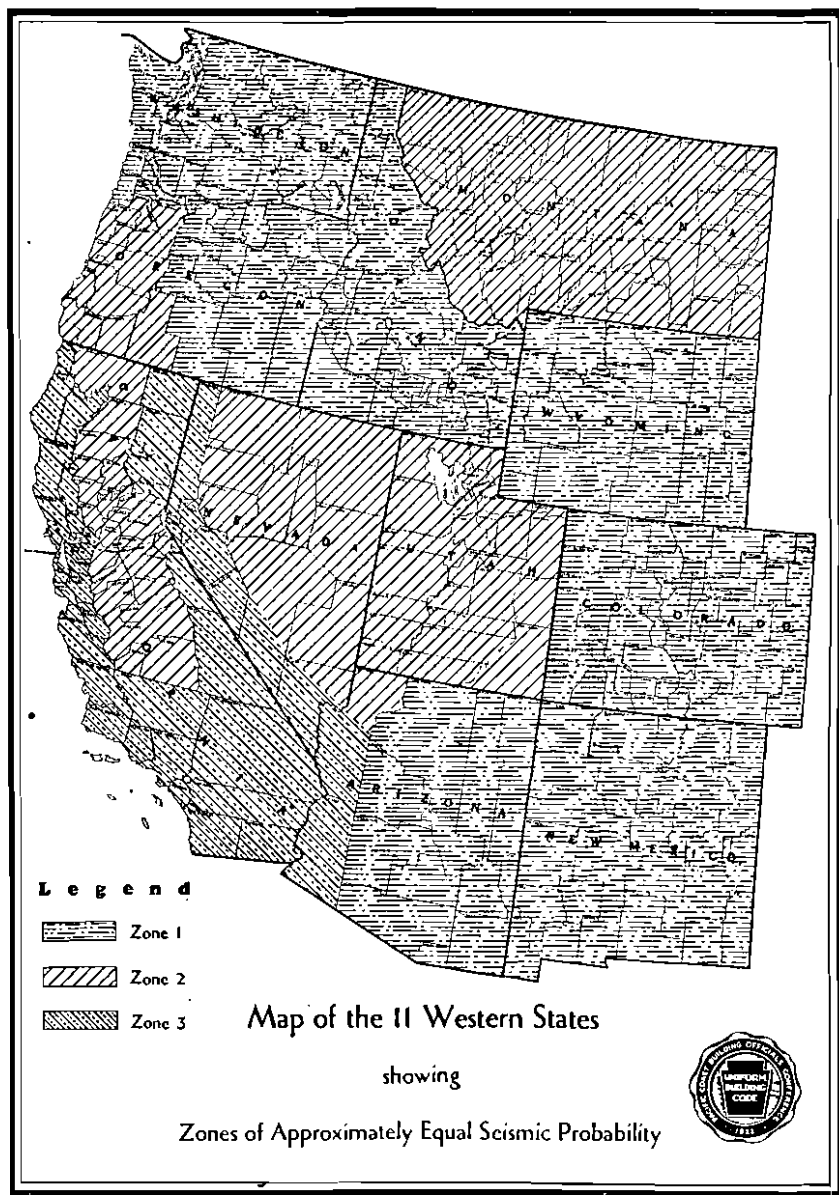

Section 2312

(c) **Foundation Ties.** In the design of buildings of Types I, II and III, where the foundations rest on piles or on soil having a safe bearing value of less than 2,000 pounds per square foot, the foundations shall be completely inter-connected in two directions approximately at right angles to each other. Each such inter-connecting member shall be capable of transmitting by both tension and compression at least 10 per cent of the total vertical load carried by the heavier only of the footings or foundations connected. The minimum gross size of each such member if of reinforced concrete shall be twelve inches by twelve inches (12"x12") and shall be reinforced with not less than the minimum reinforcement specified in Section 2620. If the inter-connecting members are of structural steel, they shall be designed as provided in Section 2702, and encased in concrete. A reinforced concrete slab may be used in lieu of inter-connecting tie members, providing the slab thickness is not less than one forty-eighth of the clear distance between the connected foundations; also providing the thickness is not less than six inches (6").

**Lateral
Bracing
(Con't.)**

Inter-connecting slabs shall be reinforced with not less than eleven-hundredths square inch (.11 sq. in.) of steel per foot of slab in a longitudinal direction and the same amount of steel in a transverse direction. The bottom of such slab shall not be more than twelve inches (12") above the tops of at least 80 per cent of the piers or foundations. The footings and foundations shall be tied to the slab in such a manner as to be restrained in all horizontal directions.

(d) **Plans and Design Data.** With each set of plans filed, a brief statement of the following items shall be included:

1. A summation of the dead and live load of the building, floor by floor, which was used in figuring the shears for which the building is designed.
2. A brief description of the bracing system used, the manner in which the designer expects such system to act, and a clear statement of any assumptions used. Assumption as to location of all points of counter-flexure in members must be stated.
3. Sample calculation of a typical bent or equivalent.

(e) **Stresses.** Stresses in materials shall not exceed by more than 33½ per cent the allowable working stresses permitted in this Code, except that rivets may be stressed the same in tension as is allowed in shear. The allowable shear in reinforced concrete walls, six inches (6") or more in thickness, shall not exceed five one-hundredths of the ultimate compressive strength of the concrete.

(f) **Detailed Requirements.** 1. **Bonding and Tying.** Cornices and ornamental details shall be bonded in the structure so as to form an integral part of it. This applies to the interior as well as to the exterior of the building.

2. **Overturning Moment.** In no case shall the overturning moment of any building and/or structure due to the forces pro-

Sections 2912 and 2410

Lateral Bracing (Con't.)

vided for in this Section exceed 50 per cent of the moment of stability of such building and/or structure.

3. Additions. Every addition to an existing building and/or structure shall be designed and constructed to resist and withstand the forces provided for in this Section, and in any case where an existing building and/or structure is increased in height all portions thereof affected by such increased height shall be reconstructed to resist and withstand the forces provided for in this Section.

4. Alterations. No existing building and/or structure shall be altered and/or reconstructed in such a manner that the resistance to the forces provided for in this Section will be less than that before such alteration and/or reconstruction was made; provided, however, that this provision shall not apply to non-bearing partitions, and shall not apply to other minor alterations which are made in a manner satisfactory to the Building Department.

(g) Lime Mortars. Lime mortars shall not be used in any unit masonry construction forming a part of a building.

(h) Veneer Tiles. Veneer ties provided in Section 2936 shall be of sufficient strength to support the full weight of the veneer in tension.

(1) Intention or Interpretation of Lateral Force Provisions.

These lateral force requirements are intended to make buildings earthquake-resistive. The provisions of this Section apply to the buildings as a unit and also to all parts thereof, including the structural frame or walls, floor and roof systems, and other structural features.

The provisions incorporated in this Section are general and, in specific cases, may be interpreted and/or added to as to detail by rulings of the Building Inspector in order that the intent shall be fulfilled.

Refer to Sec. 2410. Mortar composed of cement, lime putty or hydrated lime and sand having proportions intermediate to those specified in Section 2410 may be used in place of lime-cement mortar, provided the ratio, by volume, of the sand and cementitious material does not exceed three to one. The allowable working stress for such mortar shall be determined by the following formula:

$$P_m = P_1 + \frac{(C - L)}{(C + L)} (P_c - P_1)$$

P_m = Maximum allowable unit working stress for the mortar used.

P_1 = Maximum allowable unit working stress for lime-cement mortar.

C = Number of parts (by volume) of cement in mortar used.

L = Number of parts (by volume) of lime in mortar used.

P_c = Maximum allowable unit working stress for cement mortar.

The proportions shall be based strictly according to the volume of the constituent parts.

Section 2529

Refer to Sec. 2529. The following provisions are recommended for inclusion in the code in the territories where foundation timber is subject to special hazard of decay and termite damage.

ORDINANCE ON CONSTRUCTION PRACTICES

1. Before any new building is erected all stumps and roots shall be removed from the soil to a depth of at least twelve inches (12") below the surface of the ground in the area to be occupied by the building. **Construction Practices**

2. The exterior walls of, and all wood posts supporting girders in wood frame buildings over four hundred square feet (400 sq. ft.) in area shall be placed on masonry or concrete foundation walls or piers.

3. All masonry for foundation purposes shall be laid in portland cement mortar. Portland cement mortar shall be composed of one part of cement and three parts of sand by volume with an allowable addition of lime putty or hydrated lime of not more than 15 per cent by volume of the cement content.

4. The top of every masonry or concrete foundation wall or pier which supports and is in contact with wood construction of any kind shall be not less than six inches (6") above the final grade level or finished surface of any ground adjacent thereto (except as provided in the case of slabs). Masonry or concrete foundation walls shall in all cases extend at least as high as the top of any adjacent concrete or masonry slab which is supported by either natural ground or an earth fill.

5. Floor joists shall have a clearance of not less than eighteen inches (18") between the bottom of the joists and the surface of the ground underneath. The ground underneath floor joists shall be leveled or smoothed off so as to maintain a reasonably even surface under the entire area covered by the floor joists.

6. All wood sills, including mudsills and sole plates, which are placed directly on the ground or on masonry or concrete foundations, shall be of the grade and kind of lumber specified in paragraph No. (9).

7. Wood sleepers or similar floor supports when placed directly on masonry or concrete which is in contact with the ground shall be of the grade and kind of lumber specified in paragraph No. (9).

8. All wood members used to support permanently a load of any kind, in buildings over four hundred square feet (400 sq. ft.) in area, shall be of the grade and kind of lumber specified in paragraph (9) when any part of such member is placed within eighteen inches (18") of any earth, either natural ground or earth fill.

9. Lumber permitted in the above locations shall be either an approved grade of cedar, cypress or redwood or any species of wood if treated under pressure with an approved preservative. Such treated lumber shall show a penetration of an approved preservative of not less than one-quarter inch ($\frac{1}{4}$ ") at any point.

Sections 2529, 3809, and 4602

Under item 9, "Ordinance on Construction Practices," change the second paragraph to read as follows:

Redwood where used in such locations shall be of Foundation Grade as defined in the Standard Grading and Dressing Rules of the California Redwood Association (1940).

10. Wood posts or columns shall not extend through or be placed directly on concrete floors. They shall be supported on concrete footings extending at least two inches (2") above the finished floor or may be placed on a corrosion-resisting metal plate at least one-sixteenth inch ($\frac{1}{16}$ ") thick and not smaller than the base of the post or column. Such plate may be flush with the concrete floor.

11. Where timbers extend into a masonry wall at a point below the level of the ground outside of the wall, metal wall boxes shall be provided or the end and all surfaces of the timber within one foot (1') of the end shall be painted with at least two coats of hot coal tar creosote or other approved wood preservative.

12. Openings through foundation walls or exterior walls shall be provided for cross ventilation of the space below the first floor in every building in which the first floor is of wood frame construction, and shall have a total area as required in Section 2527.

13. All wood forms which have been used in placing concrete, if within the ground or less than eighteen inches (18") above the ground, shall be removed before a building is occupied or used for any purpose.

14. Loose or casual wood shall not be stored in direct contact with the ground under any building.

Refer to Section 3809.

All combustible materials, fabrics and woodwork used as draperies or scenery on a stage, and all draperies in the assembly portion of Group A, B, or C, Division 1 and 2 occupancies shall be made flame-proof to such an extent that when contacted by a Bunsen burner or gas flame they shall not show signs of fire, glow or smoldering nor will they communicate flame. The materials to be made flame-proof shall be impregnated and shall not be sprayed.

Where the flame-proofing process may change the color, finish or sheen of the drapery fabric, special permission shall be secured from the Building Inspector to attach a lining which has been made flame-proof.

Note: This special permission is not recommended and should be given only where the flame-proofing will greatly impair the draperies.

Refer to Sec. 4602. The following list includes all of the documents included in the Uniform Building Code, classified by subject.

Standard Specifications and Tests for High Early Strength Portland Cement, A.S.T.M. Designation C74-39. (See Section 2604).

Cement

Standard Specifications for Portland Cement, A.S.T.M. Designation C9-38. (See Sections 2410, 2604 and 4711).

Standard Specifications for Ready Mixed Concrete, A.S.T.M. Designation C94-38. (See Sections 2607 and 2609.)

Standard Specifications for Concrete Aggregates, A. S. T. M. Designation C33-39. (See Section 2604.)

Aggregates

Standard Specifications for Lightweight Aggregates for Concrete, A. S. T. M. Designation C130-39. (See Section 2604).

Standard Method of Test, Organic Impurities in Sands for Concrete, A. S. T. M. Designation C40-33. (See Section 4707.)

Standard Specifications for Billet-Steel Concrete Reinforcement Bars of Structural, Intermediate or Hard Grade Steel, A. S. T. M. Designation A15-39. (See Section 2604.)

Reinforcing Steel

Standard Specifications for Cold-Drawn Steel Wire for Concrete Reinforcement, A. S. T. M. Designation A82-34. (See Section 2604).

Standard Specifications for Rail Steel Concrete Reinforcement Bars, A. S. T. M. Designation A16-35. (See Section 2604).

Standard Methods of Making Compression Tests of Concrete, A. S. T. M. Designation C39-39. (See Section 2613.)

Concrete

Standard Methods of Making and Storing Specimens of Concrete in the Field, A. S. T. M. Designation C31-39. (See Sections 2605 and 2613).

Standard Specifications for Gypsum and Calcined Gypsum, A. S. T. M. Designation C22-25. (See Section 2409).

Gypsum

Standard Specifications for Gypsum Partition Tile or Block, A. S. T. M. Designation C52-33. (See Section 2409.)

Gypsum Tile

Standard Specification for Keene's Cement, A. S. T. M. Designation C61-30 and C26-39. (See Section 4710.)

Keene's Cement

Standard Specifications for Concrete Building Brick, A. S. T. M. Designation C55-37. (See Section 2404).

Masonry

Tentative Specifications for Building Brick, A. S. T. M. Designation C62-39T of the American Society for Testing Materials. (See Section 2402).

Standard Specifications for Sand Lime Building Brick, A. S. T. M. Designation C73-39 of the American Society for Testing Materials. (See Section 2403).

Tentative Specifications for Load Bearing Concrete Masonry Units, A. S. T. M. Designation C90-39 of the American Society for Testing Materials. (See Section 2406).

Standard Specifications and Tests, Hollow Burned-Clay Load-Bearing Wall Tile, A. S. T. M. Designation C34-39. (See Section 2405).

Tile

Section 4602

Underwriters' Laboratories Standard Concrete Masonry Units, November, 1938. (See Section 2406).

Standard Specifications for Structural Clay Non Load Bearing Tile, A. S. T. M. Designation C56-39. (See Section 2405).

Cast Stone

Tentative Specifications for Cast Stone, Serial Designation P-3-29T of the American Concrete Institute. (See Section 2408).

Lime

Standard Specifications for Hydrated Lime for Structural Purposes, A. S. T. M. Designation C6-31. (See Sections 2410 and 4708).

Standard Specifications, Quicklime for Structural Purposes, A. S. T. M. Designation C5-26. (See Sections 2410 and 4708).

Welding

American Welding Society Bulletin Code, Edition of 1937. (See Section 2710).

Standard Specification for Seamless Steel Pipe, A. S. T. M. Designation A53-36. (See Section 2701).

Steel

Standard Specifications for Carbon-Steel Castings, A. S. T. M. Designation A27-39. (See Section 2701).

Standard Specifications for Structural Steel for Bridges and Buildings, A. S. T. M. Designation A7-39. (See Section 2701).

Iron

Standard Specifications for Gray Iron Castings, A. S. T. M. Designation A48-36. (See Section 2701).

Wood

Wood Handbook, U. S. Department of Agriculture, September, 1935. (See Section 2503).

Wood Shingles, Commercial Standard CS31-38 (Red Cedar, Tidewater Red Cypress, California Redwood). [See Section 4305 (d)].

Douglas Fir Plywood, Commercial Standard 45-38. [See Section 2503 (d)].

U. S. Department of Agriculture, Miscellaneous Publication No. 185. (See Section 2503).

Fire Resistive Standards

Building Code of the National Board of Fire Underwriters, Appendix P, Fifth Edition Revised 1934. (See Section 4102).

Standard Specifications for Fire Tests of Building Construction and Materials, A. S. T. M. Designation C19-33. (See Section 4201).

Regulations of the National Board of Fire Underwriters for the Protection of Openings in Walls and Partitions Against Fire, Recommended by the National Fire Protection Association, Edition of January, 1939. (See Section 4304).

Schedule for Rating Motion Picture Plants and Film Vault Buildings, Board of Fire Underwriters of the Pacific Revision of November 12, 1931. (See Section 4102).

Underwriters' Standards for Tin-Clad Fire Doors and Shutters, Edition of July, 1937. (See Section 4304).

Sprinkler Equipment

Regulations of the N. B. F. U., recommended by the National Fire Protection Association for the Installation of Sprinkler Equipment, Edition of 1936, with Amendments of September, 1937. (See Section 3802).

Storage of Flammable Liquids

Suggested Fire Prevention Ordinance, Edition of 1933, recommended by the National Board of Fire Underwriters.

Sections 4802 and 4701

A Standard Ordinance providing minimum requirements for proper and safe construction of chimneys, flues, and fireplaces, Third Edition, Revised 1927. (See Section 3701).

Specifications of the Underwriters' Laboratories, Inc., for Class "C" Roof Coverings, December 15, 1938. (See Section 4305 [b and d]).

Tentative Methods of Testing Felted and Woven Fabrics Saturated With Bituminous Substances For Use in Waterproofing and Roofing, A. S. T. M. Designation D146-38T. [See Section 4305(c)].

Regulations for the Construction and Installation of Oil Burning Equipment and Storage and Use of Oil Fuels in connection therewith, Recommended by the National Fire Protection Association, Edition of 1934, with Amendments 1936. (See Section 3713).

Regulations for the Storage and Handling of Photographic and X-Ray Nitro-Cellulose Films, recommended by the National Fire Protection Association, Edition of August 15, 1931, amended September 15, 1936. (See Sections 4802 and 4803).

Regulations of the National Board of Fire Underwriters for Nitrocellulose Motion Picture Film, Edition of August 15, 1931, amended July 15, 1939.

Safety Code for Mechanical Refrigeration, published by the American Society of Refrigerating Engineers. Approved by the American Standards Association, April, 1939. (See Section 4901).

Refer to Chapter 47. The following provisions are recommended for inclusion in the Code where complete plastering provisions are desired.

CHAPTER 47—PLASTERING—INTERIOR AND EXTERIOR

Sec. 4701. It shall be unlawful for any person to do or cause to be done any lathing or plastering, or any alteration of lathing or plastering in or upon any building or structure unless such lathing or plastering is done in the manner and of the materials hereafter specified in this Chapter, and in addition thereto, whenever plastering is required for fire protection it shall also comply with the provisions of Chapters 42 and 43.

The Building Inspector, upon notification from the permit holder or his agent, shall make the following inspections of lathing and plastering and shall either approve that portion of the construction as completed or shall notify the permit holder or his agent wherein the same fails to comply with the law:

1. After all lathing, interior and exterior, is in place and all plastering materials are on the job.
2. Seven to 10 days after exterior walls have received second coat of stucco. The exact time of the second inspection shall be at the discretion of the Building Inspector.
3. Final inspection of finished interior and exterior plastering.

The Building Inspector or his deputy is hereby authorized to make or cause to be made tests of plastering materials or lathing, and may require a complete analysis of samples of completed plastering or stucco. In case of dispute as to the thickness of the plastering, authority is given the Building

Chimneys**Roof
Coverings****Oil Burning
Equipment****Films****Refrig-
eration****General****Tests**

Sections 4701-4703

Inspector or his deputy to make holes in the wall for the purpose of determining the thickness of the plaster. Such holes are not to be made unless it is necessary and are to be made only in the presence of the plastering contractor or the permit holder.

Wood Lath

Sec. 4702. Wood lath shall be equal to No. 1 grade Douglas fir, spruce, cedar, redwood, pine or western hemlock, and shall be reasonably clear, evenly manufactured and free from detrimental defects. A few wormholes, small pitch pockets, well set or firm knots not more than three-fourths inch ($\frac{3}{4}$ ") in diameter and not bunched, and wane not more than one-third the thickness, width or length and not in combination with any other defect shall be permitted in wood lath. Wood lath shall measure not less than five-sixteenths inch ($\frac{5}{16}$ ") nor more than three-eighths inch ($\frac{3}{8}$ ") in thickness, not less than one and three-eighths inches ($1\frac{3}{8}$ ") nor more than one and five-eighths inches ($1\frac{5}{8}$ ") in width, and not more than one-fourth inch ($\frac{1}{4}$ ") less than four feet (4') in length. Each lath shall be nailed with 3d fine blue nails to a stud, joist or other support at each end thereof and at points not more than sixteen inches (16") apart along the length of such lath. Nails shall be driven full length. For lime plaster laths shall be spaced not less than three-eighths inch ($\frac{3}{8}$ ") and not more than one-half inch ($\frac{1}{2}$ ") apart, and for gypsum plaster not less than one-quarter inch ($\frac{1}{4}$ ") and not more than three-eighths inch ($\frac{3}{8}$ ") apart. Joints at the ends of laths shall be broken at least every eighth lath and not less than six laths shall constitute a break. Studs, joists, or other supports for lathing shall be spaced at not to exceed sixteen inches (16") on center. No vertical or diagonal lathing or crooked or warped lath shall be used.

Approximately eight hours before being nailed in place wood lath shall be thoroughly soaked and kept damp until plaster is applied thereto.

It shall be unlawful to apply any interior wood lath until all exterior framing has been covered. All coves, bull noses and interior angles shall receive a strip of metal reinforcement before any plastering is applied. A strip of metal reinforcement shall also be used where masonry and wood join.

Gypsum Plaster Lath

Sec. 4703. Wherever plaster lath is used it shall be composed of gypsum, wood and manila fiber, or of other similar materials, provided, that not less than 85 per cent by weight of such composition shall be of incombustible material.

Such plaster lath shall be not less than five-sixteenths inch ($\frac{5}{16}$ ") in thickness and shall be spaced one-quarter inch ($\frac{1}{4}$ ") apart horizontally and vertically and each joint broken. Such lath shall be not less than three-eighths inch ($\frac{3}{8}$ ") thick when used as required in Section 4302.

On wood joists, furring strips, studding or other wood supports the plaster lath shall be securely fastened by means of nails of sufficient length to extend at least three-fourths inch ($\frac{3}{4}$ ") into the joists, furring strips, studding or other supports. Such nails shall be spaced or driven not more than four inches (4") apart in one direction and sixteen inches (16") apart in the opposite direction. Where the furring strips, studs or other supports are of metal the plaster lath shall be securely fastened

Sections 4703-4705

to the same with galvanized iron wire of not less than No. 16 W. & M. gauge or with No. 20 U. S. gauge metal clips spaced the same as required for nails. All wire nails used for fastening plaster lath shall be at least No. 13 W. & M. gauge with flat heads not less than three-eighths inch ($\frac{3}{8}$ ") in diameter.

It shall be unlawful to apply any interior plaster lath until all exterior framing has been covered. All coves, bull noses and interior angles shall receive a strip of metal reinforcement before any plastering is applied. A strip of metal reinforcement shall also be used where masonry and plaster lath join.

Sec. 4704. Any fiber board lath or other similar board lath which is equivalent to plaster board lath in strength, durability and bond may be used as a base for backing for plastering provided the type of such board lath shall have first been approved by the Building Inspector and all such board lath shall conform strictly to the type so approved.

**Fiber
Board
Lath**

Such approved board lath may be used wherever wood lath is permitted but shall not be used in substitution for plaster board lath or metal lath wherever such plaster board lath or metal lath are specifically required.

When fiber board lath is used it shall be applied in conformity with the provisions of Section 4703 for plaster board lath.

Sec. 4705 (a) Interior Metal Lath. Interior metal lath shall be either ingot iron, rust-resisting alloy, galvanized or coated with an approved preservative material. Metal lath used on walls and ceilings shall be of a weight not less than that shown in the following table:

**Metal
Lath**

Spacing of Supports	Weight per square yard in pounds	
	For Walls	For Ceilings
12"	2.5	2.75
16"	2.75	3.4

Metal lath shall be lapped at least one inch (1") and shall be tied at joints in at least one place between supports. The tie wire used to attach and tie metal lath shall be not less than No. 18 W. & M. gauge. Metal lath shall be secured to wood studs with not less than 4d wire nails driven to at least seven-eighths inch ($\frac{7}{8}$ ") penetration and the remaining portion of the nail bent up to engage at least one strand of fabric and must be bent in such a manner as to not break the strands.

Metal lath when applied to metal supports shall be fastened thereto with not smaller than No. 18 W. & M. gauge galvanized annealed wire or by metal clips of equivalent strength.

(b) Exterior Metal Lath. Exterior metal lath shall weigh not less than three and four-tenths pounds per square yard, and shall be galvanized, rust-resisting alloy, ingot iron or double coated with an approved preservative material. Such dip shall be alkali-resisting and shall be lime and acid proof. Metal lath shall be lapped not less than one inch (1") at each joint and shall be kept not less than one-quarter inch ($\frac{1}{4}$ ") away from all

Sections 4705-4706

backing and supports by galvanized or blued furring nails, galvanized metal furring clips or other equivalent means of furring; provided, that when self-furring metal lath is used such furring nails, clips or other equivalent means of furring shall not be required. All metal shall be held in place by means of galvanized or blued nails not smaller than 4d in size or by means of galvanized staples not less than one inch (1") in length made of not smaller than No. 14 W. & M. gauge wire, or by any other approved method of equivalent strength.

Nails for holding metal lath in place shall be driven to approximately three-fourths penetration and bent over one or more strands or their equivalent of such metal lath. Staples, furring nails, furring clips, or other methods of fastening metal lath shall develop a strength equivalent to the nails hereinbefore specified in this Section. No fastening of any kind for metal lath shall be cracked, broken or otherwise defective.

Metal lath shall be nailed or stapled to wood studs, joists or other supports or tied to metal supports at points not to exceed six inches (6") on center along such studs, joists or other supports.

**Suspended
Ceilings**

Sec. 4706. Each suspended ceiling and each portion thereof shall be constructed and supported as hereinafter in this Section provided.

The main runners or other supports for any suspended ceiling shall consist of steel channels, steel angles or steel tees, not smaller than one inch (1") in vertical depth when in place and weighing not less than 442 pounds per one thousand lineal feet (1000') or other structural members of equivalent strength.

Main runners or other supports shall be spaced at not more than four feet (4') on centers and shall be supported by galvanized steel wire hangers not smaller than No. 8 W. & M. gauge spaced at not more than four feet (4') on center. Wire hangers shall be securely fastened to the structural framing, masonry or concrete with approved metal clips or approved bolts and nuts, or such wire hangers shall be embedded in such structural framing, masonry or concrete. Wire hangers shall be secured to main runners or other supports by wrapping each wire hanger a full turn around the main runner or other support and twisting the wire hanger together over the top edge of the main runner or other support so as to develop the full strength of the wire.

The under side of such main runners or other supports shall be cross furred with steel channels which shall be not less than three-fourths inch ($\frac{3}{4}$ ") in vertical depth when in place and shall weigh not less than 276 pounds per one thousand lineal feet (1000'), and which shall be spaced at not more than twelve inches (12") on center. Each such three-quarter-inch ($\frac{3}{4}$ ") channel shall be fastened to each main runner or other support directly above same by means of not smaller than No. 16 W. & M. gauge galvanized annealed wire wrapped around both members with a double turn and twisted securely together. Each main runner and cross furring channel shall be straight and true and shall be maintained in that condition until the finished ceiling has been applied. Any metal lath applied to

Sections 4706-4708

such three-quarter-inch ($\frac{3}{4}$ ") channels shall be of the quality and weight and shall be applied in the manner specified in Section 4705 for metal lath applied to metal supports.

Nothing contained in this Section shall be deemed or construed to prohibit the use of any other material or method of construction for any suspended ceiling in the event that such other material or method of construction is the equivalent of the material or method of construction hereinabove specified; and in the further event that such other material or method of construction shall have been first approved by the Building Inspector.

Each suspended ceiling, and each portion thereof, shall be constructed so as to be capable of sustaining a live load of not less than 10 pounds per square foot, in addition to all dead loads, without any deflection, settlement or distortion which will materially affect the strength, durability or safety thereof.

Whenever in the opinion of the Building Inspector any suspended ceiling or any portion thereof is not capable of sustaining such live and dead loads as hereinabove required in this Section, the Building Inspector may require the owner, contractor, subcontractor or other person constructing or causing to be constructed the suspended ceiling or any portion thereof to test or cause to be tested such suspended ceiling, or any portion thereof, with a load test of not less than 20 pounds per square foot, and it shall be unlawful for any such owner, contractor, subcontractor or other person to fail, refuse or neglect to make such load test within the time specified.

The load test hereinabove provided for may also be required on any altered or reconstructed portion of any existing suspended ceiling.

Sec. 4707. All sand used for making plaster for any building or structure shall be clean, sharp, abrasive sand and shall not contain more than three per cent by weight of deleterious matter such as clay, loam and/or silt. In the test for organic matter the sodium hydroxide solution shall not be darker in color than the color indicated in the "Standard Method of Test for Organic Impurities in Sands for Concrete," (A. S. T. M. Designation C40-33)¹ of the American Society for Testing Materials. **Sand**

All the sand shall pass a No. 4 mesh sieve and not more than 80 per cent and not less than 60 per cent shall pass a No. 20 mesh sieve, and not more than 35 per cent and not less than 15 per cent shall pass a No. 40 mesh sieve. All remaining on the No. 4 sieve shall be considered gravel.

The sand shall be of such quality that when mixed in the proportion of one part portland cement to two parts of sand the mortar shall develop a tensile strength of not less than 210 pounds per square inch at the age of 10 days.

Sec. 4708. Lime putty used for making plaster shall be made from fresh quicklime conforming to the "Tentative Specifications for Quicklime for Structural Purposes," (A. S. T. M. Designation C5-26)¹ of the American Society for Testing Materials, or hydrated lime conforming to the "Standard Specifications for **Lime**

¹See "Specification Documents."

Sections 4708-4712

Hydrated Lime for Structural Purposes," (A. S. T. M. Designation C6-31'), of the American Society for Testing Materials.

Quicklime shall be well slaked, run through a No. 16 screen, stored and protected in an approved manner for the time recommended in the manufacturers' specifications.

Plaster Reinforcing

Sec. 4709. Any metal reinforcing material, woven wire netting, expanded metal fabric or welded wire fabric used for exterior stucco or for any interior or exterior plaster reinforcing shall be galvanized or coated with an approved preservative material, which coating shall be alkali-resisting and shall be lime and acid proof. Plaster reinforcing shall be furred and fastened in place in the same manner as required herein for metal lath and shall have a mesh not exceeding two inches (2") in width and four inches (4") in length and each such mesh shall have an area of not more than six square inches (6 sq. in.). Such metal reinforcing material, woven wire netting, expanded metal fabric or welded wire fabric shall weigh not less than one and five-tenths pounds per square yard. When woven wire netting is used it shall be not less than No. 16 W. & M. gauge wire; provided, however, that a wire netting composed of No. 18 W. & M. gauge wire woven with one inch (1") mesh and weighing not less than one and six-tenths pounds (1.6 lbs.) per square yard may be used. All plaster reinforcing covered by this Section shall be lapped not less than two inches (2").

Note: For exterior metal lath see Section 4705.

Keene's Cement

Sec. 4710. Keene's cement shall have a tensile strength of not less than 450 pounds per square inch, seven days in the air and shall conform to the "Standard Specifications for Keene's Cement," (A. S. T. M. Designation C61-30' and C26-39') of the American Society for Testing Materials.

Portland Cement

Sec. 4711. All portland cement used for making plaster shall conform to the "Standard Specifications for Portland Cement" (A. S. T. M. Designation C9-38') of the American Society for Testing Materials. The Building Inspector may require tests of cement used, when in his judgment the cement does not comply with this ordinance.

Water-proof Paper and Metal Flashing

Sec. 4712. In all cases where plastering or stucco is applied to the exterior of a wood frame building such wood frame shall be covered with a substantial waterproof paper as hereinafter described in this Section.

Wherever in this Section waterproof building paper is required, a substantial waterproof building paper which successfully passes a 60-pound Mullen test, shall be used.

Wherever such paper is used it shall be applied so as to shed water readily and care must be exercised in the application of such paper. All corners and returns shall be carefully shingled with such paper and there shall be no holes or breaks in the paper. Horizontal joints shall be lapped not less than two inches (2") and vertical joints not less than six inches (6") beyond the stud on the weather side, except sheet lath, which shall be lapped not less than four inches (4") and such paper shall be

*See "Specification Documents." *

Sections 4712-4713

nailed to the backing with wire nails of not less than No. 11 W. & M. gauge having a flat head of not less than three-eighths inch ($\frac{3}{8}$ ") in diameter. Such paper shall be nailed to the structural backing at points spaced at not more than twelve inches (12") on center vertically and sixteen inches (16") on center horizontally.

Provided, that any reinforced waterproof paper which is reinforced with metal in the process of manufacture, such reinforcement being in accordance with requirements of Section 4709 for plaster reinforcing, shall be lapped not less than two inches (2") horizontally and four inches (4") vertically.

Where sheathing or similar backing is not used No. 18 W. & M. gauge or larger wire stretched taut horizontally across the stud frame at not more than six inches (6") on center vertically shall be securely fastened in place before the paper is applied; provided, that where such paper is fastened to the metal reinforcing in such a manner as not to affect the waterproofing qualities of such paper the wire need not be installed. Where the building is sheathed with wood, fiber board or plaster board sheathing the waterproof paper shall be applied on the outside of such wood, fiber board or plaster board sheathing.

All exterior openings exposed to the weather shall be thoroughly and effectively flashed with metal flashing in such a manner as to make them waterproof. All copings and parapet walls shall be thoroughly flashed with metal in a manner approved by the Building Inspector. Wherever metal flashing is required it shall consist of not less than 16-ounce copper or 26-gauge galvanized iron or lead coated or asphaltum dipped metal not less than 26-gauge, such coating or dipping to be rust-resisting.

Sec. 4713. Except when applied to tile, masonry or concrete, all exterior hand plastering or stucco shall be three coat work and shall be reinforced with metal lath or metal plaster reinforcing as specified in Sections 4705 and 4709.

**Exterior
Hand
Plastering
or
Stucco**

(a) **First Coat.** The first coat shall consist of one part of portland cement to not more than three and one-half parts of sand by volume, to which may be added slaked or hydrated lime or approved brands of diatomaceous silica in an amount not to exceed 10 per cent by volume of cement; provided, that when approved waterproofing materials or compounds are used no hydrated or slaked lime shall be used.

The first coat shall be well forced through all spaces or openings in the metal reinforcing so as to form a good mechanical key and to solidly fill any space between such plaster reinforcing and backing. The first coat shall be thoroughly scored, combed or scratched in two directions at approximately right angles to each other in such a manner as to cause furrows or channels in such first coat, in order to provide a good mechanical bond to receive the second coat of plaster or stucco.

The first coat of plaster shall be kept moist during the first 24 hours after it has been applied so that at the end of the period of wetting the plaster will show a thoroughly set and hard condition. The first coat shall have been applied for at least seven days before second coat is applied thereto.

Sections 4713-4714

Every first coat of exterior plaster or stucco shall have a minimum thickness of not less than three-eighths inch ($\frac{3}{8}$ ") measured from the face of the backing. When plaster is applied to tile, masonry or concrete, such tile, masonry or concrete shall be thoroughly washed and cleaned before any plaster is applied thereto.

(b) **Second Coat.** The second coat of exterior plaster or stucco shall consist of one part of portland cement to not more than three and one-half parts of sand by volume, to which may be added approved waterproofing or fattening compounds as provided for the first coat.

The second coat of plaster shall be applied and rodded and shall be water floated. The second coat shall have a minimum thickness of not less than three-eighths inch ($\frac{3}{8}$ ") measured from the face of the first coat of plaster. This coat must be kept wet as prescribed for the first coat.

The second coat shall stand for at least 10 days before the third coat is applied.

(c) **Third Coat.** The third or finish coat of exterior plaster or stucco shall be composed of any material or materials approved by the Building Inspector and shall have a minimum thickness of not less than one-eighth inch ($\frac{1}{8}$ ") measured from the face of the second coat.

The total thickness of the three coats of stucco shall be not less than seven-eighths inch ($\frac{7}{8}$ ") in any place measured from the backing; provided, that on three story buildings where sheathing is required, such sheathing may be omitted, provided the stucco is not less than one and one-fourth inches ($1\frac{1}{4}$ ") in thickness and provided the reinforcement used shall be expanded metal weighing not less than four and five-tenths pounds per square yard or welded wire fabric weighing not less than four and three-tenths pounds per square yard.

Where corner beads are used on the exterior such corner beads shall be designed as exterior corner beads, shall be the full thickness of the required plaster and shall have metal lath attached thereto forming a cornerite.

(d) **Rodded Wall.** A wall shall be said to be rodded when a five-foot (5') straight edge placed upon the surface of the plaster in any position shall not show more than one-fourth inch ($\frac{1}{4}$ ") variation in the surface of the plaster at any point along the five-foot (5') length of the straight edge. This permissible variation shall not be deemed to affect the thickness of the plaster as required, but such plaster shall be the full required thickness at any point.

Pneumat- ically Placed Stucco

Sec. 4714. Pneumatically placed stucco shall be deemed to be a mixture of portland cement and sand mixed dry, conveyed by air through a pipe or flexible tube hydrated at the nozzle at the end of the conveyor and deposited by air pressure in its place of final repose.

Rebound as applied to pneumatically placed stucco shall be defined as material ejected from the nozzle against a surface from which it rebounds and falls.

Sand used for pneumatically applied stucco shall comply with the requirements for sand for reinforced concrete construction

Sections 4714-4715

as provided in Section 4707, provided, that the grading may vary from that required for concrete.

Rebound gathered up and screened may be used as sand in the mixture but shall not constitute more than 25 per cent of the total sand contained in any one batch.

Pneumatically applied stucco shall contain not less than one sack of cement to each five cubic feet (5 cu. ft.) of sand or gravel used.

Hydrated lime or other approved materials in an amount not to exceed 10 per cent of the volume of the cement may be added to the mixture.

Pneumatically applied stucco shall be applied in not less than two coats to a total minimum thickness of seven-eighths inch ($\frac{7}{8}$ ").

Not less than seven days shall elapse between the application of the first and second coats, during which time the first coat shall be sprayed with water and properly cured.

The second coat shall be rodded as provided for the second coat of hand applied stucco. No third coat will be required over the second coat of pneumatically applied stucco.

On buildings where sheathing is required, such sheathing may be omitted provided the frame is covered with not less than one-inch (1") of pneumatically applied stucco reinforced by expanded metal weighing not less than four and five-tenths pounds per square yard, or welded wire fabric weighing not less than four and three-tenths pounds per square yard. Such pneumatically applied stucco shall be applied in the manner hereinabove specified.

Sec. 4715. Number of Coats Required. Plastering with lime mortar shall be three-coat work when applied over metal lath, plaster lath or fiber board, and may be two-coat work when applied over wood lath. Lime plaster shall not be applied directly to fiber board or gypsum lath.

**Interior
Plastering**

Plastering with gypsum or hardwall plaster shall be three-coat work when applied over metal lath, and not less than two-coat work when applied over wood lath, plaster lath or fiber board.

Plastering with cement mortar shall be three-coat work when applied over metal lath, expanded metal or wire mesh.

Cement plaster shall not be applied over gypsum lath, wood lath or fiber board unless such gypsum lath, wood lath or fiber board shall be first covered with a waterproofing paper and metal reinforcing as required for exterior plastering.

In no case will a brush coat be accepted as a third or finish coat where three-coat work is required.

All plaster staff work shall have lugs of pure fiber and plaster of paris, and shall be securely installed and fastened into place in a manner approved by the Building Inspector.

Sec. 4716. (a) First Coat. Lime plaster for first coat on interior wood lath or metal lath shall be composed of eleven cubic feet (11 cu. ft.) of lime putty or five hundred pounds (500 lbs.) of hydrated lime, one hundred fifty pounds (150 lbs.) Keene's Cement, five pounds (5 lbs.) of hair or six pounds (6 lbs.) of fiber and one cubic yard (1 cu. yd.) of sand. Applied

**Plastering
With
Keene's
Cement
Lime
Mortar**

Sections 4716-4718

to brick, tile or concrete the composition shall be ten cubic feet (10 cu. ft.) of lime putty or four hundred fifty pounds (450 lbs.) of hydrated lime, one hundred twenty-five pounds (125 lbs.) Keene's Cement, two pounds (2 lbs.) of hair or three pounds (3 lbs.) of fiber and one cubic yard of sand. The first coat shall be well scored so as to form a good mechanical key and shall be thoroughly set before applying the second coat. The first coat shall completely embed and cover all of the lath.

(b) **Second Coat.** The second coat of lime plaster shall consist of nine cubic feet (9 cu. ft.) of lime putty or four hundred pounds (400 lbs.) of hydrated lime, one hundred twenty-five pounds (125 lbs.) Keene's Cement, two and one-half pounds (2½ lbs.) of hair or four pounds (4 lbs.) of fiber and one cubic yard (1 cu. yd.) of sand. The second coat shall be rodde to a straight surface. The minimum thickness of the two coats of lime plaster shall be not less than three-fourths inch ($\frac{3}{4}$ ") including the lath where the plaster is applied to metal lath, and not less than one-half inch ($\frac{1}{2}$ ") over the face of wood lath or masonry. The second coat of lime plaster shall be thoroughly set before the third, or finish coat is applied.

(c) **Third Coat.** The third or finish coat may consist of one of the following:

1. A white coat mixed one part gypsum, or plaster of paris or Keene's Cement to not more than one part lime putty. Such white coat shall thoroughly cover all brown mortar surfaces.

2. A sand finish consisting of one part gypsum plaster or Keene's Cement to not more than one part of sand by volume. Such sand finish shall thoroughly cover all brown mortar surfaces and may be left in any texture desired.

Portland cement shall not be permitted for the third or finish coat over lime or gypsum brown mortar, nor shall any portland cement be used over lime or gypsum mortar surfaces.

Hardwall or Gypsum Plaster

Sec. 4717. Hardwall or gypsum plaster applied over wood lath, plaster lath or fiber board shall be not less than one-half inch ($\frac{1}{2}$ ") thick measured from the outer surface of the lath.

For two-coat work the first or brown coat shall be mixed of one part of gypsum or hardwall plaster of an approved brand to not more than one and one-quarter parts of sand by volume. The first or brown coat shall be applied with sufficient pressure to obtain a good full key or bond and with sufficient material to cover well and this shall be doubled up immediately with the same material, which shall be brought out to grounds and straightened to a true surface with a rod and darby. The surface of the brown coat shall be left rough equivalent to a brown surface to receive the finish coat.

For three-coat work the scratch coat shall be applied with sufficient pressure to obtain a good full key and with sufficient material to cover well. The surface shall be scratched to provide a bond for the brown coat and shall have been in place at least 12 hours before the second or brown coat is applied. The second or brown coat shall be brought out to grounds and straightened to a true surface with a rod or darby. The surface of the second coat shall be left rough, equivalent to a broomed surface, to receive the finish coat.

Sections 4717-4719

The base coat shall be thoroughly set and shall be free from dryouts, sweatouts, buckles or other harmful defects before the finish coat is applied.

The second or finish coat shall consist of one of the following:

1. Any approved brand of interior stucco, which may be applied over a brown mortar surface that is still green.
2. A white coat consisting of one part gypsum plaster to not more than an equal amount of lime putty thoroughly gauged together which shall be applied in the same manner as specified for white or putty coat over lime mortar.
3. A sand finish consisting of one part of gypsum plaster mixed with not more than two parts of sand. This may be applied over a brown mortar base while it is still green.

Sec. 4718. Interior hardwall or gypsum plaster over metal lath must be at least three-coat work with a minimum thickness of not less than three-fourths inch ($\frac{3}{4}$ ") lath included, measured from the outer face of metal lath supports.

The first or scratch coat shall consist of one part of an approved brand of gypsum plaster to not more than one and one-quarter parts of sand by volume, and shall be thoroughly mixed in a manner so as not to damage the setting qualities of the plaster. This coat shall be scored so as to provide a good key for the second or brown coat.

The first or scratch coat shall be thoroughly set and dry before the brown coat is applied.

The second coat or brown coat of gypsum plaster shall be mixed one part of approved gypsum plaster to not more than two parts of sand by volume and shall be brought to a straight surface.

The third or finish coat shall be mixed and applied in the same manner as specified for the third coat over lime mortar, with the same time as required between second and third coats of lime mortar.

**Hardwall
or Gypsum
Plaster
Over
Metal
Lath**

Sec. 4719. Interior hardwall or gypsum plaster over gypsum block, brick or clay tile shall be not less than two-coat work.

Such two-coat plaster work shall have a minimum thickness of one-half inch ($\frac{1}{2}$ ") over unit masonry or one-fourth inch ($\frac{1}{4}$ ") over monolithic concrete, except where plaster is used for fire-resistant purposes, in which case the minimum thickness shall be one-half inch ($\frac{1}{2}$ ").

For application on brick, gypsum block or clay tile, gypsum plaster shall be mixed in the proportion of one part of gypsum plaster to not more than two parts of sand by volume.

When applied to concrete, gypsum plaster shall be applied over a coat of approved plaster bond or bond plaster shall be used which shall be not less than one-eighth inch ($\frac{1}{8}$ ") nor more than three-eighths inch ($\frac{3}{8}$ ") in thickness. When the concrete surface is true and even, the plaster shall be applied in one coat. If necessary to apply in two coats, double back with the same material. The surface shall be left rough equivalent to a brown surface to receive the finishing coat.

**Hardwall
or Gypsum
Plaster
Over
Masonry**

Sections 4719-4801

The finished coat shall not be applied until the first coat is thoroughly set and nearly dry, except when a putty coat finish is used, in which case the base shall be absolutely dry.

Concrete surfaces which are to be plastered shall be rough. If the required degree of roughness is not procured by using rough forms, the surface shall be hacked. Before plastering, all concrete surfaces shall be cleaned and all dust and loose particles removed. Grease, oil or efflorescence, if present, shall be washed off with a solution of one part of commercial muriatic acid to four parts of water and the surface then washed again with clean water.

**Interior
Cement
Plaster**

Sec. 4720. Except where otherwise specified for fire retardant walls and ceilings, interior cement plaster shall be applied over plaster reinforcing as required for exterior plastering.

All interior cement plaster shall be three-coat work. The first two coats shall be mixed and applied with the same materials and in the same manner as required for the first two coats of exterior work.

The third or finish coat of interior cement plastering may be of the same materials, mixed and applied in the same manner as required for the third coat of gypsum plaster over metal lath or as required for the third coat of exterior stucco.

**Staff
Work**

Sec. 4721. All staff shall be thoroughly soaked before sticking. All lugs shall be of pure fiber and plaster of paris. Excelsior shall not be used for lugs. In all cases where staff is heavy, auxiliary fastenings shall be used and such fastenings shall be not less than the equivalent of 14 gauge copper wire, shall in all cases be of sufficient strength to securely fasten the staff to the support and shall be rust resisting.

**Photographic
and X-Ray
Films**

Refer to Chapter 48. The following provisions are recommended for inclusion in the Code where provisions covering the handling and storage of photographic and X-ray nitrocellulose films are desired:

**Classes of
Film
Excepted**

Sec. 4801 The provisions of this Chapter do not apply to:

1. Film for amateur photographic use in original packages of "roll" and "film pack" films in quantities of less than fifty cubic feet (50 cu. ft.).
2. Safety film (cellulose acetate base).
3. Dental X-ray film.
4. Establishments manufacturing photographic films and storage incidental thereto.
5. Films stored or being used in standard motion picture booths (see Chapter 40).

Safety photographic and X-ray film (cellulose acetate base) may be identified by the marking on the edge of the film. This marking shows plainly before and after developing. Where film is not so marked it shall be inspected to determine whether it is of the safety acetate or nitrate type.

Sections 4801-4903

Sec. 4802. All regulations for the storage and handling of photographic and X-ray nitrocellulose films shall conform to the regulations of the National Board of Fire Underwriters for the "Storage and Handling of Photographic and X-ray Nitrocellulose Films," as recommended by the National Fire Protection Association, Edition of July 15, 1930'. **General Regulations**

Exceptions: Where definite fire-resistive materials are specified, materials of equal fire resistance as specified in this Code may be used.

Sec. 4803. The storage and handling of nitrocellulose motion picture film shall conform to the "Regulations of the National Board of Fire Underwriters for Nitrocellulose Motion Picture Film," effective August 15, 1931, amended July 15, 1939'. **Motion Picture Film**

Refer to Chapter 49: Where it is desired to regulate the installation or alteration of refrigeration systems, the following provisions are recommended for inclusion in the Code:

Sec. 4901. It shall be unlawful for any person, firm or corporation to install or alter or cause to be installed or altered, any system of refrigeration, unless such system is an approved type and is installed in accordance with the provisions of the "Safety Code for Mechanical Refrigeration," as published by the American Society of Refrigerating Engineers, April, 1939', which is hereby declared a part of this chapter. **General**

Sec. 4902. "Approved." When this term is used to apply to systems, appliances and for materials in this chapter, it shall mean that such systems, appliances and/or materials have either been listed as standard by the Underwriters' Laboratories, Incorporated, or have been approved by the Building Inspector. **Definitions**

Sec. 4903. Regulations of this chapter shall apply to all refrigeration systems hereafter installed and to alterations of and additions to such existing systems. **Scope**

¹See "Specification Documents."

NOTES:

NOTES:

NOTES:

NOTES:

NOTES:

NOTES:

NOTES:

321

322

INDEX

NOTE: 1. The following abbreviations are used in this index:

- A. S. T. M.—American Society for Testing Materials.
- A. S. A.—American Standards Association.
- A. W. S.—American Welding Society.
- A. C. I.—American Concrete Institute.
- B. F. U. P.—Board of Fire Underwriters of the Pacific.
- J. C.—Joint Committee on Reinforced Concrete.
- N. B. F. U.—National Board of Fire Underwriters.
- N. F. P. A.—National Fire Protection Association.
- Und. Lab.—Underwriters' Laboratories, Inc.
- 2. For index by Parts, Chapters and Sections in numerical order see pages 7 to 17 herein.

	Section
A—OCCUPANCIES	601
ABBREVIATIONS	
In concrete design.....	2612
In masonry construction.....	2411
In steel design.....	2702, 2703, 2704
In wood construction.....	2504, 2505, 2507, 2508, 2521
ACCESSORY BUILDINGS	1501
ADDITIONS	
To buildings	104
To existing masonry walls.....	2941
ADJOINING BUILDINGS	
Foundation—to be protected when.....	2801
See LOCATION ON PROPERTY	
ADMINISTRATION BUILDINGS (PUBLIC)	
Seating more than 3500.....	601
Seating from 750 to 3500.....	701
Seating less than 750.....	801
ADMINISTRATIVE (see Part I for complete details).....	101
Appeals—required when	303
Approval required—by Building Inspector, when.....	302
Board of Examiners and Appeals.....	304
Bond—for registered inspector.....	204
Building classified by Building Inspector, when.....	501
Building Inspector approves plans, when.....	202
Building Inspector acts as secretary.....	304
Building Inspector—definition of.....	401
Certificates required	205, 206
Condemnation—proceedings for	301
Inspection of buildings	204
Powers and duties of Building Inspector.....	301
Records kept by Building Inspector.....	203
Registered inspector—duties of.....	204
AGGREGATES	
For concrete	2604 (b)
For fire-resistive purposes—classified how.....	4301
Moisture content of.....	2608
Proportions in concrete.....	2607
AIR INTAKES	
For furnaces	3707
For motion picture machine booths.....	4001
For private garages	1505
AIR SPACE	
Around timber in masonry.....	2517
In wood construction—to be divided.....	3205
Under flooring—to be divided.....	1810

	Section
AISLES	
As access to stairway.....	3313
For Group A occupancies.....	604 (f), 604 (l)
For Group B occupancies.....	704
For Group J occupancies.....	802
ALARM VALVE—AUTOMATIC SPRINKLERS	3802
ALLEY	
Definition of	401
ALLOWABLE WORKING STRESSES (see WORKING STRESSES ALLOWABLE)	
ALTERATION	
Definition of	401
Limited how.....	104
Non-structural alterations and repairs.....	104 (e)
Structural alterations and repairs.....	104 (d)
When in Fire Zone No. 1.....	1602
When in Fire Zone No. 2.....	1603
ALTERNATE MATERIALS AND CONSTRUCTION	
Board of Appeals.....	304
Deposit required.....	303
May be approved by Building Inspector, when.....	302
Tests, required when.....	302 (b)
May be used, when.....	304
AMERICAN CONCRETE INSTITUTE—Specifications	
For cast stone.....	2408
AMERICAN LUMBER STANDARDS	
For wood.....	2503
AMERICAN SOCIETY FOR TESTING MATERIALS—Specifications	
See "DOCUMENTS", Subject and Reference	
See also Appendix, Section 4602.	
AMERICAN WELDING SOCIETY	
Welding requirements.....	2710
AMUSEMENT PARK STRUCTURES (see GROUP C)	
Construction	802
Special loads.....	802
ANCHORAGE	
For masonry construction.....	2901, 2940, 2518
For steel in reinforced concrete.....	2618
For wood construction (see WOOD)	
ANCHORS	
For beams and girders.....	2518
For facing—attachment of	2931
For fire-resistive materials.....	4301
For joists.....	2518
For masonry construction	2901, 2940
For masonry veneer to wood frame.....	2205 (d)
For panel and enclosure walls.....	2939
For reinforcing in concrete.....	2618
For roof framing.....	2518
For seats—required.....	604 (g), 704
For steel joists	2714 (d)
For stud walls and partitions.....	2518
For trusses.....	2518
For veneer—attachment of	2926
For walls	2940
For wood columns.....	2515

	Section
APARTMENT	
Definition of	401
APARTMENT HOUSE	
Classed as	1301
Definition of	401
APPEAL	
Board acts, how.....	304
From decision of Building Inspector, when.....	302
Method of making.....	303
APPLICATION	
For permit—details required.....	201
Of Code to buildings and/nr structures.....	102
To demolish	104 (a)
To additional stories	104 (a)
To additions	104 (b)
To alterations or repairs.....	104 (b)
To changed use or occupancy.....	104 (d)
To existing buildings	104
To increased floor area	104 (c)
To non-structural alterations and repairs.....	104 (e)
To roofing repairs or removal.....	104 (d)
To structural alterations or repairs.....	104 (d)
APPROVAL	
After final inspection.....	206
For new materials	302, 304
For storage of materials in street.....	4401
Of chimneys	3701
Of plans for permit	202
Of proscenium curtain after test.....	4105
Of Registered Inspector	204
APPROVED	
Definition of	401
ARCHES	
In fireplace construction	3706
In floor construction	1810
In solid masonry.....	2906
Over proscenium opening.....	3904
ARCHITECT	
Name required on plans.....	201
ARC WELDS (see WELDING)	
AREA	
Allowable (see OCCUPANCY, FIRE ZONES and TYPES OF CONSTRUCTION)	
Definition of	401
ARMORIES	
Seating more than 3500.....	601
Seating from 750 to 3500.....	701
Seating less than 750.....	801
ARTIFICIAL STONE	
General requirements.....	2408
Requirements for veneer.....	2924
ASBESTOS	
As roofing material	4305
For fire doors	4304
For heating equipment	3710, 3711, 3712

	Section
For proscenium curtains.....	4102
For warm air ducts.....	3715
ASHLAR—STONE	
Facing	2931
Walls of.....	2921
Working stresses.....	2411
ASPHALT	
Paper on exterior walls.....	2205
In roof coverings.....	4305
ASSEMBLAGE—PLACES OF (see AUDITORIUMS)	
ASSUMPTIONS	
For lateral forces.....	2307, 2312
For live loads used in design.....	2304, 2305
For reinforced concrete design.....	2611
ASYLUMS (see GROUP D).....	901
ATTIC	
Access to—required	3205
Story—definition of	401
Subdivision required.....	3205
AUDITORIUMS	
Seating more than 3500.....	601
Seating from 750 to 3500.....	701
Seating less than 750.....	801
AUTOMATIC SPRINKLERS	
Design and installation	3802
Where required	3801
AWYNINGS	
Fixed—regulations for	4501 (d)
Movable—regulations for	4501 (b)
B—OCCUPANCIES.....	701
BALCONY	
Exits from Group A occupancies.....	604 (d)
Exits from Group B occupancies.....	704
Exterior—construction of	3501
For smokeproof towers	3315
May project, how	4501 (a)
BALUSTRADES	
Must resist horizontal thrust.....	3501
On balconies for smokeproof towers.....	3315
Required for stairways—when.....	3305
When measuring stair clear width.....	3307
BARRICADES—Construction	4401
BARS	
For concrete reinforcing (see REINFORCED CONCRETE)	
Prohibited over openings.....	604 (l)
BASEMENT	
Definition of	401
Protection of ceiling, Type III.....	2010
Sprinklers—when required.....	3301
Walls and floors—design of.....	2310
BASEMENT PIPE INLETS.....	3807
BAY WINDOW	
Construction of	3501
Definition of	401
May project how.....	4501 (a)
BEAMS	
T-beams of reinforced concrete.....	2614 (d)
Design conditions—reinforced concrete (see REINFORCED CONCRETE)	

	Section
Fireproofing of	4301
Of reinforced concrete	2614
Of wood in heavy timber construction.....	1908, 1910
Of wood.....	2517
BEARING PARTITIONS	
Masonry	2936
Wood frame.....	2524
BEARING PLATES	
For steel joists.....	2715
For wood beams and girders.....	2517
For wood columns.....	2515
BEARING WALLS—(see WALLS)	
BELT COURSES , May project.....	4501 (e)
BENDING MOMENTS —for Reinforced Concrete.....	2614, 2616, 2619, 2621
BLEACHERS—(see REVIEWING STANDS)	
BLOCKS—CONCRETE (see CONCRETE BLOCKS)	
BOARD OF EXAMINERS AND APPEALS	
Appointed how	304
Consists of	304
Hears appeals, when.....	303
BOILER	
General requirements	3709
Room for (see BOILER ROOM—CONSTRUCTION)	
Smoke pipes for.....	3705
Smokestacks for	3702
BOILER ROOM—CONSTRUCTION	
For Group A occupancies.....	608
For Group B occupancies.....	708
For Group C occupancies.....	808
For Group D occupancies.....	908
For Group E occupancies.....	1008
For Group H occupancies.....	1308
BOLTS	
For foundations.....	2204
In steel construction.....	2709, 2719
In wood construction.....	2508
Panic (see panic bolts)	
Washers for.....	2514
BOND	
Allowable stresses—concrete.....	2614
Allowable stresses—reinforced masonry.....	2411
For additions to masonry walls.....	2941
For computations of—concrete.....	2614
For concrete surfaces	2608 (h)
For faced walls	2931
For hollow masonry construction	2910
For solid masonry construction.....	2904
For stone walls	2922
For veneer	2926
BOXES—THEATER	
For Group A occupancies.....	604 (h)
For Group B occupancies.....	704
BRACING	
For patent chimneys	3704
For reinforced concrete forms.....	2610
For smokestacks	3702
For steel construction during erection.....	2711, 2719
For stud walls and partitions.....	2205, 2524
For underpinning	2205
BRICK—(CLAY, CONCRETE, SAND-LIME)	
Fire-resistive rating of.....	4301, 4302
Quality	2402

	Section
Tests for determining grade.....	2402
Walls of (see WALLS).....	
Working stresses—brick masonry.....	2411
BRIDGING	
For concrete joists.....	2622, 3102
For steel joists.....	2715, 3103
For wood joists.....	2520
BUILDING CODE	
Adopted when.....	4604
Application of.....	103, 104
Enforced by.....	301
Purpose of.....	102
Scope of.....	103
Title of.....	101
BUILDING INSPECTOR	
Acts as Secretary.....	304
Approves structural frame.....	204
Approves registered inspector, when.....	204
Certifies floor loads, when.....	2309
Classifies buildings, when.....	501
Definition of.....	401
Issues permit, when.....	202
May approve alternate construction or materials.....	302
May enter premises.....	301
May require registered inspector.....	204
May require tests.....	302 (b), 2401
May stop work.....	301
Opinion necessary for changes in fire zones.....	1602
Powers and duties of.....	301
Record of permits required.....	203
Shall issue Certificate of Compliance, when.....	205
Shall make inspections, when.....	204
Shall require reports.....	204
Special permit issued when.....	1602
BUILDING INSPECTOR'S AUTHORIZATION REQUIRED	
Before changing plans.....	262
For changes of use or occupancy.....	104 (b), 207
For removal of existing safeguards.....	105
For structural alterations.....	202
BUILDINGS	
Change of use, when.....	104 (d), 207
Classified by type of construction.....	1702
Classified by use or occupancy.....	501, 503
Definition of.....	401
Located in more than one fire zone.....	1601 (b)
Regulated by fire zones.....	1602, 1603
Require registered inspector, when.....	204
Temporary.....	1601 (d)
To be condemned.....	301
To be occupied, when.....	206
To conform to Code, when.....	103, 104
BUILDING MATERIALS	
May be stored—how.....	4401
BUILT UP TIMBERS	2516
BUTTRESSED WALLS —Construction of.....	2903 (d)
C—OCCUPANCIES	801
CAISSONS	2804
CANOPIES	Chapter 45
CAST STONE	
Requirements for.....	2408
CEDAR	
Mudsills.....	2204, 2205
Piling.....	2803
Working stresses.....	2503
CEILING	
Fire-resistive required—above furnaces.....	3707
Fire-resistive required—in Type III buildings.....	2010
For fire protection purposes.....	4301
Minimum height of (see STORY).....	

	Section
CELLAR	
Definition of	401
Protection of ceiling, when	2010
Sprinklers—when required.....	3801
CELL BLOCKS—JAILS	
Construction of	909
CEMENT—PORTLAND (see PORTLAND CEMENT)	
CERTIFICATE	
Of Compliance—issued by Building Inspector.....	205
Of Occupancy—for change of use	207
Of Occupancy—issued to owner	206
Of Registration—for Registered Inspector.....	204
CHANGE OF OCCUPANCY	
Certificate required for.....	207
CHASES (see RECESSES)	
CHIEF OF THE FIRE DEPARTMENT	
Definition of.....	401
Inspection of equipment by.....	105
Inspection of plans by.....	202, 207
CHIMNEYS	
Firestopping around.....	2526
General requirements	3701
Patent type	3704
Wood frame—spaced from.....	2524
CHURCHES	
Seating more than 3500.....	601
Seating 750 to 3500.....	701
Seating less than 750.....	801
CITY	
Adopted this code, when.....	4604
Clerk, files appended documents, when.....	4602
Council orders repairs, when.....	301
Grants permission for storage in streets.....	4401
Levies penalties, when.....	305
Permits use of space under sidewalks.....	4501 (g)
Requires bond of registered inspector.....	204
Requires permit, when.....	201
CLASSIFICATION	
Of fire-resistive construction (see Chapters 42 and 43)	
Of occupancies	501, 503
Of Types of Construction	1701, 1702
CLASSIFICATION OF BUILDINGS	
By fire zones.....	1602-1604
By occupancy	503
By type of construction	1702
CLAY ROOF TILE	4305
CLAY TILE—HOLLOW	
Allowable stresses for.....	2411, 2908
Bearing walls of (see HOLLOW MASONRY)	
For fire-resistive construction	4301, 4302
For panel walls.....	2939
For partitions—bearing	2936
For partitions—non bearing	2937
Specifications for.....	2405
CLEAN-OUT	
For concrete forms	2610 (a)
For patent chimneys	3704
CLEARANCE	
Around reinforcing in concrete	2610 (d)
Around smoke pipes	3705
Around smoke stack	3702
Around stoves and heaters.....	3710, 3711

	Section
Around timber in masonry.....	2517
Around warm air furnaces	3707
For swelling of wood floor.....	1910
Of wood framing from chimneys.....	2524
Under first floor joists.....	2527, 3105
CLUBS	
Seating more than 3500	601
Seating 750 to 3500.....	701
Seating less than 750.....	801
COLD STORAGE (see GROUP G)	
COLUMNS	
Capital—defined	2603
Composite	2620
Combination	2620
Fire-protection of	4301
Heavy timber	1908
Masonry	2905, 2912
Mill construction	1908
Project beyond property line—when.....	4501 (e)
Reinforced concrete.....	2620
Reinforced concrete—definition of	2603
Structural steel—allowable stresses.....	2702
Wood—allowable stresses.....	2503, 2505
Wood—framing details.....	1908, 2515 to 2526
COMBINED STRESSES	
Concrete columns.....	2620
General requirements.....	2307, 2312
Steel	2702
Wood	2503
COMBUSTIBLE GOODS—Sales and Storage (see GROUP F)	
COMBUSTIBLE MATERIALS	
Prohibited in Fire Zone No. 1.....	1602
Regulated in Type I buildings	1816
Regulated in Type II buildings	1918
Regulated in Type III buildings	2016
Regulated in Type IV buildings	2116
Regulated in Type V buildings.....	2216
COMMUNICATING OPENINGS	
Through occupancy separations.....	503
COMPLIANCE—CERTIFICATE OF	
	205
COMPOSITION ROOFINGS	
	4305
COMPUTATIONS—may be required	
	201
CONCENTRATED LOADS	
Required to be distributed on masonry.....	2412
Special requirements for.....	2303
CONCRETE	
Blocks of (see CONCRETE BLOCKS)	
Brick—quality and design	2404
Definition of	2603
Design of—when reinforced.....	2602
Fire-resistive classification (see Chapter 43).....	4301, 4302
For roofs—slab or tile.....	4305
Piles	2903 (c)
Plain—quality and design.....	2407
Reinforced—definition of	2603
Reinforced—design of (see Chapter 26).....	2602
Tests—for reinforced concrete.....	2605, 2613
Transporting and placing	2609
Walls—plain	2901-2906, incl.
Walls—reinforced	2914
Working stresses of	2411, 2613
Working stresses—masonry units.....	2411

CONCRETE BLOCKS		Section
For fire-resistive construction	4302	
For masonry walls	2907, 2937	
For panel walls	2939	
For partitions—bearing	2936	
For partitions—non-bearing	2937	
Quality and design of	2404, 2406	
Working stresses	2411	
CONDEMNATION		301
CONNECTIONS		
Between fresh and hardened concrete	2609 (h)	
Between wood and masonry	2518	
For structural steel	2708-2710, incl.	
For additions to masonry walls	2941	
In wood framing	2508-2525, incl.	
CONSTRUCTION		
Fire Zone No. 1	1602	
Fire Zone No. 2	1603	
Fire Zone No. 3	1604	
For Group A occupancies	602, 609	
For Group B occupancies	702, 709	
For Group C occupancies	802, 809	
For Group D occupancies	902, 909	
For Group E occupancies	1002, 1009	
For Group F occupancies	1102, 1109	
For Group G occupancies	1202, 1209	
For Group H occupancies	1302, 1309	
For Group I occupancies	1402, 1409	
For Group J occupancies	1502	
For types of (see TYPES OF CONSTRUCTION)		
Lights required	4401	
Temporary use of streets allowed during	4401	
CONSTRUCTION JOINTS		
In concrete	2610 (g)	
CONSTRUCTION MATERIAL		
Allowed in streets, when	4401	
Load to be provided for, when	2719	
CONTENTS BY PARTS, CHAPTERS AND SECTIONS (See pages 7-17 inclusive)		
CONVENTS		1301
CORBELING		
Of hollow masonry	2907	
Of incinerator walls	3716	
Of solid masonry	2901	
CORNICES (see also TYPES OF BUILDINGS)		4501
COST OF BUILDINGS—for permits		201, 202
COVERINGS		
For exteriors of frame buildings	2205	
For fire protection	4301	
For patent chimneys	3704	
For roofs	4305	
For warm air ducts	3715	
For wood doors, when	4304	
CURB		
Allowed in alley—when	4501 (h)	
For skylights—constructed how	3402	
CURTAIN		
For proscenium opening (see PROSCENIUM CURTAIN)		
CURTAIN WALL		
Definition of	401	
Hollow masonry—construction of	2909	
Reinforced concrete—construction of	2914	
Solid masonry—construction of	2903	

	Section
D—OCCUPANCIES	901
DANCE HALLS	
Seating more than 3500	601
Seating from 750 to 3500	701
Seating less than 750.....	801
DEAD LOAD	
Definition of	401, 2301
DECORATIVE FEATURES—may project how.....	4501 (e)
DEFINITIONS	
Of certain words.....	401, 2603, 4305
Of fire-resistive construction	4201
Of Group A occupancies.....	601
Of Group B occupancies.....	701
Of Group C occupancies.....	801
Of Group D occupancies.....	901
Of Group E occupancies.....	1001
Of Group F occupancies.....	1101
Of Group G occupancies.....	1201
Of Group H occupancies.....	1301
Of Group I occupancies.....	1401
Of Group J occupancies.....	1501
Of terms in concrete regulations	2603
Of Type I buildings	1801
Of Type II buildings	1901
Of Type III buildings	2001
Of Type IV buildings	2101
Of Type V buildings	2201
DEMOLISH—BUILDING	
Required when.....	301
DEPTH OF FOUNDATIONS	
Affects excavations when	2801
Governed by frost line	2958
Governed by soil conditions	2802
DESIGN	
General	2302 (b)
Live loads for (see Chapter 23)	
Must be approved by Building Inspector.....	202
Of footings and foundations (see also Chapter 28).....	2306 (4)
Of masonry materials.....	2401
Of proscenium curtains.....	4101-4106, incl.
Of reinforced concrete	2602
Of structural steel	2701
Of walls	2901-2941, incl.
Of wood	2501
DETAILED REGULATIONS	
Bays and balconies	3501
Chimneys and heating apparatus	3701-3716, incl.
Doors, windows and skylights	3401, 3402
Fire extinguishing apparatus.....	3801-3809, incl.
Floor construction	3101-3105, incl.
Enclosure of vertical openings.....	3001-3003, incl.
Excavations, footings and foundations.....	2801-2803, incl.
Motion picture machine booths	4001
Penthouses and roof structures	3601
Proscenium curtains	4101-4106, incl.
Roof construction and covering	3201-3206, incl.
Stages	3901-3908, incl.
Stairs, ramps and smokeproof towers	3301-3316, incl.
Walls and partitions	2901-2941, incl.
DIVISION	
Of attic space.....	3205
Of buildings for fire protection.....	501, 503
Of floor area (see maximum area requirements under OCCUPANCY)	

DOCUMENTS—Subject and Reference**Section**

Aggregate, concrete—A.S.T.M. C33-39.....	2604
Aggregate, lightweight for concrete—A.S.T.M. C130-39.....	2604
American Welding Society Bulletin Code, Edition 1937.....	2710
Appended as part of the code.....	4602
Billet-Steel Concrete Reinforcement Bars of Structural, Intermediate or Hard Grade Steel—A.S.T.M. A15-39.....	2604 (d)
Brick—A.S.T.M. C62-39T.....	2402
Brick, concrete—A.S.T.M. C55-37.....	2404
Brick, sand lime—A.S.T.M. C73-39.....	2403
Building Code of the National Board of Fire Underwriters, Appendix P, Fifth Edition Revised 1934.....	4102
Cast stone—A.C.I. P3-A29T.....	2408
Cast iron—A.S.T.M. A-48-36.....	2701
Cast steel (Carbon-Steel Castings)—A.S.T.M. A27-39.....	2701
Chimneys—N.B.F.U. Standard Ordinance for Chimney Construction, 1927.....	3701
Clay tile—A.S.T.M. C34-39.....	2405
Clay tile—non-load bearing—A.S.T.M. C56-39.....	2405
Cold-drawn steel wire—A.S.T.M. A82-34.....	2604
Concrete building brick—A.S.T.M. C55-37.....	2404
Concrete cylinder tests—A.S.T.M. C31-39.....	2605, 2613
Concrete—Masonry—Und. Lab.—Concrete Masonry Units November, 1938.....	2406
Concrete—load-bearing masonry units—A.S.T.M. C90-39.....	2406
Concrete, ready-mixed—A.S.T.M. C94-38.....	2607
Concrete, testing of—A.S.T.M. C39-39.....	2613
Film Vault Buildings and Motion Picture Plants—Rating, Revision November 12, 1931.....	4102
Fire doors, hanging of—N.F.P.A.—Protection of Openings in Walls and Partitions Against Fire, Edition of January, 1939.....	4304
Fire doors—Und. Lab.—Standard for Tin-Clad Fire Doors and Shutters, Revised to July, 1937.....	4304
Fire Prevention Ordinance, Recommended by N.B.F.U. Edition, 1938.....	908, 1008, 1108, 1208, 1308, 1508
Fire tests—A.S.T.M. C19-33.....	4201
Flammable liquids—N.B.F.U.—Suggested Fire Prevention Ordinance, Edition, 1938.....	908, 1008, 1108, 1208, 1308, 1508
Gray Iron Castings—A.S.T.M. A48-36.....	2701
Gypsum—A.S.T.M. C22-25.....	2409
Gypsum tile—A.S.T.M. C52-33.....	2409
Hydrated lime—A.S.T.M. C6-31.....	2410, 4708
Iron—Gray Iron Castings—A.S.T.M. A48-36.....	2701
Keene's cement—A.S.T.M. C61-30 and C26-39.....	4710
Lumber, Wood Handbook, U.S. Dept. of Agriculture, Miscellaneous Publication No. 185.....	2503
Motion Picture Plants and Film Vault Buildings, B.F.U. of the Pacific, Revision of November 12, 1931.....	4102
Oil Burners—N.B.F.U.—Regulations for oil burning equipment, 1934, Amendment, 1936.....	3713
Photographic and X-Ray Film, storage of—Recommended by N.F.P.A., Edition August 15, 1931, Amended September 15, 1936.....	4802, 4803
Pipe—steel, welded and seamless—A.S.T.M. A53-36.....	2701
Portland cement—A.S.T.M. C9-38.....	2410, 2604, 4711
Portland cement—High Early Strength—A.S.T.M. C74-39.....	2604
Plywood—CS45-38.....	2503 (d)
Quicklime—A.S.T.M. C5-26.....	2410, 4708
Rail steel reinforcing—A.S.T.M. A16-35.....	2604
Refrigeration—Code for Mechanical Refrigeration—American Society of Refrigerating Engineers, Approved by A.S.A., April, 1939.....	4901
Roofing fabrics—A.S.T.M. D146-38T.....	4305 (b)
Roofs, Class C coverings—Und. Lab. December 15, 1938.....	4305 (b & d)
Safety Code for Mechanical Refrigeration—American Society of Refrigerating Engineers, Approved by A.S.A., April, 1939.....	4901
Sands, organic impurities in—A.S.T.M. C40-33.....	4707
Shingles, wood—U.S. Dept. of Com. Bur. of Stds.—CS31-38.....	4305 (d)
Sprinklers—N.B.F.U. regulations recommended by N.F.P.A.— Automatic Sprinkler Equipment, Edition 1936 with Amendments September, 1937.....	3802
Steel—Structural, for Bridges and Buildings—A.S.T.M. A7-39.....	2701
Structural, intermediate or hard-grade reinforcing— A.S.T.M. A15-39.....	2604 (d)

	Section
Suggested Fire Prevention Ordinance, Edition 1938—	
N.B.F.U. 908, 1008, 1108, 1208, 1308, 1508	
Theater curtains—Appendix "P" of the Building Code,	
N.B.F.U. Revised 1934	4102
Welding—A.W.S. Code, Edition 1937	2710
Wood Handbook, U.S. Dept. of Agriculture, September, 1935	2503
Wood Shingles—U.S. Dept. of Com. Bur. of Stds.—CS31-38	4305 (d)
Wood—U.S. Dept. of Agriculture, Miscellaneous Publication	
No. 185	2503
X-Ray Film, storage of—Recommended by N.F.P.A., Edition	
August 15, 1931, Amended September 15, 1936	4802, 4803
DOORS	
Construction—for one-hour rating	4304
Fire-resistive—classification, design, hanging	4304
Fire-resistive—when required (see under OCCUPANCY, FIRE	
ZONES and TYPES OF CONSTRUCTION)	
For enclosure of vertical openings	3002, 3003
For fire separations	503
For Group A occupancies	604 (i)
For Group B occupancies	703-706
For Group C occupancies	803, 804
For Group D occupancies	904
For horizontal exits	3311
For motion picture machine booths	4001
For smokeproof towers	3315
For stage ventilators	3901
General requirements	3401
May not project over public property, when	4501 (f)
DORMITORIES	1301
DOWNSPOUT	
For marquees	4501 (d)
For roofs—general	3206
DRAINAGE FILL	1811
DRAWINGS	
Required for permit	201
Shall include what	201
DRESSING ROOMS	
Construction of	3903
Exits from	3907
Fire protection of	3801
Location of	3903
DRIFTING	
Not permitted, when	2717
DRY CLEANING PLANTS	
Classified as	1001
Flammable liquids regulated	1008
Open flame prohibited	1008
Steam fire extinguishing apparatus	1008
Ventilation of	1008
DRY STANDPIPES (see STANDPIPES)	
DUCTS	
For ventilation of motion picture booths	4001
For warm air furnaces	3715
DUTIES	
Of Board of Examiners and Appeals	304
Of Building Inspector (see BUILDING INSPECTOR)	301
DWELLING	
Definition of	401
In Group I Occupancy	1401
When constructed on roof	1403, 3601
E—OCCUPANCIES	1001
EARTH PRESSURE	
Calculations for	2310
EARTHQUAKES—Provisions for	2312

	Section
ECCENTRIC LOADS	
In masonry construction.....	2412
In reinforced concrete.....	2620 (h)
In steel.....	2703
EGRESS (see STAIRS)	
ELECTRIC WELDING (see WELDING)	
ELEVATOR SHAFTS (see VERTICAL OPENINGS)	
EMERGENCY	
Controls for proscenium curtain	4104
Exits for—Group A occupancies.....	604
Exits for—Group B occupancies.....	704
Exits for—Group C occupancies.....	804
Stage ventilators.....	3901
Release for picture booth openings	4001
Signs for exits.....	604, 804, 3312
ENCLOSURE OF VERTICAL OPENINGS (see OCCUPANCY and TYPES OF CONSTRUCTION)	
For elevators	3002
For stairs and ramps	3002, 3303
Miscellaneous openings	3003
Required, when	3001
Smokeproof tower, when	3315
Through special fire separation, when.....	503 (c)
ENCLOSURE WALLS (see WALLS)	
ENGINEER—STRUCTURAL	
Name required on plans.....	201
ENGINEERING REGULATIONS—quality and design of the materials of construction	
Live and dead loads.....	2301-2312, incl.
Masonry (quality and design).....	2401-2412, incl.
Reinforced concrete (quality and design).....	2601-2623, incl.
Steel and iron (quality and design).....	2701-2719, incl.
Wood (quality and design).....	2501-2529, incl.
ENGINEERING SUPERVISION	
Required, when	204
ERECTION	
Of concrete forms.....	2610
Of masonry walls	Chapter 29
Of new buildings	201
Of structural steel.....	2719
Of wireless masts	3602
Of wood construction.....	2515-2526, incl.
EXCAVATIONS	
General details for	2801
Water to be removed from, when.....	2609 (c)
EXHAUST VENTILATION (see VENTILATION)	
EXISTING BUILDING	
Application of Code to	104
Definition of	401
EXISTING WALLS	
Extensions of	2941
EXIT LIGHTS	
For Group A occupancies.....	604 (j)
For Group C occupancies.....	804
General requirements	3306, 3312
EXIT FACILITIES	
General requirements	3301
Group A occupancies.....	604
Group B occupancies.....	704
Group C occupancies.....	804
Group D occupancies.....	904
Group E occupancies.....	1004
Group F occupancies.....	1104
Group G occupancies.....	1204
Group H occupancies.....	1304
Group I occupancies.....	1404
Group J occupancies.....	1504

	Section
EXPANSION (OF STEEL)	
Provision for	2716
Rollers for	2702 (h)
EXPLOSIVES—STORAGE	1001
EXTERIOR OPENINGS—PROTECTION REQUIRED WHEN	
Because of location in Fire Zone.....	1602, 1603
Because of location on property (see OCCUPANCY GROUP)	
Because of Type of Construction (see TYPES OF CONSTRUCTION)	
EXTERIOR WALLS	
Construction of (see LOCATION ON PROPERTY or TYPES OF CONSTRUCTION)	
Construction when in Fire Zone No. 2.....	1603
Construction of openings (see Particular OCCUPANCY GROUP, TYPE OF CONSTRUCTION or FIRE ZONE)	
F—OCCUPANCIES	1101
FACED WALLS (see WALLS)	
FACTORIES	
Moderately hazardous (see GROUP F).....	1101
Non-hazardous (see GROUP G).....	1201
FAMILY	
Definition of	401
FEES	
Additional fee required—when.....	305
Doubled—when	203
For appeal.....	303
For building permits	203
Record required of	203
FENCES	
Classed as	1501
For construction purposes	1602, 4401
FILLED GROUND	2802
FILL UNDER FLOOR	1810
FILM EXCHANGES	
Classed as	1001
Sprinklers required for	3801
FILMS—FLAMMABLE	
Classes of, excepted.....	4801
General regulations.....	4802
Storage and use of.....	4001, 4802
FINAL INSPECTION	
Certificate of Compliance required when.....	205
Made when	206
Required when	204
FINES—FOR VIOLATIONS	305
FIRE	
Classification of materials for resistance to (see Chapter 43)	
Extinguishing apparatus (see FIRE EXTINGUISHING APPARATUS)	
Separations required—for certain occupancies	503
Standards for resistance of (see Chapters 42 and 43)	
Standards	4201
FIRE CHIEF (See Chief of the Fire Department)	
FIRE CLAY	
For flue lining	3701
For incinerator combustion chamber	3716
For patent chimneys	3704

FIRE DAMAGE**Section**

Causes condemnation—when	104, 301
Repairs allowed—when	104 (a)

FIRE DEPARTMENT

Access to basement pipe inlets	3807

FIRE ESCAPES (see OUTSIDE STAIRWAYS)**FIRE EXTINGUISHING APPARATUS**

Automatic sprinklers—requirements for	3802
Automatic sprinklers—where required	3801
Basement pipe inlets—where required	3807
Dry standpipes—requirements	3804
Dry standpipes—where required	3803
For Group A occupancies	607
For Group B occupancies	707
For Group C occupancies	807
For Group D occupancies	907
For Group E occupancies	1007
For Group F occupancies	1107
For Group G occupancies	1207
For Group H occupancies	1307
For Group I occupancies	1407
For Group J occupancies	1507
Inspection by Fire Chief	105
Wet standpipes—requirements	3806
Wet standpipes—where required	3805

FIREPLACES—CONSTRUCTION OF 3706**FIRE PROTECTION (see TYPES OF CONSTRUCTION)**

Requirements—detailed	4301

FIRE-PROTECTED PASSAGEWAYS

For Group A occupancies	604
For Group B occupancies	704
For Group C occupancies	804
For smokeproof towers	3315

FIRE PUMPS

For wet standpipe supply	3806

FIRE-RESISTIVE

Construction	4203
Construction defined	4201
Doors, windows and shutters	4304
Floor construction	4303
Inspection of plaster protection—when	204
Materials	4202
Materials, tests for	4201
Partitions	4302
Protection of structural parts	4301
Roof coverings	4305
Standards—specifications for	4201
Walls	4302

FIRE-RESISTIVE BUILDINGS (see TYPE I BUILDINGS)

1801-1816, incl.

FIRE-RESISTIVE STANDARDS

For doors and shutters	4304
For floor construction	4303
For protection of structural parts	4301
For roof coverings	4305
For walls and partitions	4302
For windows	4304
General requirements	4201-4203 incl.

FIRE STATIONS 1101**FIRESTOPPING**

Between wood sleepers	1810
For wood frame construction	2526
In Type III buildings	2011, 2016
In Type V buildings	2205, 2526, 3105
Of attic spaces	3205

	Section
FIRE ZONES	
Definition of	1601
Doors may not project—when	4501 (f)
Requirements for Fire Zone No. 1	1602
Requirements for Fire Zone No. 2	1603
Requirements for Fire Zone No. 3	1604
FLAG POLES	3601
FLAMMABLE LIQUIDS—Regulated	
In Group A occupancies.....	608
In Group B occupancies.....	708
In Group C occupancies.....	808
In Group D occupancies.....	908
In Group E occupancies.....	1008
In Group F occupancies.....	1108
In Group G occupancies.....	1208
In Group H occupancies.....	1308
In Group I occupancies.....	1408
In Group J occupancies.....	1508
Storage for heating purposes	3713
FLAME—OPEN	
Prohibited when	1008
FLASHING	
Waterproof paper and metal	4712
FLAT SLAB	
General requirements.....	2619
FLOOR AREA	
Definition of	401
Limited (see OCCUPANCY and FIRE ZONES)	
FLOOR CONSTRUCTION	
Concrete.....	2622, 3102
Fire protection—of certain floors.....	4301, 4303
Fire-resistive—classification of	4303
For fire-resistive construction	4303
General (see TYPES OF CONSTRUCTION).....	3101
Laminated.....	2523, 3104
Mill construction	3104
Motion picture machine booths.....	4001
Stages.....	606, 3905
Steel joists.....	2715, 3103
Under warm air furnaces.....	3707
Wood joists.....	2517, 3105
FLOOR FILL	
Required, when	1810
FLOOR LEVELS	
Determine sprinkler requirements—when	3801
For Group A occupancies.....	603
For Group B occupancies.....	703
For Group E occupancies.....	1004
FLOOR LOADS	
Assumed live	2304
Definitions of	2301
Reductions allowed	2306
Required to be posted.....	2308
Special considerations	2303
FLOOR OPENINGS	
Enclosures of—when required (see VERTICAL OPENINGS—ENCLOSURE OF)	
In stages—construction of.....	606, 3905
FLOOR PROTECTION	
For wood joisted floor	4301
Over heating plants	3707, 3708

	Section
Over ranges	3711, 3712
Required in Type III buildings	2010
Under stoves	3710
 FLUES	
Area required	3701
Lining for chimneys	3701
Lining for smokestacks	3702
 FLY GALLERIES	
Construction of	3902
 FOOTINGS	
Concrete—design of	2621
Design of—general	2306, 2802
 FORMS	
For concrete construction	2610
May be removed, when	2610 (b)
 FOUNDATION	
Caissons	2804
Concrete—design of	2621
Construction allowed (see TYPES OF CONSTRUCTION)	
Definition of	401
Design of	2306, 2802
Excavations for	2801
Footing design—isolated	2306, 2802
For retaining wall	2310
Inspection required for Type V buildings	204
Liability of adjoining property	2801
May be omitted in Type V buildings, when	2204
May project beyond property line—when	4501 (h)
Openings in wall for ventilation	2527
Owner's liability for	2801
Piling for	2803
Soil bearing allowed	2802
Stepped in Type V buildings, when	2204
Thickness of walls for Type V buildings	2204
Walls of masonry	2938
 FRAME BUILDINGS (see TYPE V BUILDINGS)	 2201
 FRAME INSPECTION	
Required, when	204
 FRAMEWORK—OF BUILDING (see TYPES OF CONSTRUCTION)	
 FRAMING	
Around chimneys	2524
Of wood construction (see WOOD)	
 FRONT OF LOT	
Definition of	401
 FROST	
Depth of foundations for	2938
Protection of concrete from	2609 (g)
 FURNACES—WARM AIR	
Ducts and appurtenances for	3715
General requirements	3707
Intake required for	3707
 FURRING	
Not allowed near chimney	2524 (h)
Of stucco reinforcement	2205 (c), 4709
Requirements in wood frame construction	2526
 FUSIBLE LINKS	
For automatic sprinkler systems	3802
For doors—automobile ramp enclosures	1006

	Section
For fire doors	3401
For horizontal exits, when	3311
For motion picture machine booths	4001
For proscenium curtains	4104
For stage ventilators	3901
For vents supplying air back stage	605
G—OCCUPANCIES	1201
GALVANIZED IRON	
Casing for patent chimneys.....	3704
Used for roof	4305
Used as siding	2105, 2205 (e)
GARAGE, PRIVATE	
Classified as.....	1501
Definition of.....	401
Limited how.....	1509
Ventilation required.....	1505
GARAGE, PUBLIC	
Classified how	1001
Construction limited	1009
Definition of	401
Detailed requirements (see GROUP E)	
Ramps for	1004
Separations required	503
Ventilation required	1005
GAS	
Furnaces	3707
Heaters	3711
Hot plates	3711
Ranges—domestic	3711
Ranges—commercial	3711
Shut-offs required (see GAS SERVICE—SHUT OFF)	
Vents—general requirements	3703
GAS CUTTING OF STEEL	
How performed.....	2717
GASOLINE SERVICE STATIONS (see GROUP E)	
GAS SERVICE—SHUT-OFF REQUIRED	
For Group A occupancies.....	608
For Group B occupancies.....	708
For Group C occupancies.....	808
For Group D occupancies.....	908
GIRDERS	
Concrete (construction joints)	2610
Fire protection of.....	1809, 1909, 2009, 4301
Loads reduced when	2306
Steel	2704
Wood	2517, 3105
GRADE	
Brick	2402, 2403, 2404
Ground level, definition of.....	401
Lumber	2503
Lumber, definition of.....	401
GRADIENTS—allowed	
For automobile storage	1004
For ramps	3310
In Group A occupancies.....	602, 604
GRANDSTANDS	
	Chapter 8
GRAVITY TANKS	
For oil burning equipment	3713
For wet standpipe supply	3806

Section**GREENHOUSE**

Roof to be constructed—how	3402

GRIDIRONS

Construction of	3902

GROUP A OCCUPANCY

Area	602
Boxes	604 (h)
Chimney and heating apparatus	608
Construction	602
Defined	601
Doors and Gates	604 (i)
Enclosure of vertical openings	606
Existing buildings—classified when	609
Exit courts	604 (b)
Exit facilities	604
Exit lights	604 (j)
Fire extinguishing apparatus	607, 3801
Light and ventilation	605
Location on property	603
Mixed occupancies—separations for	610
Moving picture machine booths	4001
Obstructions in exits	604 (l)
Occupancies included	601
Protection of exterior openings	603
Running tracks—construction permitted	609
Seats	604 (g)
Smokeproof tower	604 (k)
Special hazards	608
Stage construction	602, Chap. 39

GROUP B OCCUPANCY

Area	702
Boxes	704
Chimneys and heating apparatus	708
Construction	702
Defined	701
Doors	703, 704
Enclosure of vertical openings	706
Exit facilities	704
Exit lights	704
Fire extinguishing apparatus	707, 3801
Flammable liquids prohibited	708
Light and ventilation	705
Location on property	703
Main entrance	703, 704, 706
Mixed occupancies—separation from	710
Motion picture machine booths	4001
Obstructions in exits	704
Occupancies included	701
Protection of exterior openings	703
Running tracks—construction	709
Seating capacity may be increased, when	702 (a)
Seats	704
Smokeproof tower	704
Special construction requirements	702 (b), 709
Special hazards	708
Stage construction	702, Chap. 39
When located on second floor	709

GROUP C OCCUPANCY

Area	802
Chimneys and heating apparatus	808
Construction	802
Definition of	801
Enclosure of vertical openings	806
Exit facilities	804
Exit lights	804
Fire extinguishing apparatus	807, 3801
Height	802
Light and ventilation	805
Location on property	803
Mixed occupancies—separation from	810

	Section
Motion picture machine booths	4001
Occupancies included	801
Protection of exterior openings.....	803
Running tracks—construction of.....	809
Special construction	802 (b), 809
Special hazards	808

GROUP D OCCUPANCY

Area	902
Chimneys and heating apparatus	908
Construction	902
Definition of	901
Enclosure of vertical openings.....	906
Exit facilities	904
Fire extinguishing apparatus.....	907
Flammable liquids—storage regulated.....	908
Height	902
Jails—special construction	909
Light and ventilation	905
Location on property	903
Mixed occupancies—separation from.....	910
Motion picture machine booths	4001
Occupancies included	901
Protection of exterior openings	903
Ramps required, when	904
Self-releasing latches or panic bolts, when.....	904
Special construction	902 (b), 909
Special hazards	908

GROUP E OCCUPANCY

Area	1002
Automobile ramps	1004
Chimneys and heating apparatus.....	1008
Construction	1002
Definition of	1001
Dry cleaning—special construction.....	1008
Enclosure of vertical openings.....	1006
Exit facilities	1004
Fire extinguishing apparatus.....	1007, 3801
Flammable liquids—regulated	1008
Gasoline filling station, Type V.....	1009
Height	1002
Light, ventilation and sanitation.....	1005
Location on property	1003
Mixed occupancies—separation from.....	1010
Occupancies included	1001
Prohibited in Fire Zone No. 1.....	1602
Prohibited in Fire Zone No. 2.....	1603
Protection of exterior openings	1003
Special construction	1009
Special hazards	1008

GROUP F OCCUPANCY

Area	1102
Chimneys and heating apparatus.....	1108
Construction	1102
Definition of	1101
Enclosure of vertical openings.....	1106
Exit facilities	1104
Fire extinguishing apparatus	1107
Flammable liquids, regulated	1108
Height	1102
Light, ventilation and sanitation.....	1105
Location on property	1103
Mixed occupancies—separation from.....	1110
Occupancies included	1101
Protection of exterior openings.....	1103
Special construction	1109
Special hazards	1108

GROUP G OCCUPANCY

Area	1202
Chimneys and heating apparatus	1208
Construction	1202

	Section
Definition of	1201
Enclosure of vertical openings	1206
Exit facilities	1204
Fire extinguishing apparatus	1207
Flammable liquids, regulated	1208
Height	1202
Light, ventilation and sanitation	1205
Location on property	1203
Mixed occupancies—separation from	1210
Occupancies included	1201
Protection of exterior openings	1203
Special construction	1209
Special hazards	1208

GROUP II OCCUPANCY

Area	1302
Chimneys and heating apparatus	1308
Construction	1302
Definition of	1301
Enclosure of vertical openings	1306
Exit facilities	1304
Fire extinguishing apparatus	1307
Flammable liquids, regulated	1308
Height	1302
Light, ventilation and sanitation	1305
Location on property	1303
Mixed occupancies—separation from	1310
Occupancies included	1301
Protection of exterior openings	1303
Special construction	1309
Special hazards	1308
State laws applicable	1303, 1305

GROUP I OCCUPANCY

Area	1402
Chimneys and heating apparatus	1408
Construction	1402
Definition of (dwellings)	1401
Dwellings when on roof	1409, 1401
Enclosure of vertical openings	1406
Exit facilities	1404
Fire extinguishing apparatus	1407
Flammable liquids, regulated	1408
Height (see TYPES OF CONSTRUCTION)	
Light, ventilation and sanitation	1405
Location on property	1403
Mixed occupancies—separation from	1410
Protection of exterior openings	1403
Special hazards	1408
State laws applicable	1405

GROUP J OCCUPANCY

Area	1502
Automobile storage—limited	1509
Chimneys and heating apparatus	1508
Construction, height and area allowable	1502
Definition of	1501
Enclosure of vertical openings	1506
Exit facilities	1504
Fire extinguishing apparatus	1507
Flammable liquids, regulated	1508
Height	1502
Light and ventilation	1505
Location on property	1503
Mixed occupancies—separation from	1510
Occupancies included	1501
Protection of exterior openings	1503
Special hazards	1508

GUEST

Definition of	401

Section**GUNITE (see also PNEUMATICALLY PLACED STUCCO)**

As exterior covering for frame construction.....	2205, 4714
Definition of	2603
Enclosure and panel walls	2939
Fire-resistive standards	4301, 4302
Increasing thickness of existing walls	2941
Partitions — non-bearing	2937
Tests of	2613

GUTTERS —to be kept free of obstructions—when.....	4401

GYMNASIUMS	601, 701, 801

GYMNASIUMS —Special Construction.....	609, 709, 809

GYPSUM

Blocks for fire-resistive construction	4302
Fire-resistive classification	4301, 4302, 4303
Partitions—non-bearing	2937
Plaster for fire-resistive purposes	4301, 4302
Plaster lath	4301, 4302
Quality and design	2409
Slabs on steel joists.....	3103
Working stresses	2411 (e)

H—OCCUPANCIES	1301

HANGERS REQUIRED

For joists	2519

HAZARDOUS OCCUPANCIES

Highly hazardous (see GROUP E).....	1001
Moderately hazardous (see GROUP F).....	1101
Non-hazardous (see GROUP G).....	1201

HEADER—in frame construction

Joists—support required	2519, 2524 (k)
Over opening in stud partitions.....	2524 (j)

HEAT

Sources not specified.....	3714

HEATERS

General requirements	3714
Using gas for fuel	3711
Using solid or liquid fuel	3708
Vents for, (gas).....	3703

HEATING PLANTS—LOW PRESSURE STEAM	3708

HEAVY TIMBER CONSTRUCTION (see TYPE II BUILDINGS)	1901-1916, incl.

HEIGHT

Additional for roof structures	3601
Adjoining building affects vents	3703
Affects stairways required	3309
Definition of	401
For awnings	4501 (b)
For Group A Occupancy	602
For Group C Occupancy	802
For Group D Occupancy	902
For Group E Occupancy	1002
For Group F Occupancy	1102
For Group G Occupancy	1202
For Group H Occupancy	1302
For Group J Occupancy	1502
For marquees above sidewalk.....	4501 (d)
For permanent projections over property line	4501
For Type I Buildings (Fire-resistive)	1802
For Type II Buildings (Heavy Timber)	1902
For Type III Buildings (Ordinary Masonry).....	2002

	Section
For Type IV Buildings (Light Incombustible Frame).....	2102
For Type V Buildings (Wood Frame)	2202
Of masonry walls (see WALLS)	
Of veneer on masonry	2927
Towers or spires	3602
HOLLOW CLAY TILE (see CLAY TILE)	
HOLLOW CONCRETE BLOCK OR TILE (see CONCRETE BLOCK)	
HOLLOW MASONRY WALLS (see WALLS)	
HORIZONTAL EXITS	
General requirements	3311
Signs for	3312
Substitute for stairways, when	3309
HOSE	
As equipment for wet standpipe	3806
HOSE CONNECTIONS	
To dry standpipes	3804
To wet standpipes	3806
HOSPITALS	901
HOTELS	
Classified how	1301
Definition of	401
Detailed requirements (see GROUP H)	
HOT PLATES—USING GAS	3711
HOUSES OF CORRECTION	901
I—OCCUPANCIES	1401
ICE PLANTS	1201
INCINERATORS	
Chimneys for	3701
Construction of	3716
INCLINES (see GRADIENTS)	
INFLAMMABLE LIQUIDS (see FLAMMABLE LIQUIDS)	
INNER COURT WALLS (see TYPES OF CONSTRUCTION)	
INSPECTION	
By registered inspector.....	204
Final—required when	204
For change of occupancy	207
Of concrete units by Underwriters' Laboratories.....	2406
Of fire doors by Underwriters' Laboratories	4304
Of plans	202
Of plastering	204, 4701
Of roofing by Underwriters' Laboratories	4305
Of windows by Underwriters' Laboratories	4304
Required when	204
INSULATING MATERIAL	
Regulations for.....	2016, 2216
INTERIOR TRIM	
For Type I buildings	1816
For Type II buildings	1916
INTERIOR WALL (see WALLS)	
INTERPRETATION OF CODE	
By Board of Examiners and Appeals.....	304
By Building Inspector.....	302
IRON	
Cast—allowable working stresses	2702
Cast columns—painted, when.....	2718
Cast—specifications for.....	2701
Galvanized — for exterior walls.....	2205 (e)
Galvanized — for roofs	1109, 1209, 4305

	Section
J—OCCUPANCIES	1501
JAILS	901
JOINTS IN STEEL (see STEEL—STRUCTURAL)	
JOINTS IN WOOD	
Bolts	2508
Cylindrical pins	2510
Lag screws	2511
Nails	2512, 2525
Timber connectors	2509
Washers	2514
JOIST HANGERS	2519
JOISTS	
Concrete	2622, 3102
Fire protection of	4301, 4303
Steel	2715, 3103
Steel—tests required when	2715
Wood	2517, 3105
Wood—header and trimmer	2524 (k)
KEENE'S CEMENT	
Specifications for	4710
LADDERS	
As access to roof space	3205
LAITANCE	
Definition of	2603
LAMINATED FLOORS	2523, 3104
LANDING OF STAIRS	3307, 3308
LATERAL BRACING	2312
LATH	
Fiber board	4704
Gypsum	4301, 4703
Metal (see METAL LATH)	Chap. 47
Wood (see COMBUSTIBLE MATERIALS)	Chap. 47
LIBRARIES	
Seating more than 3500	601
Seating from 750 to 3500	701
Seating less than 750	801
LIFE OF PERMIT	305
LIGHT INCOMBUSTIBLE FRAME (see TYPE IV CONSTRUCTION)	
LIGHT STEEL CONSTRUCTION	2715
LIGHT—Requirements for	
During construction	4401
For exit signs	604, 804, 3312
For Group A occupancies	605
For Group B occupancies	705
For Group C occupancies	805
For Group D occupancies	905
For Group E occupancies	1005
For Group F occupancies	1105
For Group G occupancies	1205
For Group H occupancies	1305
For Group I occupancies	1405
For Group J occupancies	1505
For stairways and exits	3306

	Section
LIME	
Proportions for plaster.....	4708
Proportions for mortar.....	2410
Specifications for.....	2410
LINING	
Of chimneys	3701
Of existing walls	2941
Of patent chimneys	3704
Of smokestacks	3702
LINTEL	
Definition of	401
Fire-protection omitted when.....	1809 (a-2), 1909 (a-2)
Special construction	2906, 2913, 2918
LIQUIDS (see FLAMMABLE LIQUIDS)	
LIVE LOADS	
Concentrations of	2303
Definition of	401, 2301
For roofs	2305
Reductions allowed	2306
Required to be posted	2308
Special considerations	2303
Unit—for certain occupancies.....	2304
LOADING PLATFORMS	
May be of wood, when	1814, 1914, 2014
LOADS (see LIVE AND DEAD LOADS)	
During construction	2719
For retaining wall design	2310
Piles—bearing power of	2803
Soil—bearing capacity of	2802
LOBBIES IN THEATERS	
Obstructions	604 (1)
Size required	604 (a)
LOCATION IN FIRE ZONES—Requirements for	
Fire Zone No. 1	1602
Fire Zone No. 2	1603
Fire Zone No. 3	1604
LOCATION ON PROPERTY—Requirements for	
General requirements	504
Group A occupancies.....	603
Group B occupancies.....	703
Group C occupancies.....	803
Group D occupancies.....	903
Group E occupancies.....	1003
Group F occupancies.....	1103
Group G occupancies.....	1203
Group H occupancies.....	1303
Group I occupancies.....	1403
Group J occupancies.....	1503
LODGES	
Seating more than 3500	601
Seating from 750 to 3500.....	701
Seating less than 750.....	801
LODGING HOUSE	1301
LOT LINES (see LOCATION ON PROPERTY)	
LUMBER (see WOOD)	2501
MAINTENANCE	
Of buildings or structures.....	105
Of present safety devices	106
Requires authority from Building Inspector.....	105

	Section
MARQUEES (see TYPES OF CONSTRUCTION).....	4501 (d)
MASONRY	
Definition of.....	401, 2401
Materials classified.....	2411
Ordinary (Type III Buildings).....	2001-2016 incl.
Quality and design (see Chapter 24).....	
Special requirements.....	2412
Tests required.....	2401
Walls and partitions (see WALLS and Chap. 29).....	
Working stresses.....	2411
MASONRY VENEER (see VENEER)	
MATTRESS FACTORIES	1001
MEASUREMENT OF HEIGHTS	
Of buildings (see definition of HEIGHT).....	401
MECHANICAL VENTILATION (see VENTILATION)	
METAL	
As lath (see METAL LATH)	
As roof covering	4305
Exterior wall covering	2105, 2205
For enclosing patent chimneys	3704
Frames with wire glass	4304
Gas vents of	3703
Required for doors—when	4304
Smokestacks of	3702
METAL FRAME BUILDINGS (see TYPE IV BLDGS.)	
METAL LATH	
For fire-resistive construction	4301, 4302, 4303
For exterior and interior plastering.....	4705
For partitions.....	2937, 4302
For stucco reinforcing	2205, 4705
METHODS OF CALCULATIONS	2302
MEZZANINE OR MEZZANINE FLOOR	
Construction for Type I buildings.....	1816
Construction for Type II buildings	1916
Definition of	401
Group C occupancy.....	804
MILL CONSTRUCTION (see TYPE II BUILDINGS)	
MINIMUM REQUIREMENTS	
For classification by type of construction.....	1702
For fire protection of structural parts.....	4301, 4302, 4303
Purpose of Code.....	102
MIX	
For masonry mortars.....	2410
For reinforced concrete.....	2606-2609 (a)
MIXED OCCUPANCIES	
Separations required	503
MONASTERIES	1301
MORTAR	
For masonry construction.....	2410
For reinforced masonry.....	2411 (b)
May be mixed in street—how	4401
MOTION PICTURE MACHINE BOOTHS	
Construction and design	4001
For Group A occupancies	608
For Group B occupancies	708
For Group C occupancies	808
For Group D occupancies.....	908
Sprinkler requirements	3801

Section

MOTION PICTURE THEATERS (see THEATERS)**MOVING—OF BUILDINGS**

Permit required for	201
When in Fire Zone No. 1	1602
When in Fire Zone No. 2	1603
When in Fire Zone No. 3	1604

MUDSILL

Required when	2204, 2205, 2524

MUSEUMS

Seating more than 3500	601
Seating 750 to 3500	701
Seating less than 750	801

NATIONAL BOARD OF FIRE UNDERWRITERS

(See DOCUMENTS)

Fire-Resistive Standards	4602

NATIONAL FIRE PROTECTION ASSOCIATION

Oil burner equipment	3713
Protection of openings, against fire	4304

NEW MATERIALS OR METHODS.....302 (a)**NIGHT LIGHTS—**for stairs and exits..... 3306**NON-BEARING WALL (see WALLS)****NOTICES**

For inspections by Building Inspector	204
Of appeals	303
Of approval required	204
Of condemnation	301
Of registered inspector	204
Of violations	301

NURSERIES 901**OBSTRUCTIONS—PROHIBITED**

As locks on doors	3304
At fire doors	4304
At horizontal exits	3311
In Group A occupancies	604
In Group B occupancies	704
In Group C occupancies	804
In street gutter—when	4401
In stage ventilators	3901
In stairway enclosures	3308
On stairways or landings	3307

OCCUPANCY

Certificate of	206, 5101
Change in use	502
Classified by Building Inspector	501
Classified how	501, 503
Definition of	401
Existing buildings classified how	502
Group A	601
Group B	701
Group C	801
Group D	901
Group E	1001
Group F	1101
Group G	1201
Group H	1301
Group I	1401
Group J	1501
Mixed	503
Permanent—of public property	4501
Separations required	503
Temporary—allowed for construction purposes	4401,
When not specifically mentioned in Code	501

	Section
OFFICE BUILDINGS	1101
OIL	
Burners—general requirements	3713
Protection against saturating wood floors	1009
Storage of. (in occupancy).....908, 1001, 1008, 1108, 1208, 1308, 1408, 1508	1508
OLD PEOPLE'S HOMES	1301
OPENINGS	
Exterior—to be protected when (see LOCATION ON PROPERTY and FIRE ZONES)	
Vertical—to be protected when (see VERTICAL OPENINGS—ENCLOSURE OF)	
ORDINARY MASONRY BUILDINGS (see TYPE III BUILDINGS)	2001-2016, incl.
ORIEL WINDOW	
Construction of	3501
Definition of	401
ORPHANAGES	901
OUTSIDE STAIRWAYS	3316
OVERCROWDING PROHIBITED	
In Group A buildings	604 (1)
Where movable seats are used	2308
OVERLOADS OF FLOORS—not permitted	2308
OVERTURNING MOMENT	
For wind calculations	2307
OWNER	
Employs registered inspector, when	204
May occupy sidewalk space, when	1401, 4501
Occupies building, when	206
Permits storage of materials in street—when	4401
Required to post signs	2308, 3303, 3706, 3804, 3807
Required to repair buildings, when	301
Responsibility of, when adjoining	2801
PAINTING	
Of cast iron, when	2718
Of structural steel	2718
PAINT SHOPS	1001
PAINT STORAGE	1001
PANEL WALL	
Construction of	2939
Definition of	401
PANIC BOLTS—Required, when	
For smokeproof towers	3315
For stairway enclosures	3304
In Group A occupancies	604 (1)
In Group B occupancies	704
In Group C occupancies	804
In Group D occupancies	904
PAPER	
Tests for	2205, 4712
Waterproof—required when	2205, 4712
PARAPET WALL	
Construction of	2935
Definition of	401
For Type I buildings	1807
For Type II buildings	1905, 1907
For Type III buildings	2005, 2007
Required, when	2935

	Section
PARTITIONS	
Bearing—combustible	2524
Bearing—incombustible	2936
Fire resistance—classification of	4302
For frame construction	2524
General (see TYPES OF CONSTRUCTION)	
Non-bearing—incombustible	2937
PARTY WALL	
Definition of	401
May function as separation wall—when	2934
PASSAGEWAYS	
For Group A occupancies—with exits	604
For Group B occupancies—with exits	703, 704
For smokeproof towers	3315
Required for stairways, when	3313
To be sprinklered, when	3801
PASSENGER STATIONS	
Seating more than 3500	601
Seating from 750 to 3500	701
Seating less than 750	801
PATENT CHIMNEYS	3704
PEDESTAL	
Concrete—definition of	2603
Concrete—design of	2611, 2620
PENALTIES AND VIOLATIONS	
Provided by Code	305
PENTHOUSE	
For stairways—required when	3303
For Type I buildings	1815
For Type II buildings	1915
For Type III buildings	2015
For Type IV buildings	2115
For Type V buildings	2215
General requirements	3601
PERMIT	
Application for	201
Does not permit violation	305
Expires when	305
Fees doubled—when	203
Fees for	203
For alteration	201
For change of occupancy	207, 2309
For demolishing	201
For moving	201
For new buildings or structures	201
For storage of construction materials in street	4401
For temporary buildings	1602, 4401
For use or occupancy	206
Not valid, when	305
Plans required for	201
When required	201
PERSON	
Definition of	401
PETROLEUM STORAGE	1001
PHOTOGRAPHY	
Roof structures allowed for	3601
Special skylight construction for	3402

	Section
PIERS	
Hollow masonry	2912
Reinforced concrete	2917
Solid masonry	2905
PILES	
General requirements	2803
PIN-RAILS (see GRIDIRONS)	
PINS	
Allowable stresses	2702
General requirements	2713
PLAIN CONCRETE	
Definition of	2407
Quality and design	2407
Walls (see WALLS)	
Working stresses	2411
PLAN CHECKING	201
PLANING MILLS	1001
PLANS	
Approved by Building Inspector	262
Required for permit when	201
Shall bear name of whom	201
Show water-cement ratio when	2606
PLASTER AND PLASTERING	
As stucco (exterior)	2205, 4713, 4714
Cement, when not to be used	4715
Exterior	2205, 4713, 4714
Fire-resistive, classification of	4301, 4302
General	4701
Inspection of	204, 4701
Interior, general	4715
Materials for fire-resistive construction	4203
Over fibre board (interior)	4715
Over masonry (interior)	4719
Over metal lath (interior)	4715, 4718
Over wood lath (interior)	4715
Over plaster lath (interior)	4715
Pneumatically placed (exterior or interior)	4714
Reinforcing for	4709
Sand	4707
Staff	4721
Suspended ceiling	4706
With cement (interior)	4720
With hardwall gypsum (interior)	4717
With lime mortar (interior)	4716
PLASTERBOARD—GYPSUM	
For fire resistance—ceilings	4301
For fire resistance—partitions	4302
PLATE	
In bearing partitions	2524
Sill (see MUDDSILL)	
PLATE GIRDERS	2704
PLATFORM	3906
PLYWOOD	
Definition	2503 (d)
Nails	2525
PNEUMATICALLY PLACED STUCCO	
Definition and method of placing	4714
POLICE STATIONS	1101
PORCHES (see TYPES OF CONSTRUCTION)	
May project—when	4501 (a)

	Section
PORTLAND CEMENT	
Definition of	2603
For plaster	4711
In masonry mortar	2410
Specifications for	2604 (a), 4711
Storage of	2604 (e)
POWER PLANTS	1201
PRESSURE TANKS	
For wet standpipe supply	3806
PRINTING PLANTS	1101
PRISONS	901
PRIVATE GARAGE (see GARAGE, PRIVATE)	
PROJECTIONS FROM BUILDING (see TYPES OF CONSTRUCTION)	
Awnings	4501 (b)
Bays and balconies	3501
Below sidewalk	4501 (g)
Cornices, marquees, etc.	4501
In alleys—when	4501 (h)
Permanent (allowed over public property)	4501
PROPERTY ROOMS, GROUP A OCCUPANCIES (see STORE ROOMS)	
PROSCENIUM	
Construction of	4101, 4102
Sprinklering of opening required	3801
Wall	3904
Wall openings allowed	3904
PROSCENIUM CURTAIN	
Asbestos cloth—type of	4102
Automatic controls for	4104
Design of	4103
General requirements	4101
Materials	4102
New designs of	4106
Operation of	4104
Operation—required when	4101
Required where	3904
Tests of	4105
PUBLIC GARAGES (see GARAGE, PUBLIC)	
PUBLIC PROPERTY	
Permanent use of	4501
Temporary use of	4401
PUMPING PLANTS	1201
PUMPS	
For oil burning equipment	3713
For part of oil storage equipment	1008
For wet standpipe supply	3806
PURPOSE	
Of Code	102
QUALITY AND DESIGN OF THE MATERIALS OF CONSTRUCTION	
Masonry	2401-2412, incl.
Reinforced concrete	2601-2622, incl.
Steel and iron	2701-2718, incl.
Wood	2501-2529, incl.
RADIO TOWERS	3602
RAFTERS (see ROOF CONSTRUCTION)	
RAILWAY STATIONS	
Passenger	601, 701, 801
RAMPS	
Construction of	3310
Enclosure for	606, 1006
For automobile storage	1004
For hospitals and sanitariums	904

	Section
For temporary walk-way	4401
Gradient of	602, 604
Required	604
Substituted for stairways, when	3310
RANGE HOODS	3712
RANGES--GAS	
Domestic	3711
For restaurants and hotels	3712
RECESSES	
In hollow masonry	2913, 2933
In reinforced concrete	2918
In solid masonry	2906, 2932
In stone	2923
Not allowed, when	4302
REDUCTIONS OF LIVE LOADS	2306
REDWOOD	
Mudsills	2204, 2205
Piles	2803
Working stresses	2503
REFORMATORIES	901
REFRIGERATION	
Definitions	4902
General	4901
Scope	4903
REGISTERED INSPECTOR	
Defined	204
Duties of	204
Required when	204
Termination of duties, when	205
REGISTERS	
Equipped with fusible links—when	605
For warm air ducts	3715
REGISTRATION—CERTIFICATE OF	
Fee for	204
Issued by Building Inspector	204
REINFORCED CONCRETE	
Aggregates—quality of	2604 (b)
Anchorage of reinforcement	2618
Assumptions for design	2611
Beams—composite	2623
Beams—depth of	2614 (c)
Beams—lateral support for	2614 (b)
Bonds for anchorage	2618
Bonding—of concrete	2609 (h)
Columns—bending in	2620 (h) (i)
Columns—combination	2620 (f)
Columns—combined compressive and tensile stresses	2620 (j)
Columns—composite	2620 (c)
Columns—design of	2620 (e)
Columns—long	2620 (h)
Computations—flexural	2614
Concrete—quality of	2606
Consistency—of mix	2607
Construction joints	2610 (g)
Curing	2609 (f)
Definitions—of certain words	2603
Depositing in cold weather	2609 (g)
Design—assumptions for	2611
Design—formulas for fully restrained conditions	2616
Design—general	2602
Diagonal tension	2617
Fire-protection of (see TYPES OF CONSTRUCTION)	4301
Flat slab—design and construction	2619
Flat slab—shear in	2617 (g)
Footings—anchorage for steel	2618 (e)
Footings—design of	2621, 2801 to 2803 incl.

	Section
Footings—shear in	2621 (d)
Forms—cleaning of	2609 (b)
Forms—construction of	2610 (a)
Forms—removal of	2610 (b)
Joists—precast	2622
Load tests	2606
Materials—specifications of	2604
Materials—storage of	2604 (e)
Materials—tests of	2605
Mixing—of concrete	2609 (a)
Notation—for formulas used	2612
Placing—of concrete	2609 (e)
Portland cement—quality of	2604 (a)
Proportions—control of	2608
Proportions of mix	2606, 2607
Quality of materials	2601, 2604
Reinforcement (see REINFORCEMENT)	2613
Ribbed floor construction	2614 (e)
Shear and diagonal tension	2617
Shear in flat slabs	2617 (g)
Slabs—thickness of	2614 (c)
Slabs, two-way	2616
Stresses—maximum allowable	2613, 2614
Symbols for formulas	2612
Tests of materials	2606
Transporting	2609 (d)
Walls of (see WALLS)	
Web reinforcement—anchorage of	2618 (d)
Web reinforcement—design of	2617
REINFORCED MASONRY	
Mortar for	2410
Working stresses	2411 (b)
REINFORCEMENT	
Bending of	2610 (c)
Cleaning of	2610 (c)
Compression steel—beams	2614 (f)
Effective area of—definition	2603
For columns—reinforced concrete	2620
For flat slabs—reinforced concrete	2619
For stucco	2205 (c), 4705, 4709
For T-beams—reinforced concrete	2614 (d)
For web (diagonal tension)—concrete	2617
Negative—definition of	2603
Of fire protection	4203, 4301
Offsets in	2610 (e)
Placing—in reinforced concrete	2610
Positive—definition of	2603
Protection of	2610 (f)
Ratio—definition of	2603
Shrinkage	2616
Specifications for	2604 (d)
Splices of	2610 (e)
Stress—allowable working	2613
Temperature	2615
REPAIR	
Applied to change of use	104, 301
Definition of	401
Of existing buildings	104
REPORTS—Required	
Of Board of Examiners and Appeals	304
Of fees collected by Building Inspector	203
Of registered inspector	204
Of tests of concrete	2605
Of tests of structural steel	2701
REQUIREMENTS BASED ON LOCATION IN FIRE ZONES (see Part IV)	
Fire zones defined	1601
For Fire Zone No. 1	1602
For Fire Zone No. 2	1603
For Fire Zone No. 3	1604

Section

REQUIREMENTS BASED ON OCCUPANCY

Classification of all occupancies.....	501- 503, incl.
For Group A occupancies (large assemblage).....	601- 610, incl.
For Group B occupancies (medium assemblage).....	701- 710, incl.
For Group C occupancies (small assemblage).....	801- 810, incl.
For Group D occupancies (hospitals and detention).....	901- 910, incl.
For Group E occupancies (highly hazardous).....	1001-1010, incl.
For Group F occupancies (moderately hazardous).....	1101-1110, incl.
For Group G occupancies (non-hazardous).....	1201-1210, incl.
For Group H occupancies (hotels and apartments).....	1301-1310, incl.
For Group I occupancies (dwellings).....	1401-1410, incl.
For Group J occupancies (accessory).....	1501-1510, incl.

REQUIREMENTS BASED ON TYPES OF CONSTRUCTION

Classification of buildings.....	1701, 1702
Type I buildings (fire-resistive).....	1801-1816, incl.
Type II buildings (heavy timber construction).....	1901-1916, incl.
Type III buildings (ordinary masonry).....	2001-2016, incl.
Type IV buildings (light incombustible frame).....	2101-2116, incl.
Type V buildings (wood frame).....	2201-2216, incl.

RESISTING MOMENT—DEAD LOAD

For wind calculations.....	2307

RESTAURANTS

.....	1101

RETAIL STORES

.....	1101

RETAINING WALL

Definition of.....	401
Design of.....	2310
Used as foundation walls for Type V buildings.....	2204

REVIEWING STANDS

Occupancy provisions.....	801
Permitted in Fire Zone No. 1, when.....	1602
Fire protection of.....	601, 701

RIBBON—In Frame Construction

.....	2517

RISERS

For dry standpipes.....	3804
For stairways.....	3307
For warm air furnaces.....	3715
For wet standpipes.....	3806

RIVETS

Construction details.....	2711
General.....	2709
Holes—to be deducted, when.....	2707
In connections.....	2708
In erection work.....	2719
To be driven how.....	2717
Working stresses for.....	2702

ROLLING SHUTTERS—Prohibited Where

.....	3304

ROOF CONSTRUCTION (see TYPES OF CONSTRUCTION)

Access to roof.....	3303
Access to roof space.....	3205
Construction and design.....	3202, 3203
Covering of.....	3204, 4305
Divided how.....	8205
Drainage.....	8206
General.....	3201
Of marquee.....	4501 (d)
Rafters.....	3203 and Chap. 25

ROOFING (see TYPES OF CONSTRUCTION)

Classified—all types.....	4305
Composition.....	4306
Felt, definition of.....	4305 (b)
Fire-retardant—details for.....	4305 (c)
Ordinary—details for.....	4305 (d)
Roll roofing, definition of.....	4305 (b)

ROOF STRUCTURES

Building requirements (see PENTHOUSE)	
General requirements.....	3601
Includes what.....	3601

	Section
ROOM CAPACITY, DEFINED	401
BUBBLE MASONRY	
Bond	2922
Chases and recesses	2923
Lateral support	2921
Thickness	2921
Working stresses	2920
RUNNING TRACKS (see GYMNASIUMS)	
SALES ROOMS	
For combustible goods	1101
For incombustible goods	1201
SAND	
For concrete	2604 (b)
For mortar	2410
For plaster	4707
SAND LIME BRICK—(see BRICK—SAND LIME)	
SANITARIUMS	901
SCHOOLS	
General requirements	801-810
See Appendix Chapter A8	
SCOPE	
Of Code	103
SCUTTLE	
Access to roof space	3205
Access to roof—when required	3303
SEATING CAPACITY	
Definition of	401
Of Group A occupancies	601
Of Group B occupancies	701, 702
Of Group C occupancies	801
Required to be posted, when	2308
SEATS	
For Group A occupancies	604 (g)
For Group B occupancies	704
For Group C occupancies	804
Number of—to be posted when	2308
SELF-CLOSING DOOR	
For attic partitions	3205
For automobile ramp enclosures	1006
For fire doors	3401
For horizontal exits	3311
For motion picture machine booths	4001
For ramp enclosures	3310
For smokeproof towers	3316
For stairway enclosures	3304
SERVICE STATIONS—GASOLINE (see GASOLINE SERVICE STATIONS)	
SHALL	
Definition of	401
SHAFT	
Construction—general	3003
Construction of enclosing walls	3002
Definition of	401
Required to be enclosed—when (see TYPES OF CONSTRUCTION)	
Special requirements (see OCCUPANCY GROUPS and TYPES OF CONSTRUCTION)	3001
SHEAR	
In reinforced concrete—allowable stresses	2614
In reinforced concrete—design of	2617
In structural steel	2702
In wood, horizontal	2508, 2604
In wood, longitudinal	2506

SHEATHING, WALL	Section 2306
SHINGLES AND SHAKES	
As roof covering	4305
As siding	2305 (b)
SHOW WINDOWS	
In Type I buildings	1816
In Type II buildings	1916
May project over property line	4501 (f)
SHUTTERS	
For fire-resistive construction	4304 (b)
For motion picture machine booths	4001
Required for stage vent ducts	3901
Rolling—prohibited where	3304
SIAMESE CONNECTIONS	
For dry standpipes	3904
For wet standpipes	3806
SIDEWALKS	
Glass lights in	3402
Live load for design of	2304
Railing required around, when	3402
Required to be protected, when	4401
Space under—may be occupied when	4501 (g)
SIGNS	
For basement pipe inlets	3807
For dry standpipes	3804
For exit—Group A	604 (j)
For exit—Group B	704
For exit—Group C	804
For false fireplace	3706
For gas shut-off—Group A	608
For gas shut-off—Group B	708
For gas shut-off—Group C	808
For gas shut-off—Group D	908
For live load—required	2308
For seating capacity—required	2308
For stage curtains	4104
For stairs	3312
For wet standpipes	3806
SKYLIGHTS	
General requirements (see TYPES OF CONSTRUCTION)	3402
SLAB	
Gypsum	2411 (e)
Minimum thickness—for fire-resistive purposes	4303
Minimum thickness—for floors	3102, 3103
Minimum thickness—for roofs	3202
Reinforced concrete (see REINFORCED CONCRETE)	
SLATE	
For roof covering	4305
SLEEPERS—WOOD	
To be divided—how	1810
SMOKE	
Curtain to be tight for	4103
Pipes for	3705
Stacks for	3702
Test for chimney	3701
SMOKE PIPES	
	3705
SMOKEPROOF TOWER—REQUIRED	
Construction and design	3315
For Group A occupancies	604 (k)
For Group B occupancies	704

	Section
For Group C occupancies.....	804
For Group D occupancies.....	904
For Group E occupancies.....	1004
For Group F occupancies.....	1104
For Group G occupancies.....	1204
For Group H occupancies.....	1304
Where and when	3315
SMOKE VENTS	
Over stage	3901
SOIL	
Bearing allowable	2802
Retaining walls for.....	2310, 2938
Tests required	2802
SOLID MASONRY (see MASONRY)	
Definition of	401, 2401
SOLID MASONRY WALLS (see WALLS)	
SPECIFICATIONS (see also DOCUMENTS)	
May be required for permit.....	201
SPIRES (see TOWERS)	
SPLICES	
Reinforcing steel	2610 (e)
Structural steel	2706
SPRINKLERS—AUTOMATIC (see AUTOMATIC SPRINKLERS)	
STADIUMS	802
STAGE	
Construction—Group A (see Chapter 39).....	602
Construction—Group B (see Chapter 39).....	702
Construction—Group C (see Chapter 39).....	802
Curtain	4101
Exits from	3907
Floors	3906
Gridirons	3902
Proscenium opening	3904
Rooms accessory to	3903
Separated from auditorium by wall.....	3904
Sprinklers required	3901
Standpipes required	3906
Switchboard hood	3908
Ventilation of	3901
STAIRS	
Access and arrangement	3303, 3313
Access to roof	3303
Application to building—general (see occupancy GROUP and TYPES OF CONSTRUCTION)	
Design—general	3302
Doors—leading to	3304
Enclosures for	3308
Exceptions	3314
Firestopping (wood frame construction).....	2526
Headroom clearance	3307
Horizontal exits—affect number required.....	3311
In smokeproof tower	3315
Intermediate landings	3302, 3307
Lighting	3306
Locks—if provided	3304
May terminate at second floor—when.....	3303
Maximum separation	3303
Number required (see also GROUP A, B, C or D).....	3309
Number required—may be reduced when.....	3302, 3309
Obstructions prohibited	3304, 3308

	Section
Outside of building	3316
Passageways required	3303, 3313
Railings	3305
Ramps—may be substituted	3310
Requirements—detailed	3307
Requirements—general	3301, 3302
Rise and tread	3302, 3307
Signs required	3303, 3312
Ventilation of enclosure	3308
Width—minimum	3307
Winders—permitted when	3302
STANDPIPES	
Dry standpipes—design and construction	3304
Dry standpipes—where required	3303
Wet standpipes—design and construction	3306
Wet standpipes—where required	3305
STATE LAWS	
Governing Group E	1008
Governing Group H	1303, 1306
Governing Group I	1405
STEAM HEATING PLANTS—Low Pressure	3708
STEEL—STRUCTURAL	
Allowable unit stresses	2702, 2715
Beams and girders	2704
Bearing plates and anchorage	2714
Bolts	2709
Cast—allowable stresses for	2702
Cast—properly annealed	2717
Combined stresses	2702 (f)
Connections in	2708
Construction details	2711, 2715
Crane runways	2704 (e)
Design	2701
Eccentric loads	2703
Erection of	2719
Expansion	2716
Fire-protection of (see also TYPES OF CONSTRUCTION)	4301
Gas cutting	2717
Girders, plate	2704
Joints—design of	2715
Lattice—design of	2712
Light steel construction	2715
Net sections—in computations	2707
Quality	2701
Painting of	2718
Plas	2713
Plumbing of frame	2719
Rivets	2709, 2717
Roller loads	2702 (h)
Splices—compression	2706
Stresses, allowable unit	2702, 2715
Tension members—net section	2707
Tests of	2701
Thickness of—minimum	2705
To be painted, when	2718
Trusses—design of	2711
Welded connections	2710
Working stresses—allowable	3702, 2710
Workmanship	2717
STIFFENERS	2704 (d)
STIRRUPS REQUIRED	
Concrete	2617
Wood	2519
STONE	
Facing of	2928
Quality and design	2411 (f)
Veneer of	2924
Walls of (see WALLS)	

	Section
STORAGE	
Combustible goods	1101
Film	Chapter 48
Incombustible goods	1201
STORAGE OF FLAMMABLES	105, 202, 207, 1001 and 608-1508 incl.
STORAGE OF MATERIALS IN STREETS	4401
STORES—RETAIL AND WHOLESALE	1101
STOREROOMS—GROUP A, B AND C OCCUPANCIES	
Fire protection of.....	3903
Flammable liquids—storage regulated.....	608, 708, 808
Location of.....	3903
STORY	
Definition of	401
STOVES	
Chimneys for	3701, 3704
General requirements	3710
STREET	
Definition of	401
Permanent use of.....	4501
Temporary use of.....	4401
STRENGTH OF MATERIALS (see QUALITY AND DESIGN OF THE MATERIALS OF CONSTRUCTION)	
STRESSES—OF MATERIALS OF CONSTRUCTION (see WORKING STRESSES—ALLOWABLE)	
STRUCTURAL FRAMEWORK (see TYPES OF CONSTRUCTION)	
STUCCO (see PLASTERING)	
STUD FRAME CONSTRUCTION	2524
STUDS—Minimum size	2524
SUSPENDED CEILINGS	
For fire protection	4301
Method of hanging	4706
Required to support load	4301, 4706
SYMBOLS (see ABBREVIATIONS)	
TANKS	
For oil burning equipment	3713
For storage of flammable liquids	1008
For wet standpipe supply	3506
Horizontal forces, design for.....	2312
Roof structures for	3601
Water	1501
T-BEAMS IN REINFORCED CONCRETE	2614 (d)
TEMPORARY BUILDINGS	
Permitted during construction	1602, 4401
Permitted in fire zones.....	1601 (d)
TEMPORARY PARTITIONS	
For Type I buildings	1806
For Type II buildings.....	1906
For Type III buildings	2006
TENANT'S RESPONSIBILITY	2308
TESTS	
For brick.....	2401-2404, incl.
For cast iron	2701
For cast steel	2701
For chimneys	3701
For clay tile.....	2401-2405
For clay roofing tile.....	4306

	Section
For concrete	2605, 2613
For concrete aggregates	2604 (b)
For dry standpipes	3804
For fire-resistive ratings of materials	4201
For metal reinforcement	2604 (d)
For new materials and devices	302, 303
For pile—safe bearing	2803 (e)
For portland cement	2604 (a)
For proscenium curtains	4101, 4105
For soil bearing	2802
For sprinkler systems	3802
For stage ventilators	3901
For structural steel	2701
For wet standpipes	3806
May be required	302 (b)
Of masonry materials	2401
Of steel joists, when	2715 (g)
THEATERS	
Seating capacity 1000 or more	601
Seating capacity 300 to 1000	701
Seating capacity less than 300	801
THIMBLES IN CHIMNEYS	3705
TIE RODS	
Design of	2711
Fire-protection of	4301
In floor construction—fire-protection required	4303
TILE	
Of clay (see CLAY TILE)	
Of concrete (see CONCRETE BLOCKS)	
Of gypsum (see GYPSUM)	
TIMBER (see WOOD)	
TITLE	
Of Code	101
Reference—"this Code"	101
TOILETS REQUIRED	
For Group E occupancies	1005
For Group F occupancies	1105
For Group G occupancies	1205
For Group H occupancies	1505
TOWERS (see TYPES OF CONSTRUCTION)	
General requirements	3602
Horizontal forces, design for	2312
Wind pressure	2307
TRAP DOORS, STAGES	3905
TRIM	
For Type I buildings	1816 (3)
For Type II buildings	1916 (3)
TRIMMER ARCHES—FOR FIREPLACES	3706
TRUSSES	
Fire-protection of (see TYPES OF CONSTRUCTION)	4301
Steel frame	2711 (a)
TYPES OF CONSTRUCTION	
Classified how	1701
Classification of buildings	1702
TYPE I or TYPE I BUILDINGS	
Area allowable	1803
Bays and balconies	1814, 3501
Combustible materials regulated	1816
Cornices	1814, 4501
Definition of	1801
Design, general	1808
Doors and windows	1813, 3401
Drainage fill on roofs	1811
Enclosure of vertical openings	1807
Exterior openings—protection required	1813

	Section
Fire-protection—floor construction.....	1810
Fire-protection—may be omitted, when.....	1209, 1809
Fire-protection—of structural frame.....	1809
Floor construction.....	1810
Foundations.....	1804
Height allowable.....	1802
Marquees.....	1814
Mezzanine floors.....	1816
Parapet wall—required when.....	1807, 2935
Partitions, interior.....	1806
Partitions, temporary.....	1806
Penthouses.....	1815, 3601
Projections from buildings.....	1814
Roof construction.....	1809, 1811, 1816
Roof structures.....	1815, 3601
Shafts—construction of.....	1807
Show windows.....	1816
Skylights.....	1815, 3402
Stairs.....	1812
Structural framework.....	1808
Structural members, fire-protection of.....	1809
Trim.....	1818
Vertical openings, enclosure of.....	1807
Walls—exterior and inner court.....	1805
Windows and doors.....	1813, 3401
Wood platforms—permitted when.....	1814

TYPE II OR TYPE II BUILDINGS

Area allowable.....	1903
Bays and balconies.....	1914, 3501
Combustible materials—regulated.....	1914, 1916
Cornices.....	1914, 4501
Definition of.....	1901
Doors and windows.....	1913, 3401
Enclosure of vertical openings.....	1907
Exterior openings—protection of.....	1913
Fire-protection of structural frame.....	1909
Fire-protection—may be omitted when.....	1909
Floor construction.....	1910
Foundations.....	1904
Height allowable.....	1902
Marquees.....	1914, 4501
Mezzanine floors.....	1916
Parapet walls.....	1905, 1907, 2935
Partitions.....	1906
Penthouses.....	1915, 3601
Projections from building.....	1914
Roof construction.....	1909, 1911
Shafts.....	1907
Show windows.....	1916
Skylights.....	1915, 3402
Stair construction.....	1912
Structural framework.....	1908
Structural members—fire-protection of.....	1909
Towers and spires.....	1902, 3602
Trim.....	1916
Vertical openings—enclosure of.....	1907
Walls—exterior and inner court.....	1905
Walls—parapet.....	1905, 1907, 2935
Windows and doors.....	1913, 3401

TYPE III OR TYPE III BUILDINGS

Area Allowable.....	2003
Attic space—divided how.....	2011, 3205
Basement—special construction.....	2010
Bays and balconies.....	2014, 3501
Combustible materials regulated.....	2014, 2016
Cornices.....	2014, 4501
Definition of.....	2001
Doors and windows.....	2013, 3401
Enclosure of vertical openings.....	2007
Fire-protection—may be omitted when.....	2009
Fire-protection structural members.....	2009
Floor construction.....	2010
Foundations.....	2004

	Section
Height allowable	2002
Insulating materials—placed how	2016
Marquees	2014, 4501
Parapet walls	2007, 2935
Partitions	2006
Partitions—temporary	2006
Penthouses	2015, 3601
Projections from buildings	2014
Roof construction	2011
Shafts	2007
Skylights	2015, 3402
Stair construction	2012
Structural framework	2008
Towers and spires	2002, 3602
Vertical openings, enclosure of	2007
Walls—exterior and inner court	2005
Walls—parapet	2007, 2935
When 4 stories or more in height	2006, 2010
Windows and doors	2013, 3401

TYPE IV OR TYPE IV BUILDINGS

Area allowable	2103
Attic space—Divided how	3205
Combustible materials—regulated	2114, 2116
Cornices	2114, 4501
Definition of	2101
Doors and windows	2113, 3401
Fire-protection—may be omitted when	2109
Floor construction	2110
Foundations	2104
Height allowable	2102
Marquees	2114, 4501
Partitions	2106
Penthouses	2115, 3601
Projections from the building	2114, 3501, 4501
Roof construction	2111
Skylights	2115, 3402
Stair construction	2112
Structural framework	2108
Towers and spires	2102, 3602
Vertical openings—enclosure of	2107
Walls—exterior	2105
Windows and doors	2113, 3401

TYPE V OR TYPE V BUILDINGS

Area allowable	2203
Attic spaces—divided how	3205
Ceiling construction	2208
Combustible materials regulated	2216
Definition of	2201
Design—general requirements	2208
Doors and windows	2213, 3401
Enclosure of vertical openings	2207
Fire-protection—may be omitted	2209
Floor construction	2210, 3105
Foundations	2204
Foundations—ventilating openings	2527
Height allowable	2202
Insulating materials—regulated	2216
Partitions—interior	2206
Penthouses	2215
Projections from buildings	2214
Roof construction	2211, Chap. 32
Roof covering	2211, 4305
Roof structures	2215, 3601
Shafts	2207
Sheathing, exterior	2205
Skylights	2215
Stairs	2212
Structural framework	2208
Towers and spires	2202, 3602
Ventilation under first floor	2527
Vertical openings—enclosure of	2207
Wall coverings (siding, stucco, veneer, etc.)	2205
Walls—exterior	2205
Windows and doors	2213

	Section
UNDERPINNING—	
Required, when.....	2205, 2524 (i), 2801
UNDERTAKING PARLOES	1101
UNDERWRITERS' LABORATORIES, INC.—Inspection service	
On doors	4304
On hollow concrete building units	2406
On roofings	4305
On windows	4304
UNIT STRESSES (see WORKING STRESSES)	
UNLAWFUL TO OCCUPY—When.....	206, 301
VACATE	
Required, when.....	301
VALIDITY	
Of this ordinance.....	4601
VALUATION	
Of buildings by Building Inspector.....	203
VALUE	
Definition of	401
VENEER	
Definition of	401
For masonry walls.....	2924
Over wood frame.....	2205 (d)
Walls of (see WALLS)	
VENTILATION	
As air supply for warm air furnace.....	3707
For automobile storage.....	1005, 1605
For Group A occupancies.....	605
For Group B occupancies.....	705
For Group C occupancies.....	805
For Group D occupancies.....	905
For Group E occupancies.....	1005
For Group F occupancies.....	1105
For Group G occupancies.....	1205
For Group H occupancies.....	1305
For Group I occupancies.....	1405
For Group J occupancies.....	1505
For stairway enclosures	3308
In dry cleaning establishments	1008
In motion picture machine booths	4001
In private garages	1505
Over stage.....	3901
Under first floor of Type V buildings.....	2527
VENTS	
For dry cleaning plants	1008
For gas	3703
For motion picture machine booths	4001
For private garages	1505
For public garages	1005
For stages	3901
Intake for warm air furnaces	3707
VENT SHAFTS (see VERTICAL OPENINGS)	
VERTICAL OPENINGS—ENCLOSURE OF	
For ducts and chutes	3003
For Group A occupancies.....	606
For Group B occupancies.....	706
For Group C occupancies.....	806
For Group D occupancies.....	906
For Group E occupancies.....	1006
For Group F occupancies.....	1106
For Group G occupancies.....	1206
For Group H occupancies.....	1306
For Group I occupancies.....	1406
For Group J occupancies.....	1506
For Type I buildings.....	1807

	Section
For Type II buildings	1907
For Type III buildings	2007
For Type IV buildings	2107
For Type V buildings	2207
General requirements	3002
Other vertical openings	3003
When required	3001

VIOLATIONS AND PENALTIES

Provided in this Code	305

WALLS

Anchoring of	2940
Are bearing partitions when	2936
As foundations—general requirements	2938
Construction required (see OCCUPANCY GROUP and TYPES OF CONSTRUCTION)	
Definition of	401
Design of	Chapter 29
Extension of use when existing	2941
Faced—bond for	2931
Faced—quality of material	2928
Faced—thickness of	2930
Faced—working stresses	2929
Foundation	2938
Hollow masonry—beam supports	2911
Hollow masonry—bearing of unprotected steel members	2933
Hollow masonry—bearing partitions	2936
Hollow masonry—bond	2910
Hollow masonry—chases and recesses	2913
Hollow masonry—fire-resistive classification	4302
Hollow masonry—General provisions	2907
Hollow masonry—panel and enclosure	2939
Hollow masonry—piers	2912
Hollow masonry—thickness of exterior	2909
Hollow masonry—working stresses	2908
Of bays and oriel windows	3501
Of motion picture machine booths	4001
Of roof structures	3601
Of smokeproof towers	3315
Of stairway enclosures	3308
Of vertical openings	3002
Panel and enclosure	2939
Parapet—general requirements	2935
Partitions (see PARTITIONS)	
Party	2934
Reinforced concrete—anchorage and reinforcement	2916
Reinforced concrete—chases and recesses	2918
Reinforced concrete—general provisions	2914
Reinforced concrete—piers	2917
Reinforced concrete—thickness of exterior	2915
Reinforced concrete—working stresses	2914
Solid masonry—bearing partitions	2936
Solid masonry—bond	2904
Solid masonry—chases and recesses	2906
Solid masonry—fire-resistive classification	4302
Solid masonry—foundation walls	2938
Solid masonry—general provisions	2901, 2932
Solid masonry—panel and enclosure	2939
Solid masonry—piers	2905
Solid masonry—thickness of exterior	2903
Solid masonry—separation of combustible members	2932
Solid masonry—working stresses	2902
Stone—bond	2922
Stone—chases and recesses	2923
Stone—lateral support and thickness	2921
Stone—quality of material	2919
Stone—working stresses	2920
Veneered—allowable height of	2927
Veneered—attachment of	2926
Veneered—quality of material	2924
Veneered—working stresses	2925
Veneered—on wood	2205
Wood stud walls	2524

	Section
WASHERS	2514
WATER	
Removal from excavations, when.....	2609 (c)
Requirements for concrete	2604 (c)
Retaining walls—design of	2310
Supply for automatic sprinkler system	3802
Supply for wet standpipes	3806
WATER-CEMENT RATIO	
Consistency required	2607
Control of proportions	2608
Requirements for use	2606
WATER-CLOSET	
For Group E occupancies.....	1005
For Group F occupancies.....	1105
For Group G occupancies.....	1205
For Group H occupancies.....	1305
WATER PRESSURE	
In wet standpipes	3806
Walls to resist—design of	2310
WEATHER	
Affects concrete construction—How.....	2609 (g)
WEATHERBOARDING	2205
WELDING	
Connection—stresses allowed	2710
Electric spot	2710
Electrode wire for.....	2710
For steel joists.....	2715 (g)
WET STANDPIPES (see STANDPIPES)	
WHOLESALE STORES	1101
WIDTH	
Of aisles	604, 704, 804
Of corridors	3313
Of entrance doors.....	604, 704, 804
Of passageways from courts—Group A occupancies.....	604 (b)
Of passageways from smokeproof towers	3315
Of stair landings	3307
Of stairs	3307
Of stair treads	3302, 3307
Of street allowed for storage	4401
WIND	
For roof design	2305
Increased stresses for	2307
In erection—to be provided for.....	2719
Pressure for vertical surfaces	2307
Steel—increased stresses for	2702
WINDOWS	
General requirements	3401
Fire-resistive—design of	4304 (c)
For Group A occupancies	603, 605
For Group B occupancies	703, 705
For Group C occupancies	803, 805
For Group D occupancies.....	903, 905
For Group E occupancies	1003, 1005
For Group F occupancies	1103, 1105
For Group G occupancies	1203, 1205
For Group H occupancies	1303, 1305
For Group I occupancies	1403, 1405
For Group J occupancies	1503
In Fire Zone No. 1.....	1602 (c)
In Type I buildings	1813
In Type II buildings	1913
In Type III buildings	2013
In Type IV buildings	2113
In Type V buildings	2213

Section

WIND PRESSURE

Design requirements and stresses	2307
Steel stresses may be increased for	2702

WIRE

For proscenium curtain reinforcing	4102
For stucco reinforcing	2205, 4705
For tying roofing materials	4305
Ties for fire-resistive materials	4301

WIRE GLASS

In fire-resistive doors	4304 (a)
In fire-resistive windows	4304 (c)
In skylights—when	3402
Required by location (see LOCATION ON PROPERTY, FIRE ZONES, DOORS AND WINDOWS)	

WIRE LATH (see METAL LATH)**WIRE MESH REQUIRED**

For exterior plaster	2205, 4705
For skylights—when	3402
For stage ventilators—when	3901
Over gypsum plaster lath—when	4301, 4302

WOOD

Allowable stresses tabulated—flexure	2503
Anchors and ties	2518
Beams and joists—may be cut, when	2521
Beams and girders	2517-2521 incl.
Bridging	2520
Built up members in compression	2516
Ceiling joists—deflection of	2522
Columns—allowable unit stresses	2505
Columns—or posts	2505, 2515
Combined stresses	2506
Compression members—built up	2516
Compression on inclined surfaces	2507
Deflection	2524
Diaphragms	2528
Firestops—required	2526
Floors—laminated	2523
General requirements	2501
Horizontal members—framing details	2517
Horizontal shear	2504
Joists	2517-22 incl., 2524 (k)
Longitudinal shear	2504
Partitions—framing details	2524
Piles of	2303 (b)
Plaster lath	4702
Plywood, definition	2503 (d)
Plywood, nails	2525
Required sizes—determination of	2502
Roof framing	3203
Separation required between members	2932, 4302
Shear—horizontal	2504
Sheathing	2525
Shingles—for exterior walls	2205
Shingles—for roofs	4305
Siding	2205
Structural lumber	2503 (b)
Stud walls—framing details	2524
Sub-floor	2525
Unit stresses—decrease for exposure	2503 (e)
Unit stresses—intermittent load	2503 (f)
Unit stresses—may be decreased, when	2503 (d)
Use—conditions defined	2503
Ventilation—underfloor	2527
Yard lumber	2503 (c)
Walls of	1905, 2005, 2205
Weatherboarding	2205

Section

WOOD CONNECTIONS

Bolts, design loads.....	2508
Connectors	2509
General	2525
Joints bolted	2508
Lag screws	2511
Nails	2513
Pins	2510
Screws	2511, 2512
Washers	2514

WOOD FRAME BUILDINGS (see TYPE V BUILDINGS)....2201-2216, incl.**WOODWORKING FACTORIES** 1001**WORDS—Special Meaning of**

For reinforced concrete	2603
General	401

WORKING STRESSES—ALLOWABLE

Cast iron	2702
Cloth— asbestos curtain	4102
Increase allowed—masonry.....	2412
Increase allowed for seismic forces.....	2312
Increase allowed—steel and iron.....	2702
Increase allowed for wind.....	2307
Increase allowed—wood.....	2503 (e)
Masonry construction	2411
May be increased.....	2307, 2312
Piles	2808
Reinforced concrete.....	2613, 2614
Soil	2802
Steel	2702, 2710
Wood	2503

WORKMANSHIP

Inspection of	204
Structural steel	2717

WORKSHOPS

In Group A, B and C occupancies.....	3801, 3903
Moderately hazardous	1101
Non-hazardous	1201

YARD

Definition of.....	401

Publications of the
PACIFIC COAST
BUILDING OFFICIALS CONFERENCE

UNIFORM BUILDING CODE:

Single copies or up to 24.....	\$1.00 ea.
25 to 49 copies.....	.95 ea.
50 to 99 copies.....	.90 ea.
100 to 499 copies.....	.85 ea.
500 copies or more.....	.80 ea.
Fabricoid-bound copies with sewed backs.....	2.00 ea.
Charge for engraving name in gold on cover of fabricoid-bound copy.....	.50 ea.

For codes desired to be sent by air mail enclose \$1.00 extra per copy ordered. Regular parcels post charges are prepaid.

Several chapters of the Uniform Building Code are reprinted as pamphlets, including the chapters on wood frame, and plastering. Prices may be had by writing Conference Headquarters.

SPECIFICATION DOCUMENTS:

The Appended Documents of the Uniform Building Code are available in book form, some 60 documents, classified and arranged by subject matter with table of contents and index in standard terminology. Price \$4.00 per copy.

BUILDING STANDARDS MONTHLY:

Monthly publication devoted to technical and factual data covering structural design, quality and application of building materials, building code interpretation, national safety standards, fire zoning, earthquake resistive provisions and kindred topics. Subscription price, \$1.50 a year.

PROSPECTUS:

A pamphlet on the history and purposes of the Uniform Building Code and the Pacific Coast Building Officials Conference is obtainable without charge through Conference Headquarters.

Published by
R. C. COLLING AND ASSOCIATES,
for the

Pacific Coast Building Officials Conference
124 West Fourth St. Los Angeles, Calif.

hold securely the column or post in position and to protect its base from deterioration; shall be supported in basements by footings projecting at least two inches above the finished floor and separated therefrom by a metal plate of not less than one-quarter inch ($\frac{1}{4}$ ") thickness; shall not rest directly or indirectly on floor beams except in cases where there is no column below.

Preservatives shall be applied to column ends where necessary to protect against dampness.

Untreated wood columns in basements, when built into masonry partitions or walls, shall be exposed on at least two sides.

Wood posts, where used as foundations below ground and as piles, (except for minor structures), shall be pressure-treated with an approved preservative.

Sec. 2516. The compressive strength of built-up columns or compression members, when composed of two or more members spiked or bolted together, either with or without spacing blocks between members, shall be taken as the combined compressive strength of the individual pieces, each considered as an independent column; provided, however, that compression members which are fastened together by bolts and timber connectors, or otherwise used in such a manner as to approach fixed-end conditions, or which are laterally braced parallel to the least dimension of the individual members, may be calculated as having 80 per cent of the compressive strength of long columns

Built-Up Columns or Compression Members

having a slenderness ratio $\frac{l}{d}$ based on the least overall dimension of the composite member.

Specially designed spaced compression members shall be based upon design principles acceptable to the Building Inspector.

Sec. 2517. Where joists enter stud walls, either exterior or interior, in which the studs are not cut off and capped underneath the joists thus giving bearing support thereto, such joists shall be connected to the studs in an approved manner or may be supported on a wooden ribbon not less than one inch by four inches (1"x4") set snugly into the studs. In the latter case design shall be in accordance with Section 2503 (f).

Horizontal Members

Joists under bearing partitions and running parallel thereto shall be doubled and well spiked or separated by solid bridging not more than sixteen inches (16") on centers to permit the passage of pipes.

The bearing surfaces of masonry on which wooden structural members are to rest shall be finished to give true and even support. When less than three feet (3') from the ground, the bearing surfaces of wooden joists, beams, girders, built-up girders, or rafters over six inches (6") in width of bearing, which would otherwise rest directly upon masonry or concrete shall be protected in an approved manner against damage by moisture or other injurious conditions.

Every wooden joist, rafter, beam or girder entering any masonry or reinforced concrete wall shall be separated from

Sections 2517-2521

any wood members entering the opposite side of said wall by at least four inches (4") of solid masonry.

Ends of wood members entering masonry or concrete walls shall be treated with approved preservative or shall be provided with metal wall boxes affording one-half inch ($\frac{1}{2}$ ") air space on each side or shall be provided with at least one inch (1") of air space at top and sides.

Header beams shall be placed not closer than twenty inches (20") from the face of a chimney. All spaces between chimneys and wood joists or beams shall be filled with loose incombustible materials placed in an incombustible support, or a metal collar connected to the chimney and fastened to the joists, beams or flooring to form an effective fire stop.

All joists shall have a minimum bearing of two inches (2") except when supported on a ribbon board and nailed securely to the adjoining stud.

Cutting of wood girders, beams or joists shall be limited to that permitted in Sections 2506 and 2521.

Wall Anchors and Ties

Sec. 2518. When timber construction is used in connection with masonry or reinforced concrete walls, the walls shall be tied to the interior timber construction at each floor and roof at horizontal intervals as required by design loads and stresses.

Where the joists, rafters or beams are supported by wooden girders, such girders shall be anchored to the walls so as to furnish resistance as required by the design loads and stresses.

Header and Tail Joists

Sec. 2519. Header joists over six feet (6') long and tail joists over twelve feet (12') long shall be hung in joist or beam hangers, or secured by other devices affording equivalent support.

Trimmers and header joists more than four feet (4') long shall be doubled.

Bridging

Sec. 2520. Wooden cross bridging or metal cross bridging of equal strength shall be placed between joists if the span of the joists is greater than eight feet (8'). The distance between bridging or between bridging and bearing shall not exceed eight feet (8'). Each member of wood cross bridging shall be not less than two inches by three inches (2"x3") nominal.

Solid bridging shall be placed between joists at all points of support, except when resting on ribbons, and at the edges of openings where the flooring is not continued.

Cutting and Notching

Sec. 2521. Girders, beams or joists, may be notched or bored in any part of the section within three times the beam depth from either support. Such notches or holes shall not exceed one-fifth of the depth of beam except at point of support and as hereinafter provided.

Where girders, beams or joists are notched at points of support they shall meet design requirements for net section in bending and also for shear. The unit shearing stress at such