


TOENAIL CONNECTIONS

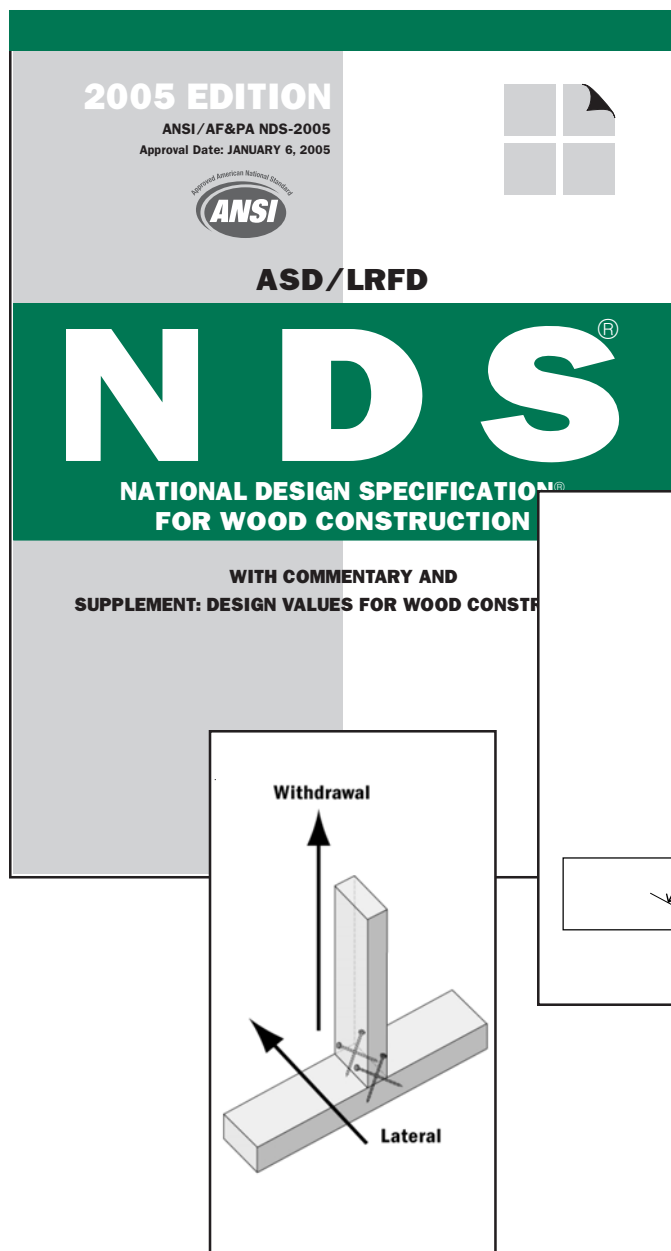

DESIGN AID No. 2

**American
Forest &
Paper
Association**

DESIGN AID FOR TOENAIL CONNECTIONS

The American Wood Council (AWC) is part of the wood products group of the American Forest & Paper Association (AF&PA). AF&PA is the national trade association of the forest, paper and wood products industry, representing member companies engaged in growing, harvesting, and processing wood and wood fiber, manufacturing pulp, paper, and paperboard products from both virgin and recycled fiber, and producing engineered and traditional wood products. For more information see www.afandpa.org.

While every effort has been made to insure the accuracy of the information presented, and special effort has been made to assure that the information reflects the state-of-the-art, neither the American Forest & Paper Association nor its members assume any responsibility for any particular design prepared from this publication. Those using this document assume all liability from its use.

Copyright © 2007
American Forest & Paper Association, Inc.

American Wood Council
1111 19th St., NW, Suite 800
Washington, DC 20036
202-463-4713
awcinfo@afandpa.org
www.awc.org

Introduction

This Design Aid was developed as supplemental information for the *National Design Specification® (NDS®) for Wood Construction* to facilitate the design of connections. These tables are based on provisions of the 2001 and later editions of the NDS which are integral to the use and understanding of the tables.

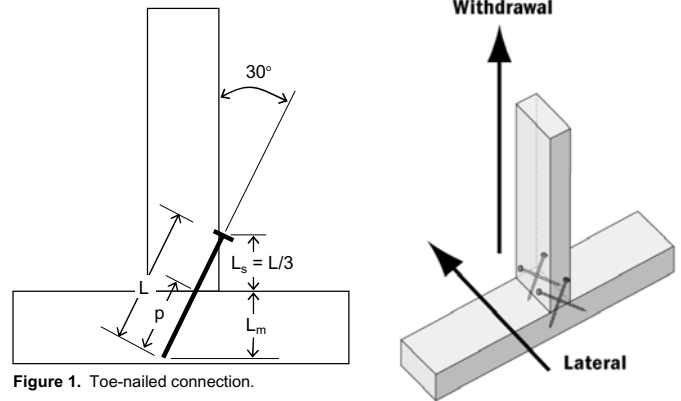


Figure 1. Toe-nailed connection.

Reference **Lateral Design Values (Z)** for **Toe-Nailed Connections**^{1,2}
for Sawn Lumber or SCL with both members of identical specific gravity

Nail Type	Nail Diameter D in.	Nail Length			G=0.67 Red Oak	G=0.55 Mixed Maple Southern Pine	G=0.5 Douglas Fir-Larch	G=0.49 Douglas Fir-Larch (N)	G=0.46 Douglas Fir(S) Hem-Fir(N)	G=0.43 Hem-Fir	G=0.42 Spruce-Pine-Fir	G=0.37 Redwood (open grain)	G=0.36 Eastern Softwoods Spruce-Pine-Fir (S) Western Cedars Western Woods	G=0.35 Northern Species
		L in.	Ls in.	Lm in.										
Box	0.099	2	0.67	1.07	60	50	46	45	42	38	36	30	29	28
	0.113	2.5	0.83	1.33	78	66	60	59	56	52	50	41	40	38
	0.128	3	1.00	1.60	101	84	77	75	71	67	65	55	53	51
	0.135	3.5	1.17	1.86	112	94	86	84	79	74	73	65	63	60
	0.148	4	1.33	2.13	128	107	98	95	91	85	83	74	72	70
Common	0.162	5	1.67	2.66	153	128	117	114	108	101	99	88	87	84
	0.113	2	0.67	1.07	78	65	57	55	50	46	44	37	36	35
	0.131	2.5	0.83	1.33	105	88	80	77	71	64	62	52	50	48
	0.148	3	1.00	1.60	128	107	98	95	91	82	80	66	64	61
Sinker	0.162	3.5	1.17	1.86	153	128	117	114	108	101	99	82	80	76
	0.099	2.125	0.71	1.13	60	50	46	45	43	39	38	31	30	29
	0.113	2.375	0.79	1.27	78	66	60	59	56	50	48	40	39	37
	0.120	2.875	0.96	1.53	88	74	68	66	63	59	57	49	47	45
	0.135	3.125	1.04	1.67	112	94	86	84	79	74	73	61	59	56
	0.148	3.250	1.08	1.73	128	107	98	95	91	85	83	69	67	64

1. Tabulated lateral design values (Z) shall be multiplied by all applicable adjustment factors (see NDS Table 10.3.1). Tabulated lateral design values (Z) have been multiplied by the toe-nail factor, $C_{tn} = 0.83$ as specified in NDS 11.5.4.2.

2. Tabulated lateral design values (Z) are for toe-nailed connections with common wire, box and sinker nails (see NDS Appendix L) installed in accordance with NDS; side and main member thickness sufficient to provide complete embedment of the nail into the wood members; and nail bending yield strengths (F_{yb}): $F_{yb} = 100,000$ psi for $0.099" \leq D \leq 0.142"$; $F_{yb} = 90,000$ psi for $0.142" < D \leq 0.177"$

Reference **Withdrawal Design Values (Wp)** for **Toe-Nailed Connections**^{1,2}
in Sawn Lumber or SCL

Nail Type	Nail Diameter D in.	Nail Length			G=0.67 Red Oak	G=0.55 Mixed Maple Southern Pine	G=0.5 Douglas Fir-Larch	G=0.49 Douglas Fir-Larch (N)	G=0.46 Douglas Fir(S) Hem-Fir(N)	G=0.43 Hem-Fir	G=0.42 Spruce-Pine-Fir	G=0.37 Redwood (open grain)	G=0.36 Eastern Softwoods Spruce-Pine-Fir (S) Western Cedars Western Woods	G=0.35 Northern Species
		L in.	Ls in.	Lm in.										
Box	0.099	2	0.67	1.07	41	25	20	19	16	14	13	9	9	8
	0.113	2.5	0.83	1.33	59	36	28	27	23	19	18	13	12	12
	0.128	3	1.00	1.60	80	49	39	37	31	26	25	18	17	16
	0.135	3.5	1.17	1.86	99	60	48	45	39	33	31	22	21	19
	0.148	4	1.33	2.13	124	76	60	57	48	41	38	28	26	24
Common	0.162	5	1.67	2.66	169	103	81	77	66	56	53	38	36	33
	0.113	2	0.67	1.07	47	29	23	22	18	16	15	11	10	9
	0.131	2.5	0.83	1.33	68	42	33	31	27	23	21	16	14	14
	0.148	3	1.00	1.60	93	57	45	42	36	31	29	21	20	18
Sinker	0.162	3.5	1.17	1.86	119	72	57	54	46	39	37	27	25	23
	0.099	2.125	0.71	1.13	44	27	21	20	17	15	14	10	9	9
	0.113	2.375	0.79	1.27	56	34	27	26	22	19	17	13	12	11
	0.120	2.875	0.96	1.53	72	44	35	33	28	24	22	16	15	14
	0.135	3.125	1.04	1.67	88	54	42	40	34	29	27	20	19	17
	0.148	3.250	1.08	1.73	101	61	48	46	39	33	31	23	21	20

1. Tabulated withdrawal design values (Wp) shall be multiplied by all applicable adjustment factors (see NDS Table 10.3.1). Tabulated withdrawal design values (Wp) have been multiplied by the toe-nail factor, $C_{tn} = 0.67$ as specified in NDS 11.5.4.1.

2. Tabulated withdrawal design values (Wp) are for toe-nailed connections with common wire, box and sinker nails (see NDS Appendix L) with side and main member thickness sufficient to provide complete embedment of the nail in the wood members

**American Forest & Paper Association
American Wood Council
1111 19th Street, NW
Suite 800
Washington, DC 20036
Phone: 202-463-4713
Fax: 202-463-2791
awcinfo@afandpa.org
www.awc.org**

A F & P A[®]

